

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law (Chapter 644 RSMo, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended,

Permit No. MO-0002453

Owner: Expert Management Inc. (c/o Akzo Nobel Inc). Attn: Inge Welles
Address: 525 Marriot Drive, Suite 500, Nashville TN, 37214

Continuing Authority: Expert Management Inc.
Address: same as above

Facility Name: Expert Management Inc.
Facility Address: 3078 County Road 180, Carthage, MO 64836

Legal Description: Outfall #004: SE ¼, SW ¼, Sec. 25, T28N, R32W; Jasper Co.
Outfall #018: NW ¼, SE ¼, Sec. 36, T28N, R32W; Jasper Co.

UTM Coordinates: Outfall #004: X = 377679; Y = 4108254
Outfall #018: X = 377963; Y = 4107175

Receiving Stream: Tributary to Grove Creek
First Classified Stream and ID: Presumed Use Stream (C) WBID #5079
USGS Basin & Sub-watershed No.: 11070207-0606: Grove Creek-Center Creek


authorizes activities pursuant to the terms and conditions of this permit in accordance with the Missouri Clean Water Law and/or the National Pollutant Discharge Elimination System; it does not apply to other regulated activities.

FACILITY DESCRIPTION

Former SIC # 2892 (historic: manufacturing of explosives); current SIC # 6512 (nonresidential building operators); groundwater monitoring (monitored natural attenuation as regulated by the Department's Hazardous Waste Program); outfall #004 receives stormwater runoff and spring seepage from a 246-acre watershed where former production facilities existed, several corrective action sites all now in post-closure care, and pasture; some stormwater runoff from the northwest portion of General Dynamics/EBVEEC's property drains toward this outfall; outfall #018 discharge from overland flow wetlands; normally does not discharge; some stormwater runoff from the southern portion of General Dynamics/EBVEEC's property drains toward this outfall. Outfall #004 maximum discharge was 10.657 MGD, and outfall #018 was 19.006 MGD for the last five years.

September 1, 2023
Effective Date

August 31, 2028
Expiration Date



John Hoke, Director, Water Protection Program

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

OUTFALL #004 AND #018 <i>Stormwater Only</i>		TABLE A-1 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS				
The facility is authorized to discharge from outfall(s) as specified. The final effluent limitations shall become effective on September 1, 2023 and remain in effect until expiration of the permit. Discharges shall be controlled, limited and monitored by the facility as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL LIMITATIONS		BENCH-MARKS	MONITORING REQUIREMENTS	
		DAILY MAXIMUM	MONTHLY AVERAGE		MINIMUM MEASUREMENT FREQUENCY	SAMPLE TYPE
LIMIT SET: A						
PHYSICAL						
Flow	MGD	*		-	once/year	24 Hr Est.
CONVENTIONAL						
pH †	SU	6.5 to 9.0		-	once/year	grab
Total Suspended Solids	mg/L	*		once/year	grab	
NUTRIENTS						
Ammonia as N	mg/L	**		2.5	once/year	grab
Nitrate as N	mg/L	**		23.2	once/year	grab
Nitrogen, Total (TN) ‡	mg/L	*		-	once/year	grab
OTHER						
2, 4-Dinitrotoluene	µg/L	*	-	once/year	grab	
2, 6-Dinitrotoluene	µg/L	*	-	once/year	grab	
Perchlorate	µg/L	**	9,300	once/year	grab	
MONITORING REPORTS SHALL BE SUBMITTED <u>ANNUALLY</u> ; THE FIRST REPORT IS DUE <u>JANUARY 28, 2024</u> .						

* Monitoring and reporting requirement only

** Monitoring and reporting requirement with benchmark. See Special Conditions for additional requirements.

† pH: the facility will report the minimum and maximum values; pH is not to be averaged.

‡ Nitrogen, Total (TN), is a calculation using TKN + Nitrate + Nitrite. Or alternatively, a sample may be collected and analyzed directly for TN.

B. STANDARD CONDITIONS

In addition to specified conditions stated herein, this permit is subject to the attached Part I standard conditions dated August 1, 2014 and hereby incorporated as though fully set forth herein.

C. SPECIAL CONDITIONS

- Spills, Overflows, and Other Unauthorized Discharges.
 - Any spill, overflow, or other discharge(s) not specifically authorized are unauthorized discharges.
 - If an unauthorized discharge causes or permits any contaminants to discharge or enter waters of the state, the unauthorized discharge must be reported to the regional office as soon as practicable but no more than 24-hours after the discovery of the discharge. If the spill or overflow needs to be reported after normal business hours or on the weekend, the facility must call the Department's 24-hour spill line at 573-634-2436.
- Electronic Discharge Monitoring Report (eDMR) Submission System. Per 40 CFR Part 127, the National Pollutant Discharge Elimination System (NPDES) Electronic Reporting Rule, reporting of effluent monitoring data and any report required by the permit (unless specifically directed otherwise by the permit), shall be submitted via an electronic system to ensure collection of a timely, complete, accurate, and nationally consistent set of data for the NPDES program. The eDMR system is currently the only Department-approved reporting method for this permit unless specified elsewhere in this permit, or a waiver is granted by the Department. The facility must register in the Department's eDMR system through the Missouri Gateway for Environmental Management (MoGEM) before the first report is due. All reports uploaded into the system shall be reasonably named so they are easily identifiable, such as "WET Test Chronic Outfall 002 Jan 2023", or "Outfall004-DailyData-Mar2025".

3. Stormwater Pollution Prevention Plan (SWPPP).

The facility holds a RCRA Subtitle C permit and hence shall implement a Stormwater Pollution Prevention Plan (SWPPP) [40 CFR 122.26(b)(14)(iv) and/or 10 CSR 20-6.200(2)(B)], which must be prepared and implemented upon permit effective date. The SWPPP must be kept on-site and not sent to the Department unless specifically requested. The SWPPP must be reviewed and updated every five (5) years or if site conditions affecting stormwater change. The facility shall select, install, use, operate, and maintain the Best Management Practices prescribed in the SWPPP in accordance with the concepts and methods described in: *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (EPA 833-B-09-002 March 2021) (https://www.epa.gov/sites/production/files/2021-03/documents/swppp_guide_industrial_2021_030121.pdf). The purpose of the SWPPP and the Best Management Practices (BMPs) listed herein is the prevention of pollution of waters of the state. A deficiency of a BMP means it was ineffective at providing the necessary protections for which it was designed. Corrective action describes the steps the facility took to eliminate the deficiency.

The SWPPP must include:

- (a) A listing of specific contaminants and their control measures (BMPs) and a narrative explaining how BMPs are implemented to control and minimize the amount of contaminants potentially entering stormwater.
- (b) A map with all outfalls and structural BMPs marked.
- (c) If within the boundaries of a regulated Municipal Separate Storm Sewer System (MS4s), list the name of the regulated MS4.
- (d) A schedule for at least quarterly site inspections and brief written reports. The inspection report must include precipitation information for the entire period since the last inspection, as well as observations and evaluations of BMP effectiveness. A BMP is considered to be disrupted if it is rendered ineffective as a result of damage or improper maintenance. Categorization of a deficiency is reliant on the length of time required to correct each disrupted BMP. Corrective action after discovering a disrupted BMP must be taken as soon as possible. Throughout coverage under this permit, the facility must perform ongoing SWPPP review and revision to incorporate any site condition changes.
 - (1) Operational deficiencies are disrupted BMPs which the facility is able to and must correct within 7 calendar days.
 - (2) Minor structural deficiencies are disrupted BMPs which the facility is able to and must correct within 14 calendar days.
 - (3) Major structural deficiencies (deficiencies projected to take longer than 14 days to correct) are disrupted BMPs which must be reported as an uploaded attachment through the eDMR system with the DMRs. The initial report shall consist of the deficiency noted, the proposed remedies, the interim or temporary remedies (including proposed timing of the placement of the interim measures), and an estimate of the timeframe needed to wholly complete the repairs or construction. If required by the Department, the facility shall work with the regional office to determine the best course of action. The facility may consider temporary structures to control stormwater runoff. The facility shall correct the major structural deficiency as soon as reasonably achievable.
 - (4) All actions taken to correct the deficiencies shall be included with the written report, including photographs, and kept with the SWPPP. Additionally, corrective action of major structural deficiencies shall be reported as an uploaded attachment through the eDMR system with the DMRs.
 - (5) BMP failure causing discharge through an unregistered outfall is considered an illicit discharge and must be reported in accordance with Standard Conditions Part I.
 - (6) Inspection reports must be kept on site with the SWPPP and maintained for a period of five (5) years. These must be made available to Department personnel upon request. Electronic versions of the documents and photographs are acceptable.
- (e) A provision for designating a responsible individual for environmental matters.

4. Site-wide minimum Best Management Practices (BMPs). At a minimum, the facility shall adhere to the following:

- (a) Provide good housekeeping practices on the site to keep trash from entry into waters of the state.
- (b) Provide collection facilities and arrange for proper disposal of waste products including but not limited to petroleum waste products, and solvents.
- (c) Store all paint, solvents, petroleum products, petroleum waste products (except fuels), and storage containers (such as drums, cans, or cartons) so these materials are not exposed to stormwater or provide other prescribed BMPs such as plastic lids and/or portable spill pans to prevent the commingling of stormwater with container contents. Commingled water may not be discharged under this permit. Provide spill prevention control, and/or management sufficient to prevent any spills of these pollutants from entering waters of the state. Any containment system used to implement this requirement shall be constructed of materials compatible with the substances contained and shall also prevent the contamination of groundwater. Spill records shall be retained on-site or readily accessible electronically.
- (d) Provide sediment and erosion control sufficient to prevent or minimize sediment loss off of the property, and to protect embankments from erosion.
- (e) Wash water is not produced at this site therefore washing is not a permitted activity.
- (f) The facility shall not apply salt and sand (traction control) in excess of what is required to maintain safe roadways and walkways. In the spring, after potential for additional snow or ice accumulation, if there is evidence of significant excess traction control materials, the facility shall remove excess sand or salt as soon as possible to minimize and control the discharge of salt and solids. At all times the facility shall use salt judiciously to minimize freshwater salinization.

- (g) Salt and sand shall be stored in a manner minimizing mobilization in stormwater (for example: under roof, in covered container, under tarp, etc.).
5. Stormwater Benchmarks. This permit stipulates numeric pollutant benchmarks applicable to the facility's stormwater discharges.
- (a) Benchmarks do not constitute direct numeric effluent limitations; therefore, a benchmark exceedance alone is not a permit violation. Stormwater monitoring, numeric benchmark compliance, and visual inspections shall be used to determine the overall effectiveness of the BMPs identified in the SWPPP.
 - (b) If any annual sample exceeds a benchmark concentration, the facility must review the SWPPP and BMPs to determine what improvements or additional controls are needed to reduce pollutant concentrations in future stormwater discharges.
 - (c) Every time a numeric benchmark exceedance occurs, a Corrective Action Report (CAR) must be completed. A CAR is a document recording the efforts undertaken by the facility to improve BMPs to meet benchmarks in future samples. CARs must be retained with the SWPPP and be available to the Department upon request. This permit may require CARs be submitted to the Department upon permit renewal; see Renewal Requirements section below.
 - (d) Failure to take corrective action to address numeric benchmark exceedance, and failure to make measureable progress towards achieving the numeric benchmark(s), is a permit violation.
 - (e) Stormwater benchmarks and required minimum BMPs as described in this permit are enforceable permit conditions. Any requested change(s) to numeric benchmark values or deviation from minimum BMP requirements must be established through the permitting process. Assessment, evaluation, and implementation of specific BMPs to meet numeric benchmarks or minimum BMP requirements, must be addressed through the SWPPPs and CARs.
6. All outfalls must be clearly marked in the field.
7. Report as no-discharge when a discharge does not occur during the report period. It is a violation of this permit to report no-discharge when a discharge has occurred.
8. This facility is not allowed to report "operational shutdown" as a NODI code in the DMR system. A sample for stormwater must be taken every year if there is a discharge regardless of staff presence.
9. This facility may not report "0" as a value for any parameter unless the true value is 0; the minimum value the facility is allowed to report is the method detection limit of the analytical method. The facility will use the method detection limit and a less than (<) sign to report sample results.
10. Reporting of Non-Detects.
- (a) Compliance analysis conducted by the facility or any contracted laboratory shall be conducted in such a way the precision and accuracy of the analyzed result can be enumerated. See sufficiently sensitive test method requirements in Standard Conditions Part I, §A, No. 4 regarding proper testing and detection limits used for sample analysis. For the purposes of this permit, the definitions in 40 CFR 136 apply; method detection limit (MDL) and laboratory-established reporting limit (RL) are used interchangeably in this permit. The reporting limits established by the laboratory must be below the lowest effluent limits established for the specified parameter (including any parameter's future limit after an SOC) in the permit unless the permit provides for an ML.
 - (b) The facility shall not report a sample result as "non-detect" without also reporting the MDL. Reporting "non-detect" without also including the MDL will be considered failure to report, which is a violation of this permit.
 - (c) For the daily maximum, the facility shall report the highest value; if the highest value was a non-detect, use the less than "<" symbol and the laboratory's highest method detection limit (MDL) or the highest reporting limit (RL); whichever is higher (e.g. <6).
 - (d) When calculating monthly averages, the detection limit shall be used in place of any value(s) not detected. Where all data used in the average are below the MDL or RL, the highest MDL or RL shall be reported as "<#" for the average as indicated in item (c).
11. Failure to pay fees associated with this permit is a violation of the Missouri Clean Water Law (644.055 RSMo).
12. This permit does not cover land disturbance activities.
13. This permit does not allow stream channel or wetland alterations unless approved by Clean Water Act §404 permitting authorities.
14. This permit does not authorize in-stream treatment, the placement of fill materials in flood plains, placement of solid materials into any waterway, the obstruction of stream flow, or changing the channel of a defined drainage course.
15. All records required by this permit may be maintained electronically. These records can be maintained in a searchable format.

16. Changes in Discharges of Toxic Pollutant.

In addition to the reporting requirements under 40 CFR 122.41, all existing manufacturing, commercial, mining, and silvicultural dischargers must notify the Director per 40 CFR 122.42(a)(1) and (2) as soon as recognizing:

- (a) An activity has occurred or will occur which would result in the discharge, on a routine or frequent basis, of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following notification levels:
 - (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile;
 - (3) Five hundred micrograms per liter (500 µg/L) for 2,4-dinitrophenol and for 2-methyl-4, 6-dinitrophenol;
 - (4) One milligram per liter (1 mg/L) for antimony;
 - (5) Five (5) times the maximum concentration value reported for the pollutant in the permit application in accordance with 40 CFR 122.21(g)(7); or
 - (6) The notification level established by the Department in accordance with 40 CFR 122.44(f).
- (b) Any activity has occurred or will occur which would result in any discharge, on a non-routine or infrequent basis, of a toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels":
 - (1) Five hundred micrograms per liter (500 µg/L);
 - (2) One milligram per liter (1 mg/L) for antimony;
 - (3) Ten (10) times the maximum concentration value reported for the pollutant in the permit application in accordance with 40 CFR 122.21(g)(7).
 - (4) The level established by the Director in accordance with 40 CFR 122.44(f).
- (c) Authorization of new or expanded pollutant discharges may be required under a permit modification or renewal, and may require an antidegradation review.

17. This permit does not authorize the facility to accept, treat, or discharge wastewater from other sources unless explicitly authorized herein. If the facility would like to accept, treat, or discharge wastewater from another activity or facility, the permit must be modified to include external wastewater pollutant sources in the permit.

18. The full implementation of this operating permit, which includes implementation of any applicable schedules of compliance, shall constitute compliance with Sections 301, 302, 306, 307, and 403 of the federal Clean Water Act, except for standards imposed under Section 307 for toxic pollutants injurious to human health, and with equivalent provisions of the Missouri Clean Water Law, in accordance with Section 644.051.16 RSMo and CWA §402(k). This permit may be reopened and modified, or alternatively revoked and reissued to comply with any applicable effluent standard or limitation issued or approved under CWA §§301(b)(2)(C) and (D), §304(b)(2), and §307(a)(2), if the effluent standard or limitation so issued or approved contains different conditions or is otherwise more stringent than any effluent limitation in the permit, or controls any pollutant not already limited in the permit. This permit may be modified, revoked and reissued, or terminated for cause, including determination of new pollutants found in the discharge not identified in the application for the new or revised permit. The filing of a request by the facility for a permit modification, termination, notice of planned changes, or anticipated non-compliance does not stay any permit condition.

19. Any discharges (or qualified activities such as land application) not expressly authorized in this permit, and not clearly disclosed in the permit application, cannot become authorized or shielded from liability under CWA section 402(k) or Section 644.051.16, RSMo, by disclosure to EPA, state, or local authorities after issuance of this permit via any means, including any other permit applications, funding applications, the SWPPP, discharge monitoring reporting, or during an inspection. Submit a permit modification application, as well as an antidegradation determination if appropriate, to request authorization of new or expanded discharges.

20. This facility does not have permission to discharge any pollutant not expressly authorized in Table A of the permit.

D. NOTICE OF RIGHT TO APPEAL

If you were adversely affected by this decision, you may be entitled to pursue an appeal before the administrative hearing commission (AHC) pursuant to 621.250 and 644.051.6 RSMo. To appeal, you must file a petition with the AHC within thirty days after the date this decision was mailed or the date it was delivered, whichever date was earlier. If any such petition is sent by registered mail or certified mail, it will be deemed filed on the date it is mailed; if it is sent by any method other than registered mail or certified mail, it will be deemed filed on the date it is received by the AHC. Any appeal shall be directed to:

Administrative Hearing Commission; U.S. Post Office Building, Third Floor
131 West High Street, P.O. Box 1557; Jefferson City, MO 65102-1557
Phone: 573-751-2422; Fax: 573-751-5018; Website: <https://ahc.mo.gov>

MISSOURI DEPARTMENT OF NATURAL RESOURCES
FACT SHEET
FOR THE PURPOSE OF RENEWAL OF
MO-0002453
EXPERT MANAGEMENT INC.

The Federal Water Pollution Control Act (Clean Water Act (CWA) §402 Public Law 92-500 as amended) established the National Pollutant Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of stormwater from certain point sources. All such discharges are unlawful without a permit (§301 of the Clean Water Act). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal Clean Water Act and Missouri Clean Water Law 644 RSMo as amended). MSOPs may also cover underground injection, non-discharging facilities, and land application facilities. Permits are issued for a period of five (5) years unless otherwise specified for less.

Per 40 CFR Part 124.8(a) and 10 CSR 20-6.020(1)(A)2., a fact sheet shall be prepared to give pertinent information regarding applicable regulations, rationale for the development of limitations and conditions, and the public participation process for the Missouri State Operating Permit (MSOP or permit) listed below. A fact sheet is not an enforceable part of a permit.

PART I. FACILITY INFORMATION

Facility Type:	Industrial: minor, noncategorical, >1 MGD
SIC Code(s):	(former) 2892; current 6512 (Operators of Nonresidential Buildings)
NAICS Code(s):	(former) 325920; current 531390 (Other Activities Related to Real Estate)
Application Date:	06/27/2022
Modification Date:	mm/dd/yyyy
Expiration Date:	12/31/2022
Last Inspection:	01/26/2022

FACILITY DESCRIPTION

Former chemical and explosives manufacturing facility, formerly known as Atlas Powder Company, ICI Explosives, and Joplin Manufacturing. The facility previously manufactured industrial grade ammonium nitrate, weak nitric acid, ammonium nitrate based emulsion explosives, trinitrotoluene (TNT), blasting agents and other chemicals in the support of the explosives industry. The former manufacturing facility encompasses an area of approximately 583 acres. Expert Management retains responsibility for post-closure care, corrective action, and monitoring related to the soil and groundwater pursuant to a permit with the department's Environmental Remediation Program (MOD077887909); EIN # 22-3830075.

The facility was constructed in 1901 by E.I. DuPont de Nemours & Company, (DuPont) Incorporated, approximately 6.5 miles northeast of Joplin in Jasper County. In 1912, DuPont divested portions of its explosives operations and the plant became part of the newly formed Atlas Powder Company. In 1961, the company incorporated under the name Atlas Chemical Industries. The primary product of the plant was commercial grade dynamite. During World War II, trinitrotoluene (TNT) was produced. From 1940 through the late 1980s, a portion of the property was leased to the WR Grace Company for the production of mixed fertilizers. Starting in the 1950s, nitric acid and ammonium nitrate production lines were added. As a part of a joint venture with Standard Oil, ammonia and urea were produced through the 1960s and 1970s. In the early 1970s, ICI acquired Atlas Chemical Industries. ICI then divested the Atlas Powder explosives operations in 1973. Atlas Powder Company became a wholly-owned subsidiary of the Tyler Corporation from approximately mid-1973 until May 1990, when it was re-acquired by ICI. Several operations ceased between May 1990 and January 2000. ICI sold the bulk of its business and assets (exclusive of the real property) in February 2000 to Joplin Manufacturing, Incorporated (JMI), which continued to manufacture emulsion explosives until September 2001. ICI changed its name to Expert Management Inc. (EMI) in December 2001. JMI ceased operations at the facility and their lease of the real property on January 31, 2002. There are no current manufacturing operations at the facility. EMI retains responsibility for post-closure care and monitoring related to the soil and groundwater.

EPA issued a 1989 Resource Conservation and Recovery Act (RCRA) Corrective Action Administrative Order on Consent for the Facility. While the facility initially conducted corrective action under that order, the order was subsequently terminated once the Post Closure Permit was issued in about 2005. The facility has been conducting corrective action and post-closure activities since approximately 1990. In 1991, various production lines began shutting down. With the shutdown of production lines, production buildings began being demolished allowing for corrective action to occur. Operations at the facility ceased in 2001. Since 2001, the company has completed remediation of various areas with a hazardous waste post-closure permit and the stormwater permit. In 1999, a series of 10 wetlands were constructed, 3 as active treatment and 7 as upland wetlands. The construction of the wetlands changed the

drainage patterns of the area, which allowed outfalls to be closed as flows were rerouted. To close outfall #002, the wetlands were further extended in 2003. There are over 40 acres of wetlands on site now.

Active remediation that included off-site disposal and/or on-site treatment (i.e., composting) of impacted soil was completed at the facility in the fall of 2019, and formally closed-out and approved by MDNR in April 2020. The facility was issued a post-closure care permit on August 31, 2020.

In 2009, the Hazardous Waste Program (now Environmental Remediation Program; ERP) modified its Permit to include benzene, ethylbenzene, toluene, xylene, and methyl tertiary butyl ether in the Table 1: Groundwater Protection Standard of the Hazardous Waste Part I Permit. In discussions with the facility and the ERP, monitoring at Outfall 004 is not in the drainage area where the underground storage containers were located and monitoring for the parameters is not appropriate at outfalls #004 or #018.

The facility received a Class II inspection on January 26, 2022. The inspection findings were of compliance.

Items listed in the facility (or outfall) description, applicable to the operation, maintenance, control, and resultant effluent quality are required to be enumerated in the facility description. The facility description ensures the facility continues to operate the wastewater (or stormwater) controls listed in the permit to preserve and maintain the effluent quality pursuant to 40 CFR 122.21(e). Any planned changes to the facility (which changes the facility or outfall description) are required to be reported to the Department pursuant to 40 CFR 122.41(l)(1)(ii). If the facility does not or cannot use all of their disclosed treatment devices, this is considered bypassing pursuant to 40 CFR 122.41(m) in the case of wastewater, and BMP disruption in the case of stormwater.

FACILITY PERFORMANCE HISTORY & COMMENTS

The electronic discharge monitoring reports were reviewed for the last five years. The facility reported no discharge and operational shutdown for several quarters. The facility may not use these NODI code for stormwater. A special condition is placed in the permit. The facility may not report 0 for any parameter. The facility must use the method detection limit or reporting limit of the parameter and a less than (<) sign. A special condition was added to the permit to correct this error.

Only outfalls #004 and #018 are actively permitted. The other outfalls have been closed during remediation activities. These outfalls consist of only stormwater and flows vary based on the precipitation received at the site. The facility utilizes best management practices to manage the stormwater at the site. The facility must adhere to numeric benchmarks for selected parameters to ensure proper operational controls are executed.

Outfalls #005 through #008 were removed in 1996 or before. Outfalls #001, #003, and #012 through #016 were removed in 2003. Outfalls #002, #009 through #011, and #017 were removed in 2006. Instream monitoring and compliance were removed from the permit in 2003. The following outfalls were removed from monitoring requirements and are listed here for permit continuity. These outfalls were deleted from MoCWIS 9/22/2017 to allow auto-mapping to complete for the site.

Outfall #001: Removed from monitoring in 2003. Former SIC #2892; process wastewater from ammonium nitrate and copper recovery system. Outfall also received effluent from the activated sludge plant and stormwater runoff from the nitrogen section. Design Flow was 0.160 MGD. Legal Description: NW ¼, SW ¼, Sec. 36, T28N, R32W; UTM Coordinates: X = 376996; Y = 4107402

Outfall #002: Removed from monitoring in 2006. Former SIC #2892, 1629; outfall previously received non-contact cooling water from the large diameter emulsion production facility, stormwater runoff from the dynamite production facility and the ammonia production facility, and spring seepage. The ammonia production facility was demolished in 1987. The dynamite production facility was closed in August 1993. As demolition and remediation occurred and other outfalls were closed, stormwater flows were routed to outfall #002. Outfall #002 received flows from a 231-acre watershed. To close outfall #002, the ditches were filled in and the wetland areas expanded. In 2006, Outfall #002 was closed and replaced by Outfall# 018 following the expansion of the constructed wetlands. Design flow was 36.38 MGD. Legal Description: SW ¼, NE ¼, Sec. 36, T28N, R32W; UTM Coordinates: X = 377908; Y = 4107456

Outfall #003: Removed from monitoring in 2003; outfall previously received chiller water, boiler blowdown, stormwater from the ammonium nitrate, weak nitric acid, and the aqua ammonia production facilities, plus stormwater from the sulfuric acid plant. The sulfuric acid facility closed in June 1993. As demolition and remediation occurred and other outfalls were closed, stormwater flows were routed to outfall #003. Flows from outfall #003 were rerouted through outfall #002; design flow was 2.93 MGD. Legal Description: NW ¼, NW ¼, Sec. 1, T27N, R32W; UTM Coordinates: X = 377273; Y = 4106182

Outfall #005: Removed from monitoring in 1996; this outfall received process wastewater from the nitroglycerin storehouses and the Biazzini facility. The Biazzini facility was permanently closed in August 1993 and the storehouses were demolished in November 1993. The outfall was eliminated after facility was demolished and stormwater runoff flows were rerouted to Outfall #003. Legal Description: NW ¼, NW ¼, Sec. 1, T27N, R32W; UTM Coordinates: X = 377279; Y = 4106273

Outfall #006: Removed prior to 1991; flows were rerouted to outfall #002.

Outfall #007: Removed from monitoring in 1991, with approval to close in 1989; flows were rerouted to Outfall #002.
Legal Description: SW ¼, NE ¼, Sec. 36, T28N, R32W; UTM Coordinates: X = 377952; Y = 4106866

Outfall #008: Removed from monitoring in 1996. Former SIC #2892; Cooling tower and boiler blowdown from the sulfuric acid facility were discharged to the sulfuric acid unit pond and then through outfall #008. The sulfuric acid facility was permanently closed in June 1993. Storm water runoff from the former cooling tower was diverted to outfall #003. Design flow was 0.04 MGD.
Legal Description: SW ¼, NE ¼, Sec. 1, T27N, R32W; UTM Coordinates: X = 376978; Y = 4106131

Outfall #009: Removed from monitoring in 2006; this outfall received storm water runoff, primarily from the former sulfuric acid plant, but some runoff traveled overland from other plant areas covering a 3.2-acre watershed. The redundant French Drain collection system was removed and any depressions were backfilled with clean compacted flows. Design flow was 0.5 MGD. Legal Description: SW ¼, NE ¼, Sec. 1, T27N, R32W; UTM Coordinates: X = 376937; Y = 4105877

Outfall #010: Removed from monitoring in 2006; outfall received storm water runoff, primarily from the former phosphoric acid production and storage facilities. This outfall received stormwater runoff from a 26.9-acre watershed. Discharge pipe removed and converted the swale to a stormwater retention basin in May 2005. Design flow was 4.24 MGD. Legal Description: SW ¼, NE ¼, Sec. 1, T27N, R32W; UTM Coordinates: X = 376838; Y = 4105909

Outfall #011: Removed from monitoring in 2003; outfall received storm water runoff, primarily from the former phosphoric acid production and storage facilities, from 24.6 acres. Flows were rerouted to outfall #010; design flow was 3.9 MGD. Legal Description: SE ¼, NE ¼, Sec. 1, T27N, R32W; UTM Coordinates: X = 377315; Y = 4106173

Outfall #012: Removed from monitoring in 2003; outfall received process wastewater from the laundry and change house before being land applied on 2.1-acres by spray irrigation. The irrigation and land application ceased in 2000, and the lagoon was sampled in 2002 for closure. Design flow was 0.02 MGD. Legal Description: SW ¼, SW ¼, Sec. 36, T28N, R32W; UTM Coordinates: X = 377439; Y = 4106794

Outfall #013: Removed from monitoring in 2003; Process and cooling water from the nitric acid section. Legal Description: NW ¼, NW ¼, Sec. 01, T27N, R32W; UTM Coordinates: X = 377114; Y = 4106167

Outfall #014: Removed from monitoring in 2003; outfall received stormwater from the distribution maintenance shop and cap magazine areas. The outfall weir was removed and the area regraded to allow natural flow. Legal Description: SE ¼, SW ¼, Sec. 25, T28N, R32W; UTM Coordinates: X = 377608; Y = 4108623

Outfall #015: Removed from monitoring in 2003; outfall received process and cooling water from the ammonium nitrate section. Legal Description: SW ¼, Sec. 36, T28N, R32W; UTM Coordinates: X = 377140; Y = 4106755

Outfall #016: Removed from monitoring in 2003. Former SIC #2892; this outfall received stormwater runoff from the former ammonium nitrate bagging plant. The outfall weir was removed and the area regraded to allow natural flow. Legal Description: NE ¼, SW ¼, Sec. 25, T28N, R32W; UTM Coordinates: X = 377839; Y = 4105934

Outfall #017: Removed from monitoring in 2006. Former SIC #2892; outfall received stormwater runoff from a 14.1-acre watershed where production activities existed; design flow was 2.22 MGD. Legal Description: SW ¼, NE ¼, Sec. 1, T27N, R32W; UTM Coordinates: X = 377285; Y = 4106087

Instream Monitoring SM01: Upstream Grove Creek monitoring point was located in Scotland Spring. NW ¼, Sec. 12, T27N, R32W; removed from monitoring in 2003.

Instream Monitoring SM02: Upstream Center Creek monitoring point was located at Center Creek and Alternate 71 bridge NW ¼, Sec. 34, T28N, R31W; removed from monitoring in 2003.

Instream Monitoring SM03: Highway HH and Center Creek monitoring point was located at HH bridge and Center Creek. NW ¼, Sec. 24, T28N, R32W; removed from monitoring in 2003.

Instream Monitoring SM04: Instream Grove Creek Compliance Point #1 was located about 1,000 feet north of outfall #002 at the end of an unpaved road. NE ¼, Sec. 36, T28N, R32W; removed from monitoring in 2003.

Instream Monitoring SM05: Instream Compliance Point #2 was located at the low water crossing. SW ¼, Sec. 25, T28N, R32W; removed from monitoring in 2003.

FACILITY MAP:



CONTINUING AUTHORITY

Pursuant to 10 CSR 20-6.010(2)(A) and (E), the Department has received the appropriate continuing authority authorized signature from the facility. The Missouri Secretary of State continuing authority charter number for this facility is F00500142; this number was verified on April 4, 2023 to be associated with the facility and precisely matches the continuing authority reported by the facility. Pursuant to 10 CSR 20-6.010(2)(B)4, this facility is a Level 4 Authority; but is stormwater only so a higher authority waiver is not required.

OTHER ENVIRONMENTAL PERMITS

In accordance with 40 CFR 122.21(f)(6), the Department evaluated other environmental permits currently held by this facility. This facility has the following: MOD077887909 for hazardous waste remediation.

PART II. RECEIVING WATERBODY INFORMATION**RECEIVING WATERBODY TABLE:**

OUTFALL	WATERBODY NAME	CLASS	WBID	DESIGNATED USES	DIS-TANCE	12-DIGIT HUC
#004 and #018	Presumed Use Stream* (Tributary to Grove Creek)	C	5079*	GEN, HHP, IRR, LWW, SCR, WBC-B, WWH (ALP)	0 mi	110702070606: Grove Creek-Center Creek

* The previous permit identified WBID# 3960 and 100K Extent-Remaining Stream; these changes are due to a new numbering system and new naming convention for streams and lakes based on the HUC8 watershed number, the actual receiving stream has not changed.

Classes are representations of hydrologic flow volume or lake basin size per 10 CSR 20-7.031(1)(E).

Designated uses are described in 10 CSR 20-7.031(1)(F).

WBID: Waterbody Identification Number per 10 CSR 20-7.031(1)(Q) and (S)

HUC: Hydrologic Unit Code <https://water.usgs.gov/GIS/huc.html>

Water Quality Standards Search https://apps5.mo.gov/mocwis_public/waterQualityStandardsSearch.do

EXISTING WATER QUALITY & IMPAIRMENTS

The receiving waterbody(s) segment(s), upstream, and downstream confluence water quality was reviewed. The USGS <https://waterdata.usgs.gov/nwis/sw> or the Department's quality data database was reviewed.

https://apps5.mo.gov/mocwis_public/wqa/waterbodySearch.do and <https://apps5.mo.gov/wqa/> Impaired waterbodies which may be impacted by discharges from this facility were determined. Impairments include waterbodies on the 305(b) or 303(d) list and those waterbodies or watersheds under a TMDL. <https://dnr.mo.gov/water/what-were-doing/water-planning/quality-standards-impaired-waters-total-maximum-daily-loads/tmdl> Section 303(d) of the federal Clean Water Act requires each state to identify waters not meeting water quality standards and for which adequate water pollution controls have not been required. <https://dnr.mo.gov/water/what-were-doing/water-planning/quality-standards-impaired-waters-total-maximum-daily-loads/impaired-waters> Water quality standards protect beneficial uses of water as provided in 10 CSR 20-7.031. The 303(d) list helps state and federal agencies keep track of impaired waters not addressed by normal water pollution control programs. A TMDL is a calculation of the maximum amount of a given pollutant a water body can absorb before its water quality is affected; hence, the purpose of a TMDL is to determine the pollutant loading a specific waterbody can assimilate without exceeding water quality standards.

✓ Applicable; this facility is found within the water shed for Center Creek and Turkey Creek Zinc TMDL. This TMDL was approved by the EPA 10/25/2006. This facility is not considered to have contributed to the impairment.

PART III. RATIONALE AND DERIVATION OF PERMIT CONDITIONS**ANTIBACKSLIDING**

Federal antibacksliding requirements [CWA §402(o) and 40 CFR § 122.44(l) [https://www.ecfr.gov/current/title-40/chapter-I/subchapter-D/part-122#p-122.44\(l\)](https://www.ecfr.gov/current/title-40/chapter-I/subchapter-D/part-122#p-122.44(l))] generally prohibit a reissued permit from containing effluent limitations that are less stringent than the previous permit, with some exceptions. All renewed permits are analyzed for evidence of backsliding. There are several express statutory exceptions to the antibacksliding requirements, located in CWA § 402(o)(2) and 40 CFR 122.44(l). Parameters are discussed individually in Part IV of the fact sheet.

ANTIDEGRADATION REVIEW

For wastewater discharges with new, altered, or expanding flows, the Department is to document, by means of antidegradation review, if the use of a water body's available assimilative capacity is justified. See <https://dnr.mo.gov/document-search/antidegradation-implementation-procedure>

✓ Not applicable; the facility does not discharge wastewater.

BEST MANAGEMENT PRACTICES

Minimum site-wide best management practices are established in this permit to ensure all facilities are managing their sites equally to protect waters of the state from certain activities which could cause negative effects in receiving water bodies. While not all sites require a SWPPP because the SIC codes are specifically exempted in 40 CFR 122.26(b)(14) or 10 CSR 20-6.200(2), these best management practices are not specifically included only for stormwater purposes. These practices are minimum requirements for all industrial sites to protect waters of the state. If the minimum best management practices are not followed, the facility may violate general criteria [10 CSR 20-7.031(4)]. Statutes are applicable to all permitted facilities in the state, therefore pollutants cannot be released unless in accordance with 644.011 and 644.016 (17) RSMo.

CLOSURE

To properly decontaminate and close a wastewater storage structure, treatment structure, lagoon, basin, or device, the facility must draft a complete closure plan, and include the Closure Request Form #2512 <https://dnr.mo.gov/document-search/facility-closure-request-form-mo-780-2512> The publication, Wastewater Treatment Plant Closure - PUB2568 found at <https://dnr.mo.gov/print/document-search/pub2568> may be helpful to develop the closure plan. The regional office will then approve the closure plan, and provide authorization to begin the work. The regional office contact information can be found here: <https://dnr.mo.gov/about-us/division-environmental-quality/regional-office>

CHANGES IN DISCHARGES OF TOXIC POLLUTANT

This special condition reiterates the federal rules found in 40 CFR 122.44(f) for technology treatments and 122.42(a)(1) for all other toxic substances. In these rules, the facility is required to report changes in amounts of toxic substances discharged. Toxic substances are defined in 40 CFR 122.2 as "...any pollutant listed as toxic under section 307(a)(1)" or, in the case of "sludge use or disposal practices," any pollutant identified in regulations implementing section 405(d) of the CWA." Section 307 of the Clean Water Act then refers to those parameters listed in 40 CFR 401.15 and any other toxic parameter the Department determines is applicable for reporting under these rules in the permit. The facility must also consider any other toxic pollutant in the discharge as reportable under this condition and must report all increases to the Department as soon as discovered in the effluent. The Department may open the permit to implement any required effluent limits pursuant to CWA §402(k) where sufficient data was not supplied within the application but was supplied at a later date by either the facility or other resource determined to be representative of the discharge, such as sampling by Department personnel.

COMPLIANCE AND ENFORCEMENT

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

✓ Not applicable; the facility is not currently under Water Protection Program enforcement action.

DISCHARGE MONITORING REPORTING – ELECTRONIC (EDMR) SUBMISSION SYSTEM

The U.S. Environmental Protection Agency (EPA) promulgated a final rule on October 22, 2015, to modernize Clean Water Act reporting for municipalities, industries, and other facilities by requiring electronic data reporting. To comply with the federal rule, the Department is requiring all facilities to submit discharge monitoring data and reports online. To review historical data, the Department's database has a publicly facing search engine, available at https://apps5.mo.gov/mocwis_public/dmrDisclaimer.do

Registration and other information regarding MoGEM can be found at <https://dnr.mo.gov/mogem>. Information about the eDMR system can be found at <https://dnr.mo.gov/env/wpp/edmr.htm>. The first user shall register as an Organization Official and the association to the facility must be approved by the Department. To access the eDMR system, use: <https://apps5.mo.gov/mogems/welcome.action> For assistance using the eDMR system, contact edmr@dnr.mo.gov or call 855-789-3889 or 573-526-2082. To assist the facility in entering data into the eDMR system, the permit describes limit sets designators in each table in Part A of the permit. Facility personnel will use these identifiers to ensure data entry is being completed appropriately. For example, M for monthly, Q for quarterly, A for annual, and others as identified.

DOMESTIC WASTEWATER, SLUDGE, AND BIOSOLIDS

Domestic wastewater is defined as wastewater originating primarily from the sanitary conveyances of bathrooms and kitchens. Domestic wastewater excludes stormwater, wash water, animal waste, process, or ancillary wastewater.

✓ Not applicable; this facility does not generate domestic wastewater on site.

EFFLUENT LIMITATIONS

Two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs) are reviewed. Permits are required to establish the most stringent or most protective limit per 10 CSR 20-7.015(9)(A) and 40 CFR 122.44(b)(1). Effluent limitations derived and established for this permit are based on current operations of the facility. Any flow through the outfall is considered a discharge and must be sampled and reported as provided in the permit. Daily maximums and monthly averages are required for continuous discharges per 40 CFR 122.45(d)(1). Weekly limits are not available for non-POTWs.

FEDERAL EFFLUENT LIMITATION GUIDELINES

Effluent Limitation Guidelines, or ELGs, are found at 40 CFR 400-499. <https://www.ecfr.gov/current/title-40/chapter-I/subchapter-N> These are limitations established by the EPA based on the type of activities a facility is conducting. Most ELGs are for process wastewater and some address stormwater. Effluent guidelines are not always established for every pollutant present in a point source discharge. In many instances, EPA promulgates effluent guidelines for an indicator pollutant. Industrial facilities complying with the effluent guidelines for the indicator pollutant will also control other pollutants (e.g. pollutants with a similar chemical structure). For example, EPA may choose to regulate only one of several metals present in the effluent from an industrial category, and compliance with the effluent guidelines will ensure similar metals present in the discharge are adequately controlled. All are technology based limitations which must be met by the applicable facility at all times. If Reasonable Potential is established for any particular parameter, and water-quality based effluent limits are more protective of the receiving water's quality, the WQBEL will be used as the limiting factor in accordance with 40 CFR 122.44(d) and 10 CSR 20-7.015(9)(A).

✓ The facility does not have an associated ELG.

GENERAL CRITERIA CONSIDERATIONS

In accordance with 40 CFR 122.44(d)(1), effluent limitations shall be placed into permits for pollutants determined to cause, have reasonable potential to cause, or to contribute to, an excursion above any water quality standard, including narrative water quality criteria. In order to comply with this regulation, permit decisions were made by completing a reasonable potential determination on whether discharges have reasonable potential to cause, or contribute to an excursion of the general criteria listed in 10 CSR 20-7.031(4). See Part III REASONABLE POTENTIAL for more information. In instances where reasonable potential exists, the permit includes limitations to address the reasonable potential. In discharges where reasonable potential does not exist, the permit may include monitoring to later determine the discharge's potential to impact the narrative criteria. Additionally, 644.076.1 RSMo, as well as Part I §D – Administrative Requirements of Standard Conditions included in this permit state it shall be unlawful for any person to cause or allow any discharge of water contaminants from any water contaminant or point source located in Missouri in violation of §§644.006 to 644.141 of the Missouri Clean Water Law or any standard, rule, or regulation promulgated by the commission. See Part IV for specific determinations.

GOOD HOUSEKEEPING PRACTICES

Good housekeeping is a practical, cost-effective way to maintain a clean and orderly facility to prevent potential pollution sources from coming into contact with stormwater. It includes establishing protocols to reduce the possibility of mishandling materials or equipment and employee training. Common areas where good housekeeping practices should be followed include trash containers and adjacent areas, material storage areas, vehicle and equipment maintenance areas, and loading docks. Good housekeeping practices must include a schedule for regular pickup and disposal of garbage and waste materials and routine inspections of drums, tanks, and containers for leaks and structural conditions. Practices also include containing and covering garbage, waste materials, and debris. Involving employees in routine monitoring of housekeeping practices is an effective means of ensuring the continued implementation of these measures.

Specific good housekeeping may include:

- ◆ Spill and overflow protection under chemical or fuel connectors to contain spillage at liquid storage tanks
- ◆ Load covers on residue hauling vehicles and ensure gates on trucks are sealed and the truck body is in good condition
- ◆ Containment curbs around loading/unloading areas or tanks
- ◆ Techniques to reduce solids residue which may be tracked on to access roads traveled by residue trucks or residue handling vehicles.
- ◆ Techniques to reduce solid residue on exit roads leading into and out of residue handling areas

Industrial facilities may conduct activities that use, store, manufacture, transfer, and/or dispose of PFAS containing materials. Successful good housekeeping practices to minimize PFAS exposure to stormwater could include inventorying the location, quantity, and method of storage; using properly designed storage and transfer techniques; providing secondary containment around chemical storage areas; and using proper techniques for cleaning or replacement of production systems or equipment.

Where feasible, minimizing exposure of potential pollutant sources to precipitation is an important control option. Minimizing exposure prevents pollutants, including debris, from coming into contact with precipitation and can reduce the need for BMPs to treat contaminated stormwater runoff. It can also prevent debris from being picked up by stormwater and carried into drains and surface waters. Examples of BMPs for exposure minimization include covering materials or activities with temporary structures (e.g., tarps) when wet weather is expected or moving materials or activities to existing or new permanent structures (e.g., buildings, silos, sheds). Even the simple practice of keeping a dumpster lid closed can be a very effective pollution prevention measure. Another example could include locating PFAS-containing materials and residues away from drainage pathways and surface waters. For erosion and sediment control, BMPs must be selected and implemented to limit erosion on areas of your site that, due to topography, activities, soils, cover, materials, or other factors, are likely to experience erosion. Erosion control BMPs such as seeding, mulching, and sodding prevent soil from becoming dislodged and should be considered first. Sediment control BMPs such as silt fences, sediment ponds, and stabilized entrances trap sediment after it has eroded. Sediment control BMPs should be used to back-up erosion control BMPs.

The SWPPP (if required for this facility) must contain a narrative evaluation of the appropriateness of stormwater management practices that divert, infiltrate, reuse, or otherwise manage stormwater runoff so as to reduce the discharge of pollutants. Appropriate measures are highly site-specific, but may include, among others, vegetative swales, collection and reuse of stormwater, inlet controls, snow management, infiltration devices, and wet retention measures. A combination of preventive and treatment BMPs will yield the most effective stormwater management for minimizing the offsite discharge of pollutants via stormwater runoff. BMPs schedules must also address preventive maintenance records or logbooks, regular facility inspections, spill prevention and response, and employee training.

GROUNDWATER MONITORING

Groundwater is a water of the state according to 644.016(27) RSMo, is subject to regulations at 10 CSR 20-7.015(7) and 10 CSR 20-7.031(6), and must be protected accordingly.

- ✓ This facility is monitoring the groundwater at the site for the Environmental Remediation Program; this permit does not include groundwater requirements because of this overlap.

ICE-MELT PRODUCT REMOVAL

The Department is authorized to require BMPs for facilities per 40 CFR 122.44(k)(2). The facility should, to the extent practicable, remove large pieces of salt as soon as possible. After winter weather has ceased for the year, the facility needs to inspect all low-lying areas for extra salt and sand, and remove these as soon as possible. Salt applied to large areas has the potential to cause freshwater salinization which could result in a fish kill of sensitive species. To reduce potential for solids entering a stream, sand or other traction control materials will need to be evaluated against the probability that these materials could cause general criteria violations of solids and bottom deposits per 10 CSR 20-7.031(4).

LAND APPLICATION

Land application, which is surficial dispersion of wastewater or surficial spreading of sludge can be performed by facilities as an alternative to discharging. Authority to regulate these activities is pursuant to 644.026 RSMo. The Department implements requirements for these types of operations pursuant to 10 CSR 20-6.015(4)(A)1 which instructs the Department to develop permit conditions containing limitations, monitoring, reporting, and other requirements to protect soils, crops, surface waters, groundwater, public health, and the environment. Sub-surface dispersion or application of wastewater is typically considered a Class V UIC system; See UNDERGROUND INJECTION CONTROL section below.

- ✓ Not applicable; this permit does not authorize operation of a surficial land application system to disperse wastewater or sludge.

LAND DISTURBANCE

Land disturbance, sometimes called construction activities, are actions which cause disturbance of the root layer or soil; these include clearing, grading, and excavating of the land. 40 CFR 122.26(b)(14) and 10 CSR 20-6.200(3) requires permit coverage for these activities. Coverage is not required for facilities when only providing maintenance of original line and grade, hydraulic capacity, or to continue the original purpose of the facility.

- ✓ Not applicable; this permit does not provide coverage for land disturbance activities although the previous permit did; the facility is not disturbing the ground any more. The facility may obtain a separate land disturbance permit (MORA) online at <https://dnr.mo.gov/water/business-industry-other-entities/permits-certification-engineering-fees/stormwater/construction-land-disturbance>. MORA permits may not cover disturbance of contaminated soils, however, site specific permits such as this one can be modified to include appropriate controls for land disturbance of contaminated soils by adding site-specific BMP requirements and additional outfalls.

MAJOR WATER USER

Any surface or groundwater user with a water source and the equipment necessary to withdraw or divert 100,000 gallons (or 70 gallons per minute) or more per day combined from all sources from any stream, river, lake, well, spring, or other water source is considered a major water user in Missouri. <https://dnr.mo.gov/water/business-industry-other-entities/reporting/major-water-users> All major water users are required by 256.400 RSMo to register water use annually. <https://dnr.mo.gov/document-search/frequently-asked-major-water-user-questions-pub2236/pub2236>

- ✓ This facility is not a major water user.

MODIFICATION REQUESTS

Facilities have the option to request a permit modification from the Department at any time under RSMo 644.051.9. Requests must be submitted to the Water Protection Program with the appropriate forms and fees paid per 10 CSR 20-6.011. It is recommended facilities contact the program early so the correct forms and fees are submitted, and the modification request can be completed in a timely fashion. Minor modifications, found in 40 CFR 122.63, are processed without the need for a public comment period. Major modifications, those requests not explicitly fitting under 40 CFR 122.63, do require a public notice period. Modifications to permits must be completed when: a new pollutant is found in the discharge; operational or functional changes occur which affect the technology, function, or outcome of treatment; the facility desires alternate numeric benchmarks; or other changes are needed to the permit.

Modifications are not required when utilizing or changing additives in accordance with the publication <https://dnr.mo.gov/document-search/additive-usage-wastewater-treatment-facilities-pub2653/pub2653> nor are required when a temporary change or provisional discharge has been authorized by the regional office. While provisional discharges may be authorized by the regional office, they will not be granted for more than the time necessary for the facility to obtain an official modification from the Water Protection Program. Temporary provisional discharges due to weather events or other unforeseen circumstances may or may not necessitate a permit modification. The facility may ask for a Compliance Assistance Visit (CAV) from the regional office to assist in the decision-making process; CAVs are provided free to the permitted entity.

OPERATOR CERTIFICATION REQUIREMENTS

Operators or supervisors of operations at regulated domestic wastewater treatment facilities shall be certified in accordance with 10 CSR 20-9 and any other applicable state law or regulation.

- ✓ Not applicable; this facility is not owned or operated by a municipality, public sewer district, county, public water supply district, or private sewer company regulated by the Public Service Commission, or operated by a state or federal agency.

PERMIT SHIELD

The permit shield provision of the Clean Water Act (Section 402(k)) and Missouri Clean Water Law (644.051.16 RSMo) provides that when a permit holder is in compliance with its NPDES permit or MSOP, it is effectively in compliance with certain sections of the Clean Water Act, and equivalent sections of the Missouri Clean Water Law. In general, the permit shield is a legal defense against certain enforcement actions, but is only available when the facility is in compliance with its permit and satisfies other specific conditions, including having completely disclosed all discharges and all facility processes and activities to the Department at time of application. It is the facility's responsibility to ensure that all potential pollutants, waste streams, discharges, and activities, as well as wastewater land application, storage, and treatment areas, are all fully disclosed to the Department at the time of application or during the draft permit review process. Previous permit applications are not necessarily evaluated or considered during permit renewal actions. All relevant disclosures must be provided with each permit application, including renewal applications, even when the same information was previously disclosed in a past permit application. Subsequent requests for authorization to discharge additional pollutants, expanded or newly disclosed flows, or for authorization for previously unpermitted and undisclosed activities or discharges, will likely require an official permit modification, including another public participation process.

REASONABLE POTENTIAL (RP)

Regulations 10 CSR 20-7.015(9)(A)2 and 40 CFR 122.44(d)(1)(i) require effluent limitations for all pollutants which are (or may be) discharged at a level causing or have the reasonable potential to cause (or contribute to) an in-stream excursion above narrative or numeric water quality standards. Per 10 CSR 20-7.031(4), general criteria shall be applicable to all waters of the state at all times; however, acute toxicity criteria may be exceeded by permit allowance in zones of initial dilution, and chronic toxicity criteria may be exceeded by permit allowance in mixing zones. A reasonable potential analysis (RPA) is a numeric RP decision calculated using effluent data provided by the facility for parameters that have a numeric Water Quality Standard (WQS). If any given pollutant has the reasonable potential to cause or contribute to an in-stream excursion above the WQS, the permit must contain a WQBEL for the pollutant per 40 CFR Part 122.44(d)(1)(iii) and the most stringent limits per 10 CSR 20-7.031(9)(A). The RPA is performed using the *Technical Support Document for Water Quality Based Toxics Control (TSD)* methods (EPA/505/2-90-001) for continuous discharges. See additional considerations under Part II WATERBODY MIXING CONSIDERATIONS and Part III WASTELOAD ALLOCATIONS.

Wasteload allocations are determined utilizing the same equations and statistical methodology. Absent sufficient effluent data, WQBELs are derived without consideration of effluent variability and is assumed to be present unless found to be absent to meet the requirements of antidegradation review found in 10 CSR 20-7.031(3) and reporting of toxic substances pursuant to 40 CFR 122.44(f). The Department's permit writer's manual (<https://dnr.mo.gov/water/business-industry-other-entities/technical-assistance-guidance/wastewater-permit-writers-manual>), the EPA's permit writer's manual (<https://www.epa.gov/npdes/npdes-permit-writers-manual>), program policies, and best professional judgment guide each decision. Each parameter in each outfall is carefully considered; and all applicable information regarding: technology based effluent limitations, effluent limitation guidelines, water quality standards, inspection reports, stream water quality information, stream flows, uses assigned to each waterbody, and all applicable site specific information and data gathered by the facility through discharge monitoring reports and renewal (or new) application sampling.

Reasonable potential determinations (RPD) are based on physical conditions of the site as provided in Sections 3.1.2, 3.1.3, and 3.2 of the TSD using best professional judgement. An RPD consists of evaluating visual observations for compliance with narrative criteria, non-numeric information, or small amounts of numerical data (such as 1 data point supplied in the application). Narrative criteria with RP typically translate to a numeric WQS, so a parameter's establishment being based on narrative criteria does not necessarily make the decision an RPD vs RP—how the data is collected does, however. For example, a facility with orange discharge can have RP for narrative criteria like color, but a numeric iron limit is established to account for the violation of narrative criteria based on effluent data submitted by the facility. When insufficient data is received to make a determination on RP based on numeric effluent data, the RPD decisions are based on best professional judgment considering the type of effluent discharged, the current operational controls in place, and historical overall management of the site. In the case of iron causing excursions of narrative criteria for color, if a facility has not had iron monitoring in a previous permit, adding iron monitoring would be an RPD, since numeric data isn't being used in the determination, but observable, site-specific conditions are.

When the facility is performing surficial or subsurface land application, the volume of water, frequency of application, type of vegetation, soil type, land slopes, and general overall operating conditions are considered. 10 CSR 20-8 are regulations for the minimum operating conditions for land application; these regulations cannot be excused even if there is no RP. RP is reserved for discharging outfalls given that these outfalls are the only ones which water quality standards apply to, but the process is similar as the site conditions are compared to regulations, soil sampling, pollutant profile, and other site specific conditions. In the case of non-discharging outfalls, an RPD is instead used to determine monitoring requirements.

The TSD RPA method cannot be performed on stormwater as the flow is intermittent and highly variable. A stormwater RPD consists of reviewing application data and discharge monitoring data and comparing those data to narrative or numeric water quality criteria. For stormwater outfalls, considerations are required per 10 CSR 20-6.200(6)(B)2: A. application and other information supplied by the facility; B. effluent guidelines; C. best professional judgment; D. water quality; and E. BMPs.

RPDs are also performed for WET testing in wastewater. While no WET regulations specific to industrial wastewater exist, 40 CFR 122.21(j)(5) implies the following can be considered: 1) the variability of the pollutants; 2) the ratio of wastewater flow to receiving stream flow; and 3) current technology employed to remove toxic pollutants. Generally, sufficient data does not exist to mathematically determine RPA for WET, but instead compares the data for other toxic parameters in the wastewater with the necessity to implement WET testing with either monitoring or limits. When toxic parameters exhibit RP, WET testing is generally included in the permit as an RPD. However, if all toxic parameters are controlled via limitations or have exhibited no toxicity in the past, then WET testing may be waived. Only in instances where the wastewater is well characterized can WET testing be waived.

WET testing is typically not implemented for stormwater. Stormwater discharges do not adhere to the same principles of wastewater RPAs because stormwater discharges are not continuous, and at the time of precipitation discharge the receiving stream is also no longer at base (0) flow, meaning that using RP to develop WET testing requirements for stormwater is unrepresentative. The Department works with the Missouri Department of Conservation and has understanding of streams already exhibiting toxicity, even without the influence of industrial wastewater or stormwater. Facilities discharging to streams with historical toxicity are required to use laboratory water for dilution, instead of water from the receiving stream when performing WET tests.

TSD methods encountered may be § 3.3.2, § 5.7.3 for metals, and § 5.4.1 for chloride. Part IV EFFLUENT LIMIT DETERMINATIONS provides specific decisions related to this permit. In general, removal of a WQBEL if there is no RP is not considered backsliding, see ANTIBACKSLIDING for additional information.

✓ No statistical RPAs were performed for this permit. RPDs were utilized instead.

REGIONAL OFFICES (ROS)

Regional Offices will provide a compliance assistance visit at a facility's request; a regional map with links to phone numbers can be found here: <https://dnr.mo.gov/about-us/division-environmental-quality/regional-office>. Or use <https://dnr.mo.gov/compliance-assistance-enforcement> to request assistance from the Region online.

RENEWAL REQUIREMENTS

The renewal special condition permit requirement is designed to guide the facility to prepare and include all relevant and applicable information in accordance with 10 CSR 20-6.010(7)(A)-(C), and if applicable, federal regulations. The special condition may not include all requirements and requests for additional information may be made at the time of permit renewal under 644.051.13(5) RSMo and 40 CFR 122.21(h). Prior to submittal, the facility must review the entire submittal to confirm all required information and data is provided; it is the facility's responsibility to discern if additional information is required. Failure to fully disclose applicable information with the application or application addendums may result in a permit revocation per 10 CSR 20-6.010(8)(A) and may result in the forfeiture of permit shield protection authorized in 644.051.16 RSMo. Forms are located at: <https://dnr.mo.gov/water/business-industry-other-entities/permits-certification-engineering-fees/wastewater>

- ✓ This facility shall submit an appropriate and complete application to the Department no less than 180 days prior to the expiration date listed on page 1 of the permit.
- ✓ The facility may email cleanwaterpermits@dnr.mo.gov to submit the application to the Program. A paper copy is not necessary if submitted via email. For larger applications, a drop-box type service may also be used.
- ✓ Application materials shall include complete Form A, and Form C. If the form name has changed, then the facility should ensure they are submitting the correct forms as required by regulation.

SAMPLING FREQUENCY JUSTIFICATION

Sampling and reporting frequency changed to annually because the facility is inactive. Minimum sampling frequency for all parameters is annually per 40 CFR 122.44(i)(2).

Sampling frequency for stormwater-only outfalls is typically quarterly even though BMP inspection occurs monthly or more often dependent on site needs. The facility may sample more frequently if additional data is required to determine if best management operations and technology are performing as expected.

A reduction in monitoring frequency is not considered backsliding. A numeric or narrative limit established in the permit is applicable every hour of every day, not only during the day the monitoring occurs, therefore, a reduction in monitoring frequency has no bearing on the numeric limits applied in the permit. Both § 402(o)(1) and the safety clause in § 402(o)(3) prohibit renewed permits from containing effluent limitations that are less stringent. The Department does not read 402(o) to apply to any other non-limiting type of permit conditions.

- ✓ Reporting of precipitation was removed from the permit. The information is readily available online, therefore reporting this information is not required.

SAMPLING TYPE JUSTIFICATION

Sampling type was continued from the previous permit. The sampling types are representative of the discharges, and are protective of water quality.

SCHEDULE OF COMPLIANCE (SOC)

A schedule of compliance is time allowed to meet future more stringent limitations.

- ✓ Not applicable; this permit does not contain a SOC.

SPILLS, OVERFLOWS, AND OTHER UNAUTHORIZED DISCHARGE REPORTING

Per 260.505 RSMo, any emergency involving a hazardous substance must be reported to the Department's 24-hour Environmental Emergency Response hotline at (573) 634-2436 at the earliest possible moment after discovery. The Department may require the submittal of a written report detailing measures taken to clean up a spill. These reporting requirements apply whether or not the spill results in chemicals or materials leaving the permitted property or reaching waters of the state. This requirement is in addition to the noncompliance reporting requirement found in Standard Conditions Part I.

<https://revisor.mo.gov/main/OneSection.aspx?section=260.500&bid=13989&hl=>

Any other spills, overflows, or unauthorized discharges reaching waters of the state must be reported to the regional office during normal business hours, or after normal business hours, to the Department's 24-hour Environmental Emergency Response spill line at 573-634-2436.

Certain industrial facilities are subject to the self-implementing regulations for Oil Pollution Prevention in 40 CFR 112, and are required to initiate and follow Spill Prevention, Control, and Countermeasure (SPCC) Plans. This permit, as issued, is not intended to be a replacement for any SPCC plan, nor can this permit's conditions be automatically relaxed based on the SPCC plan if the permit is more stringent than the plan.

SLUDGE – INDUSTRIAL

Industrial sludge is solid, semi-solid, or liquid residue generated during the treatment of industrial process or non-process wastewater in a treatment works; including but not limited to, scum or solids removed in primary, secondary, or advanced wastewater treatment process; scum and solids filtered from water supplies and backwashed; and any material derived from industrial sludge. Industrial sludge could also be derived from holding structure dredging or other similar maintenance activities. Certain oil sludge, like those from oil water separators, are subject to self-implementing federal regulations under 40 CFR 279 for used oils.

- ✓ Not applicable; industrial sludge is not generated at this facility.

STANDARD CONDITIONS

The standard conditions Part I attached to this permit incorporate all sections of 10 CSR 20-6.010(8) and 40 CFR 122.41(a) through (n) by reference as required by law. These conditions, in addition to the conditions enumerated within the standard conditions must be reviewed by the facility to ascertain compliance with this permit, state regulations, state statutes, federal regulations, and the Clean Water Act.

STORMWATER PERMITTING: LIMITATIONS AND BENCHMARKS

Because of the fleeting nature of stormwater discharges, the Department, under the direction of EPA guidance, has determined monthly averages are capricious measures of stormwater-only discharges. The *Technical Support Document for Water Quality Based Toxics Control* (EPA/505/2-90-001; 1991) §3.1 indicates most procedures within the document apply only to water quality based approaches, not end-of-pipe technology-based controls. Hence, stormwater-only outfalls will generally only contain a maximum daily limit (MDL), a benchmark, or a monitoring requirement as dictated by site specific conditions, the BMPs in place, the BMPs proposed, past performance of the facility, and the receiving water's current quality.

Sufficient rainfall to cause a discharge for one hour or more from a facility would not necessarily cause significant flow in a receiving stream. Acute Water Quality Standards (WQSs) are based on one hour of exposure, and must be protected at all times. Therefore, industrial stormwater facilities with toxic contaminants present in the stormwater may have the potential to cause a violation of acute WQSs if toxic contaminants occur in sufficient amounts. In this instance, the permit may apply daily maximum limitations.

Conversely, it is unlikely for rainfall to cause a discharge for four continuous days from a facility; if this does occur however, the receiving stream will also likely sustain a significant amount of flow providing dilution. Most chronic WQSs are based on a four-day exposure with some exceptions. Under this scenario, most industrial stormwater facilities have limited potential to cause a violation of chronic water quality standards in the receiving stream.

A standard mass-balance equation cannot be calculated for stormwater because stormwater flow and flow in the receiving stream cannot be determined for conditions on any given day or storm event without real-time ad-hoc monitoring. The amount of stormwater discharged from the facility will vary based on current and previous rainfall, soil saturation, humidity, detention time, BMPs, surface permeability, etc. Flow in the receiving stream will vary based on climatic conditions, size of watershed, area of surfaces with reduced permeability (houses, parking lots, and the like) in the watershed, hydrogeology, topography, etc. Decreased permeability may increase the stream flow dramatically over a short period of time (flash).

Numeric benchmark values are based on site specific requirements taking in to account a number of factors but cannot be applied to any process water discharges. First, the technology in place at the site to control pollutant discharges in stormwater is evaluated. Other permits are also reviewed for similar activities. A review of the guidance forming the basis of Environmental Protection Agency's (EPA's) *Multi-Sector General Permit for Stormwater Discharges Associated with Industrial Activity* (MSGP) may also occur. Because precipitation events are sudden and momentary, benchmarks based on state or federal standards or recommendations use the Criteria Maximum Concentration (CMC) value, or acute standard may also be used. The CMC is the estimate of the highest concentration of a material in surface water to which an aquatic community can be exposed briefly without resulting in an unacceptable effect. The CMC for aquatic life is intended to be protective of the vast majority of the aquatic communities in the United States. If a facility has not disclosed BMPs applicable to the pollutants for the site, the facility may not be eligible for benchmarks.

40 CFR 122.44(b)(1) requires the permit implement the most stringent limitations for each discharge, including industrially exposed stormwater; and 40 CFR 122.44(d)(1)(i) and (iii) requires the permit to include water-quality based effluent limitations (WQBELs) where reasonable potential has been found. However, because of the non-continuous nature of stormwater discharges, staff are unable to perform statistical Reasonable Potential Analysis (RPA) under most stormwater discharge scenarios. Reasonable potential determinations (RPDs; see REASONABLE POTENTIAL above) using best professional judgment are performed.

Benchmarks require the facility to monitor, and if necessary, replace and update stormwater control measures. Benchmark concentrations are not effluent limitations. A benchmark exceedance, therefore, is not a permit violation; however, failure to take corrective action is a violation of the permit. Benchmark monitoring data is used to determine the overall effectiveness of control measures and to assist the facility in knowing when additional corrective actions may be necessary to comply with the conditions of the permit.

BMP inspections typically occur more frequently than sampling. Sampling frequencies are based on the facility's ability to comply with the benchmarks and the requirements of the permit. Inspections must occur after large rain events and any other time an issue is noted; sampling after a benchmark exceedance may need to occur to show the corrective action taken was meaningful.

When a permitted feature or outfall consists of only stormwater, a benchmark may be implemented if there is no RP for water quality excursions.

- ✓ Applicable, this facility has stormwater-only outfalls where benchmarks or limitations were deemed appropriate contaminant measures.

STORMWATER POLLUTION PREVENTION PLAN (SWPPP)

A SWPPP must be prepared by the facility if the SIC code or facility description type is found in 40 CFR 122.26(b)(14) and/or 10 CSR 20-6.200(2). A SWPPP may be required of other facilities where stormwater has been identified as necessitating better management. The purpose of a SWPPP is to comply with all applicable stormwater regulations by creating an adaptive management plan to control and mitigate stream pollution from stormwater runoff.

Pursuant to 40 CFR 122.44(k), Best Management Practices (BMPs) must be used to control or abate the discharge of pollutants when:

- 1) Authorized under §304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities;
- 2) Authorized under §402(p) of the CWA for the control of stormwater discharges;
- 3) Numeric effluent limitations are infeasible; or
- 4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA.

A BMP may take the form of a numeric benchmark. In accordance with the EPA's *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (EPA 833-B-09-002) published by the EPA in 2015 and again in 2021 https://www.epa.gov/sites/default/files/2021-03/documents/swppp_guide_industrial_2021_030121.pdf BMPs are measures or practices used to reduce the amount of pollution entering waters of the state from a permitted facility. BMPs may take the form of a process, activity, or physical structure. Additionally in accordance with the Stormwater Management, a SWPPP is a series of steps and activities to 1) identify sources of pollution or contamination, and 2) select and carry out actions which prevent or control

the pollution of storm water discharges. Additional information can be found in *Stormwater Management for Industrial Activities: Developing Pollution Prevention Plans and Best Management Practices* (EPA 832-R-92-006; September 1992).

Developing a SWPPP provides opportunities to employ appropriate BMPs to minimize the risk of pollutants being discharged during storm events. The following paragraph outlines the general steps the facility can take to determine which BMPs will work to achieve the benchmark values or limits in the permit. This section is not intended to be all encompassing or restrict the use of any physical BMP or operational and maintenance procedure assisting in pollution control. Additional steps or revisions to the SWPPP may be required to meet the requirements of the permit.

The facility can review the precipitation frequency maps for development of appropriate BMPs. The online map https://hdsc.nws.noaa.gov/hdsc/pfds/pfds_map_cont.html?bkmrk=mo can be targeted to the facility location and is useful when designing detention structures and planning for any structural BMP component. The stormwater map can also be used to determine if the volume of stormwater caused a disrupted BMP; and if the BMP must be re-designed to incorporate additional stormwater flows.

Areas which must be included in the SWPPP are identified in 40 CFR 122.26(b)(14). Once the potential sources of stormwater pollution have been identified, a plan shall be formulated to best control the amount of pollutant being released and discharged by each activity or source. This must include, but is not limited to, minimizing exposure to stormwater, good housekeeping measures, proper facility and equipment maintenance, spill prevention and response, vehicle traffic control, and proper materials handling. Once a plan has been developed the facility will employ the control measures determined to be adequate to achieve the benchmark values discussed above. The facility will conduct monitoring and inspections of the BMPs to ensure they are working properly and re-evaluate any BMP not achieving compliance with permitting requirements. For example, if sample results from an outfall show values of TSS above the benchmark value, the BMP being employed is deficient in controlling stormwater pollution. Corrective action must be taken to repair, improve, or replace the failing BMP. This internal evaluation is required at least once per month but may be continued more frequently if BMPs continue to fail. If failures do occur, continue this trial and error process until appropriate BMPs have been established.

For new, altered, or expanded stormwater discharges, the SWPPP shall identify reasonable and effective BMPs while accounting for environmental impacts of varying control methods. The antidegradation analysis must document why no discharge or no exposure options are not feasible. The selection and documentation of appropriate control measures shall serve as an alternative analysis of technology and fulfill the requirements of antidegradation [10 CSR 20-7.031(3)]. For further guidance, consult the antidegradation implementation procedure (<https://dnr.mo.gov/document-search/antidegradation-implementation-procedure>).

Alternative Analysis (AA) evaluation of the BMPs is a structured evaluation of BMPs which are reasonable and cost effective. The AA evaluation can include practices designed to be: 1) non-degrading; 2) less degrading; or 3) degrading water quality. The glossary of AIP defines these three terms. The chosen BMP will be the most reasonable and effective management strategy while ensuring the highest statutory and regulatory requirements are achieved and the highest quality water attainable for the facility is discharged. The AA evaluation must demonstrate why “no exposure” is not a feasible alternative at the facility. This structured analysis of BMPs serves as the antidegradation review, fulfilling the requirements of 10 CSR 20-7.031(3) Water Quality Standards and *Antidegradation Implementation Procedure* (AIP), §II.B.

If parameter-specific numeric benchmark exceedances continue to occur and the facility feels there are no practicable or cost-effective BMPs which will sufficiently reduce a pollutant concentration in the discharge to the benchmark values established in the permit, the facility can submit a request to re-evaluate the benchmark values. This request needs to include 1) a detailed explanation of why the facility is unable to comply with the permit conditions and unable to establish BMPs to achieve the benchmark values; 2) financial data of the company and documentation of cost associated with BMPs for review and 3) the SWPPP, which must contain adequate documentation of BMPs employed, failed BMPs, corrective actions, and all other required information. This will allow the Department to conduct a cost analysis on control measures and actions taken by the facility to determine cost-effectiveness of BMPs. The request shall be submitted in the form of an operating permit modification, which includes an appropriate fee; the application is found at: <https://dnr.mo.gov/water/business-industry-other-entities/permits-certification-engineering-fees/wastewater>

✓ Applicable; a SWPPP shall be developed and implemented for this facility; see specific requirements in the SPECIAL CONDITIONS section of the permit.

SUFFICIENTLY SENSITIVE ANALYTICAL METHODS

Please review Standard Conditions Part 1, §A, No. 4. The analytical and sampling methods used shall conform to the reference methods listed in 10 CSR 20-7.015 or 40 CFR 136 unless alternates are approved by the Department and incorporated within this permit. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. The facility shall ensure the selected methods are able to quantify the presence of pollutants in any given discharge at concentrations low enough to determine compliance with Water Quality Standards in 10 CSR 20-7.031 or effluent limitations unless provisions in the permit allow for other alternatives. The reporting limits established by the chosen laboratory must be below the lowest effluent limits established for the specified parameter (including any parameter’s future limit after an SOC) in the permit unless the permit provides for an ML or if the facility provides a written rationale to the Department. It is the facility’s responsibility to

ensure the laboratory has adequate equipment and controls in place to quantify the pollutant. Inflated reporting limits will not be accepted by the Department if the reporting limit is above the parameter value stipulated in the permit. A method is “sufficiently sensitive” when; 1) the method quantifies the pollutant below the level of the applicable water quality criterion or; 2) the method minimum level is above the applicable water quality criterion, but the amount of pollutant in a facility’s discharge is high enough the method detects and quantifies the level of pollutant in the discharge, or 3) the method has the lowest minimum level of the analytical methods approved under 10 CSR 20-7.015 and or 40 CFR 136. These methods are also required for parameters listed as monitoring only, as the data collected may be used to determine if numeric limitations need to be established. A facility is responsible for working with their contractors to ensure the analysis performed is sufficiently sensitive.

UNDERGROUND INJECTION CONTROL (UIC)

Class V wells are sub-surface dispersal or injection of any industrial wastewater; and in certain circumstances, may also be considered a Class V well if it is domestic wastewater. They can also be shallow injection wells like heat pumps and groundwater remediation wells. UIC systems may be described as having “septic tanks” or “lateral lines” in addition to the traditional well type of injection. The UIC program for all classes of wells in the State of Missouri is administered by the Missouri Department of Natural Resources and approved by EPA pursuant to §§1422 and 1425 of the Safe Drinking Water Act (SDWA) and 40 CFR 147 Subpart AA. Injection wells are classified based on the liquids which are being injected. Class I wells are hazardous waste wells which are banned by 577.155 RSMo; Class II wells are established for oil and natural gas production; Class III wells are used to inject fluids to extract minerals; Class IV wells are also banned by Missouri in 577.155 RSMo. In accordance with 40 CFR 144.82, construction, operation, maintenance, conversion, plugging, or closure of injection wells shall not cause movement of fluids containing any contaminant into Underground Sources of Drinking Water (USDW) if the presence of any contaminant may cause a violation of any drinking water standards or groundwater standards under 10 CSR 20-7.031, or other health based standards, or may otherwise adversely affect human health. If the director finds the injection activity may endanger USDWs, the Department may require closure of the injection wells, or other actions listed in 40 CFR 144.12(c), (d), or (e). In accordance with 40 CFR 144.26, the facility shall submit a Class V Well Inventory Form for each active or new underground injection well drilled, or when the status of a well changes, to the Missouri Department of Natural Resources, Geological Survey Program, P.O. Box 250, Rolla, Missouri 65402. The Class V Well Inventory Form can be requested from the Geological Survey Program or can be found at the following web address:

<https://dnr.mo.gov/document-search/class-v-well-inventory-form-mo-780-1774> Single family residential septic systems and non-residential septic systems used solely for sanitary waste and having the capacity to serve fewer than 20 persons a day are excluded from the UIC requirements (40 CFR 144.81(9)). The Department implements additional requirements for these types of operations pursuant to 10 CSR 20-6.015(4)(A)1 which instructs the Department to develop permit conditions containing limitations, monitoring, reporting, and other requirements to protect soils, crops, surface waters, groundwater, public health, and the environment.

- ✓ This facility has disclosed UIC is occurring but UIC is due to remediation activities and is covered under the Environmental Remediation Program instead.

WHOLE EFFLUENT TOXICITY (WET) TEST

A WET test is a quantifiable method to conclusively determine if discharges from the facility cause toxicity to aquatic life by itself, in combination with, or through synergistic responses, typically when mixed with receiving stream water. Under the CWA §101(a)(3), requiring WET testing is reasonably appropriate for Missouri State Operating Permits to quantify toxicity. WET testing is also required by 40 CFR 122.44(d)(1) when RP is found. WET testing ensures the provisions in 10 CSR 20-6 and Missouri’s Water Quality Standards in 10 CSR 20-7 are being met; the acute WQS for WET is 0.3 TUa. Under 10 CSR 20-6.010(8)(A)4, the Department may require other terms and conditions it deems necessary to ensure compliance with the CWA and related regulations of the Missouri Clean Water Commission. Missouri Clean Water Law (MCWL) RSMo 644.051.3 requires the Department to set permit conditions complying with the MCWL and CWA. 644.051.4 RSMo specifically references toxicity as an item the Department must consider in permits (along with water quality-based effluent limits); and RSMo 644.051.5 is the basic authority to require testing conditions. Requirements found in the federal application requirements for POTWs (40 CFR 122.21(j)(5)) do not apply to industrial facilities, therefore WET testing can be implemented on a case by case basis following the factors outlined below. Annual testing is the minimum testing frequency if reasonable potential is found; monitoring requirements promulgated in 40 CFR 122.44(i)(2) state “requirements to report monitoring results shall be established on a case-by-case basis with a frequency dependent on the nature and effect of the discharge, but in no case less than once per year.” To determine reasonable potential, factors considered are: 1) history of toxicity; 2) quantity and quality of substances (either limited or not) in the permit with aquatic life protections assigned; and 3) operational controls on toxic pollutants. Additionally, per 40 CFR 122.44(d)(1)(v), limits on whole effluent toxicity are not necessary where the permitting authority demonstrates in the fact sheet, using the procedures in 40 CFR 122.44(d)(1)(ii) of this section, that chemical-specific limits or specified operational controls are sufficient to attain and maintain applicable numeric and narrative water quality standards.

- ✓ Not applicable; WET testing was not implemented in this permit because there are no pollutants limited and identified as “toxic”, and there is no RP for WET.

PART IV. EFFLUENT LIMIT DETERMINATIONS**OUTFALLS #004 AND #018 – STORMWATER OUTFALLS**

PARAMETERS	UNIT	DAILY MAXIMUM LIMIT	BENCH- MARK	PREVIOUS PERMIT LIMITS	MINIMUM SAMPLING FREQUENCY	REPORTING FREQUENCY	SAMPLE TYPE
PHYSICAL							
FLOW	MGD	*	-	SAME	ONCE/YEAR	ANNUALLY	24 HR. ESTIMATE
CONVENTIONAL							
pH [†]	SU	6.5 TO 9.0	-	SAME	ONCE/YEAR	ANNUALLY	GRAB
TSS	mg/L	*	-	*	ONCE/YEAR	ANNUALLY	GRAB
NUTRIENTS							
AMMONIA AS N	mg/L	**	2.5	*	ONCE/YEAR	ANNUALLY	GRAB
NITRATE AS N	mg/L	**	23.2	*	ONCE/YEAR	ANNUALLY	GRAB
NITROGEN, TOTAL (TN)	mg/L	*	-	NEW	ONCE/YEAR	ANNUALLY	GRAB
OTHER							
2,4-DINITROTOLUENE	µg/L	*	-	SAME	ONCE/YEAR	ANNUALLY	GRAB
2,6-DINITROTOLUENE	µg/L	*	-	SAME	ONCE/YEAR	ANNUALLY	GRAB
PERCHLORATE	µg/L	**	9,300	*	ONCE/YEAR	ANNUALLY	GRAB

* monitoring and reporting requirement only

** monitoring with associated benchmark

† report the minimum and maximum pH values; pH is not to be averaged

new parameter not established in previous state operating permit

DERIVATION AND DISCUSSION OF LIMITS:**PHYSICAL:****Flow**

In accordance with 40 CFR Part 122.44(i)(1)(ii), the volume of effluent discharged from each outfall is needed to ensure compliance with permitted effluent limitations. If the facility is unable to obtain effluent flow, then it is the responsibility of the facility to inform the Department, which may require the submittal of an operating permit modification. The facility will report the total flow in millions of gallons per day (MGD). Quarterly monitoring from previous permit changed to annual monitoring. The facility reported from 0 to 10.657 MGD in the last five years for outfall #004, and from 0 to 19.006 MGD in the last five years for outfall #018.

Precipitation

Reporting removed. The Department no longer requires this information. This information is readily available online; the facility should continue to collect this information for the SWPPP to determine if BMPs are designed appropriately.

CONVENTIONAL:**pH**

6.5 to 9.0 SU – instantaneous grab sample; same as last permit. Water quality limits [10 CSR 20-7.031(5)(E)] are applicable to this outfall. pH is a fundamental water quality indicator. Additionally, ammonia availability in water is dependent on pH. Limitations in this permit will protect against aquatic organism toxicity, downstream water quality issues, human health hazard contact, and negative physical changes in accordance with the general criteria at 10 CSR 20-7.031(4) and the Clean Water Act's (CWA) goal of 100% fishable and swimmable rivers and streams.

Settleable Solids (SS)

Monitoring is removed. The Department has reviewed the data and the data are not concerning and do not provide the facility with information that is pertinent to stormwater management at the site. Removal of this parameter is not considered backsliding as there was no numeric limit in the last permit. Also, removal of monitoring is not backsliding because the parameter has no RP.

Total Suspended Solids (TSS)

Monitoring continued, but changed to annually. There is no numeric water quality standard for TSS; however, sediment discharges can negatively impact aquatic life habitat. TSS is also a valuable indicator parameter. TSS monitoring allows the facility to identify increases in TSS indicating uncontrolled materials leaving the site. Increased suspended solids in runoff can lead to decreased available oxygen for aquatic life and an increase of surface water temperatures in a receiving stream. Suspended solids can also be carriers of toxins, which can adsorb to the suspended particles; therefore, total suspended solids are a valuable indicator parameter for other pollution. The facility reported from 0 to 9.6 mg/L in the last 5 years.

NUTRIENTS:

Ammonia, Total as Nitrogen

Monitoring continued, but changed to annually. Monitoring with a daily maximum benchmark of 2.5 mg/L is included using best professional judgment under 10 CSR 20-6.200(6)(B)2.C. The benchmark is the Ecological Surface Water Screening Value for ammonia set forth in the facility's Missouri Hazardous Waste Management Facility Part I Permit No. MOD077887909. There is no RP for ammonia therefore a limit is not required; the facility does not discharge wastewater.

Nitrate as Nitrogen

As part of EMI's RCRA Part 1 Permit, groundwater monitoring of nitrates is required. Annual groundwater and surface water monitoring remains. Annual monitoring with a daily maximum benchmark of 23.2 mg/L is included using best professional judgment under 10 CSR 20-6.200(6)(B)2.C. The benchmark was derived based on the facility's data; 23.2 is the 95th percentile of the data collected after completion of remedial activities at the site in 2020. There is no RP for nitrate therefore a limit is not required; the facility does not discharge constantly or discharge wastewater. The facility reported from 0 to 25 mg/L during the last permit term. There is no RP because this is not a constant discharge. The benchmark is solely a technology assessment tool. The facility will need to review the site and determine if additional stormwater controls are necessary to meet the benchmark.

Nitrogen, Total (TN)

Because the facility is discharging ammonia and nitrate, TN is being added at this permit renewal. A single sample for TN may be obtained or the facility may use the formula in the permit note.

OTHER:

2,4-Dinitrotoluene

Monitoring requirement from previous state operating permit has been reassessed and verified it is still required to maintain protection of the receiving stream's water quality; 10 CSR 20-7.031 Table A: HHF = 9 µg/L chronic exposure; The facility reported between 0 and 0.097 µg/L for this parameter in the last 5 years. A benchmark is not being established for this parameter at this time. Monitoring changed to annually.

2,6-Dinitrotoluene

Monitoring requirement from previous state operating permit has been reassessed and verified it is still protective of the receiving stream's water quality. There are no water quality standards for this parameter. The facility reported between 0 and 0.16 µg/L for this parameter in the last 5 years. A benchmark is not being established for this parameter at this time. Monitoring changed to annually.

Perchlorate

Monitoring requirement from previous state operating permit has been reassessed; EPA's 2006 assessment guidance on perchlorate sets a drinking water equivalent level of 24.5 µg/L; (January 26, 2006 Memo: Assessment Guidance for Perchlorate http://www.epa.gov/fedfac/pdf/perchlorate_guidance.pdf). The facility reported between 0 and 29 µg/L for this parameter in the last 5 years. Annual monitoring with a daily maximum benchmark of 9,300 µg/L is included using best professional judgment under 10 CSR 20-6.200(6)(B)2.C. The benchmark is the Ecological Surface Water Screening Value for perchlorate set forth in the facility's Missouri Hazardous Waste Management Facility Part I Permit No. MOD077887909. There is no RP for perchlorate therefore a limit is not required; the facility does not discharge wastewater. The receiving stream does not have the drinking water use assigned.

PART V. ADMINISTRATIVE REQUIREMENTS

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

PERMIT SYNCHRONIZATION

Permits are normally issued on a five-year term, but to achieve watershed synchronization some permits will need to be issued for less than the full five years as allowed by regulation. The intent is all permits within a watershed will move through the Watershed Based Management (WBM) cycle together will all expire in the same fiscal year. This will allow the Department to explore a watershed based permitting effort at some point in the future.

- ✓ Industrial permits are not being synchronized.

PUBLIC NOTICE

The Department shall give public notice a draft permit has been prepared and its issuance is pending. Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in or with concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and facility must be notified of the denial in writing. <https://dnr.mo.gov/water/what-were-doing/public-notices> The Department must issue public notice of a draft operating permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.

For persons wishing to submit comments regarding this proposed operating permit, please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments. All comments must be in written form.

- ✓ This Public Notice period for operating permit started July 14, 2023, and ended August 14, 2023. No comments were received.

DATE OF FACT SHEET: AUGUST 18, 2023

COMPLETED BY:

PAM HACKLER, ENVIRONMENTAL SCIENTIST
MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM
OPERATING PERMITS SECTION - INDUSTRIAL UNIT
(573) 526-3386
pam.hackler@dnr.mo.gov



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

These Standard Conditions incorporate permit conditions as required by 40 CFR 122.41 or other applicable state statutes or regulations. These minimum conditions apply unless superseded by requirements specified in the permit.

Part I – General Conditions

Section A – Sampling, Monitoring, and Recording

1. **Sampling Requirements.**
 - a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
 - b. All samples shall be taken at the outfall(s) or Missouri Department of Natural Resources (Department) approved sampling location(s), and unless specified, before the effluent joins or is diluted by any other body of water or substance.
2. **Monitoring Requirements.**
 - a. Records of monitoring information shall include:
 - i. The date, exact place, and time of sampling or measurements;
 - ii. The individual(s) who performed the sampling or measurements;
 - iii. The date(s) analyses were performed;
 - iv. The individual(s) who performed the analyses;
 - v. The analytical techniques or methods used; and
 - vi. The results of such analyses.
 - b. If the permittee monitors any pollutant more frequently than required by the permit at the location specified in the permit using test procedures approved under 40 CFR Part 136, or another method required for an industry-specific waste stream under 40 CFR subchapters N or O, the results of such monitoring shall be included in the calculation and reported to the Department with the discharge monitoring report data (DMR) submitted to the Department pursuant to Section B, paragraph 7.
3. **Sample and Monitoring Calculations.** Calculations for all sample and monitoring results which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in the permit.
4. **Test Procedures.** The analytical and sampling methods used shall conform to the reference methods listed in 10 CSR 20-7.015 unless alternates are approved by the Department. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. The facility shall ensure that the selected methods are able to quantify the presence of pollutants in a given discharge at concentrations that are low enough to determine compliance with Water Quality Standards in 10 CSR 20-7.031 or effluent limitations unless provisions in the permit allow for other alternatives. A method is “sufficiently sensitive” when; 1) the method minimum level is at or below the level of the applicable water quality criterion for the pollutant or, 2) the method minimum level is above the applicable water quality criterion, but the amount of pollutant in a facility’s discharge is high enough that the method detects and quantifies the level of pollutant in the discharge, or 3) the method has the lowest minimum level of the analytical methods approved under 10 CSR 20-7.015. These methods are also required for parameters that are listed as monitoring only, as the data collected may be used to determine if limitations need to be established. A permittee is responsible for working with their contractors to ensure that the analysis performed is sufficiently sensitive.
5. **Record Retention.** Except for records of monitoring information required by the permit related to the permittee’s sewage sludge use and disposal activities, which shall be retained for a period of at least five (5) years (or longer as required by 40 CFR part 503), the permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the application for the permit, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.

6. **Illegal Activities.**
 - a. The Federal Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under the permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than two (2) years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than four (4) years, or both.
 - b. The Missouri Clean Water Law provides that any person or who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than six (6) months, or by both. Second and successive convictions for violation under this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.

Section B – Reporting Requirements

1. **Planned Changes.**
 - a. The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility when:
 - i. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b); or
 - ii. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in the permit, nor to notification requirements under 40 CFR 122.42;
 - iii. The alteration or addition results in a significant change in the permittee’s sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan;
 - iv. Any facility expansions, production increases, or process modifications which will result in a new or substantially different discharge or sludge characteristics must be reported to the Department 60 days before the facility or process modification begins. Notification may be accomplished by application for a new permit. If the discharge does not violate effluent limitations specified in the permit, the facility is to submit a notice to the Department of the changed discharge at least 30 days before such changes. The Department may require a construction permit and/or permit modification as a result of the proposed changes at the facility.
2. **Non-compliance Reporting.**
 - a. The permittee shall report any noncompliance which may endanger health or the environment. Relevant information shall be provided orally or via the current electronic method approved by the Department, within 24 hours from the time the permittee becomes aware of the circumstances, and shall be reported to the appropriate Regional Office during normal business hours or the Environmental Emergency Response hotline at 573-634-2436 outside of normal business hours. A written submission shall also be provided within five (5) business days of the time the permittee becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

- b. The following shall be included as information which must be reported within 24 hours under this paragraph.
 - i. Any unanticipated bypass which exceeds any effluent limitation in the permit.
 - ii. Any upset which exceeds any effluent limitation in the permit.
 - iii. Violation of a maximum daily discharge limitation for any of the pollutants listed by the Department in the permit required to be reported within 24 hours.
 - c. The Department may waive the written report on a case-by-case basis for reports under paragraph 2. b. of this section if the oral report has been received within 24 hours.
3. **Anticipated Noncompliance.** The permittee shall give advance notice to the Department of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements. The notice shall be submitted to the Department 60 days prior to such changes or activity.
 4. **Compliance Schedules.** Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of the permit shall be submitted no later than 14 days following each schedule date. The report shall provide an explanation for the instance of noncompliance and a proposed schedule or anticipated date, for achieving compliance with the compliance schedule requirement.
 5. **Other Noncompliance.** The permittee shall report all instances of noncompliance not reported under paragraphs 2, 3, and 6 of this section, at the time monitoring reports are submitted. The reports shall contain the information listed in paragraph 2. a. of this section.
 6. **Other Information.** Where the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Department, it shall promptly submit such facts or information.
 7. **Discharge Monitoring Reports.**
 - a. Monitoring results shall be reported at the intervals specified in the permit.
 - b. Monitoring results must be reported to the Department via the current method approved by the Department, unless the permittee has been granted a waiver from using the method. If the permittee has been granted a waiver, the permittee must use forms provided by the Department.
 - c. Monitoring results shall be reported to the Department no later than the 28th day of the month following the end of the reporting period.
- b. Notice.
 - i. Anticipated bypass. If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible at least 10 days before the date of the bypass.
 - ii. Unanticipated bypass. The permittee shall submit notice of an unanticipated bypass as required in Section B – Reporting Requirements, paragraph 5 (24-hour notice).
 - c. Prohibition of bypass.
 - i. Bypass is prohibited, and the Department may take enforcement action against a permittee for bypass, unless:
 1. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
 2. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and
 3. The permittee submitted notices as required under paragraph 2. b. of this section.
 - ii. The Department may approve an anticipated bypass, after considering its adverse effects, if the Department determines that it will meet the three (3) conditions listed above in paragraph 2. c. i. of this section.
3. **Upset Requirements.**
 - a. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of paragraph 3. b. of this section are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review.
 - b. Conditions necessary for a demonstration of upset. A permittee who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:
 - i. An upset occurred and that the permittee can identify the cause(s) of the upset;
 - ii. The permitted facility was at the time being properly operated; and
 - iii. The permittee submitted notice of the upset as required in Section B – Reporting Requirements, paragraph 2. b. ii. (24-hour notice).
 - iv. The permittee complied with any remedial measures required under Section D – Administrative Requirements, paragraph 4.
 - c. Burden of proof. In any enforcement proceeding, the permittee seeking to establish the occurrence of an upset has the burden of proof.

Section C – Bypass/Upset Requirements

1. **Definitions.**
 - a. *Bypass*: the intentional diversion of waste streams from any portion of a treatment facility, except in the case of blending.
 - b. *Severe Property Damage*: substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
 - c. *Upset*: an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
2. **Bypass Requirements.**
 - a. Bypass not exceeding limitations. The permittee may allow any bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of paragraphs 2. b. and 2. c. of this section.

Section D – Administrative Requirements

1. **Duty to Comply.** The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the Missouri Clean Water Law and Federal Clean Water Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application.
 - a. The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
 - b. The Federal Clean Water Act provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The Federal Clean Water Act provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the CWA, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions.

- c. Any person may be assessed an administrative penalty by the EPA Director for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000.
 - d. It is unlawful for any person to cause or permit any discharge of water contaminants from any water contaminant or point source located in Missouri in violation of sections 644.006 to 644.141 of the Missouri Clean Water Law, or any standard, rule or regulation promulgated by the commission. In the event the commission or the director determines that any provision of sections 644.006 to 644.141 of the Missouri Clean Water Law or standard, rules, limitations or regulations promulgated pursuant thereto, or permits issued by, or any final abatement order, other order, or determination made by the commission or the director, or any filing requirement pursuant to sections 644.006 to 644.141 of the Missouri Clean Water Law or any other provision which this state is required to enforce pursuant to any federal water pollution control act, is being, was, or is in imminent danger of being violated, the commission or director may cause to have instituted a civil action in any court of competent jurisdiction for the injunctive relief to prevent any such violation or further violation or for the assessment of a penalty not to exceed \$10,000 per day for each day, or part thereof, the violation occurred and continues to occur, or both, as the court deems proper. Any person who willfully or negligently commits any violation in this paragraph shall, upon conviction, be punished by a fine of not less than \$2,500 nor more than \$25,000 per day of violation, or by imprisonment for not more than one year, or both. Second and successive convictions for violation of the same provision of this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.
2. **Duty to Reapply.**
 - a. If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for and obtain a new permit.
 - b. A permittee with a currently effective site-specific permit shall submit an application for renewal at least 180 days before the expiration date of the existing permit, unless permission for a later date has been granted by the Department. (The Department shall not grant permission

for applications to be submitted later than the expiration date of the existing permit.)

- c. A permittee with currently effective general permit shall submit an application for renewal at least 30 days before the existing permit expires, unless the permittee has been notified by the Department that an earlier application must be made. The Department may grant permission for a later submission date. (The Department shall not grant permission for applications to be submitted later than the expiration date of the existing permit.)
3. **Need to Halt or Reduce Activity Not a Defense.** It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.
 4. **Duty to Mitigate.** The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment.
 5. **Proper Operation and Maintenance.** The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems which are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit.
 6. **Permit Actions.**
 - a. Subject to compliance with statutory requirements of the Law and Regulations and applicable Court Order, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to, the following:
 - i. Violations of any terms or conditions of this permit or the law;
 - ii. Having obtained this permit by misrepresentation or failure to disclose fully any relevant facts;
 - iii. A change in any circumstances or conditions that requires either a temporary or permanent reduction or elimination of the authorized discharge; or
 - iv. Any reason set forth in the Law or Regulations.
 - b. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition.
 7. **Permit Transfer.**
 - a. Subject to 10 CSR 20-6.010, an operating permit may be transferred upon submission to the Department of an application to transfer signed by the existing owner and the new owner, unless prohibited by the terms of the permit. Until such time the permit is officially transferred, the original permittee remains responsible for complying with the terms and conditions of the existing permit.
 - b. The Department may require modification or revocation and reissuance of the permit to change the name of the permittee and incorporate such other requirements as may be necessary under the Missouri Clean Water Law or the Federal Clean Water Act.
 - c. The Department, within 30 days of receipt of the application, shall notify the new permittee of its intent to revoke or reissue or transfer the permit.
 8. **Toxic Pollutants.** The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the Federal Clean Water Act within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
 9. **Property Rights.** This permit does not convey any property rights of any sort, or any exclusive privilege.



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

10. **Duty to Provide Information.** The permittee shall furnish to the Department, within a reasonable time, any information which the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit or to determine compliance with this permit. The permittee shall also furnish to the Department upon request, copies of records required to be kept by this permit.
11. **Inspection and Entry.** The permittee shall allow the Department, or an authorized representative (including an authorized contractor acting as a representative of the Department), upon presentation of credentials and other documents as may be required by law, to:
 - a. Enter upon the permittee's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of the permit;
 - b. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit;
 - c. Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this permit; and
 - d. Sample or monitor at reasonable times, for the purposes of assuring permit compliance or as otherwise authorized by the Federal Clean Water Act or Missouri Clean Water Law, any substances or parameters at any location.
12. **Closure of Treatment Facilities.**
 - a. Persons who cease operation or plan to cease operation of waste, wastewater, and sludge handling and treatment facilities shall close the facilities in accordance with a closure plan approved by the Department.
 - b. Operating Permits under 10 CSR 20-6.010 or under 10 CSR 20-6.015 are required until all waste, wastewater, and sludges have been disposed of in accordance with the closure plan approved by the Department and any disturbed areas have been properly stabilized. Disturbed areas will be considered stabilized when perennial vegetation, pavement, or structures using permanent materials cover all areas that have been disturbed. Vegetative cover, if used, shall be at least 70% plant density over 100% of the disturbed area.
13. **Signatory Requirement.**
 - a. All permit applications, reports required by the permit, or information requested by the Department shall be signed and certified. (See 40 CFR 122.22 and 10 CSR 20-6.010)
 - b. The Federal Clean Water Act provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or non-compliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six (6) months per violation, or by both.
 - c. The Missouri Clean Water Law provides that any person who knowingly makes any false statement, representation or certification in any application, record, report, plan, or other document filed or required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than ten thousand dollars, or by imprisonment for not more than six months, or by both.
14. **Severability.** The provisions of the permit are severable, and if any provision of the permit, or the application of any provision of the permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of the permit, shall not be affected thereby.

Missouri State Operating Permit Renewal Application

Expert Management, Inc.
EPA ID# MOD077887909
MSOP# MO-0002453
Carthage, Missouri

June 2022



Prepared for: Expert Management Inc.
3078 County Road 180
Carthage, MO 64836

Prepared by: Element Environmental Solutions, Inc.
PO Box 921
Adamstown, PA 19501

CONTENTS

1.0 INTRODUCTION 1-1

1.1 Facility Ownership and Status 1-1

1.2 Former Operations 1-1

1.3 Current Operations 1-1

1.4 General Facility Property Description 1-2

2.0 OUTFALLS 2-1

2.1 Outfall 004 Description 2-1

2.2 Outfall 018 Description 2-1

3.0 PERMIT 3-1

4.0 REFERENCES 4-1

Appendix A - Missouri Form A

Appendix B - Missouri Form C

1.0 INTRODUCTION

This application is being submitted to renew the current Missouri State Operating Permit (MSOP) MO-0002453. The following is a brief history of the facility and overview of the outfalls related to stormwater discharges at the facility.

1.1 Facility Ownership and Status

Expert Management Inc. (EMI), a Delaware Corporation, is the owner of the 583-acre facility. The facility is located at 3078 County Road 180, Carthage, Jasper County, Missouri (Facility). The Facility was previously owned by ICI Explosives USA, Inc. and Atlas Powder Company. The Facility has a current MSOP MO-0002453 that will expire December 31, 2022. This application is being submitted by EMI for renewal of its current permit. EMI proposed no changes to the existing MSOP, MO-0002453 conditions. EMI is a former industrial facility undergoing post closure care, monitoring, and corrective action under the Resource Conservation and Recovery Act (RCRA). EMI's EIN is 22-3830075.

1.2 Former Operations

The Facility was formerly used for the manufacturing of explosives. Production activities ceased at the Facility by early 2002 and all manufacturing operations have fully decommissioned and demolished.

1.3 Current Operations


EMI is conducting post-closure care, monitoring, and corrective action activities pursuant to a Hazardous Waste Management Facility Permit (EPA ID Number: MOD0077887909) issued by the Missouri Department of Natural Resources (MDNR) Hazardous Waste Program for the Facility.

Industrial wastewater discharges at the Facility has been discontinued. The only remaining discharges at the Facility are a result of stormwater runoff or spring seepage. The Facility is not a major facility. This MSOP Renewal Application requests the current permit conditions and monitoring requirements be maintained in the renewed permit.

1.4 General Facility Property Description

The Facility property location and boundaries are shown on **Figure 1**. The Facility property topography, structures, drainage features, and outfalls are presented on **Figure 2**.

The topography of the Facility land ranges from gently to moderately sloping uplands with moderately to steeply sloping and narrow drainage valleys leading to the relatively flat floodplain of Grove Creek (see **Figure 2**).

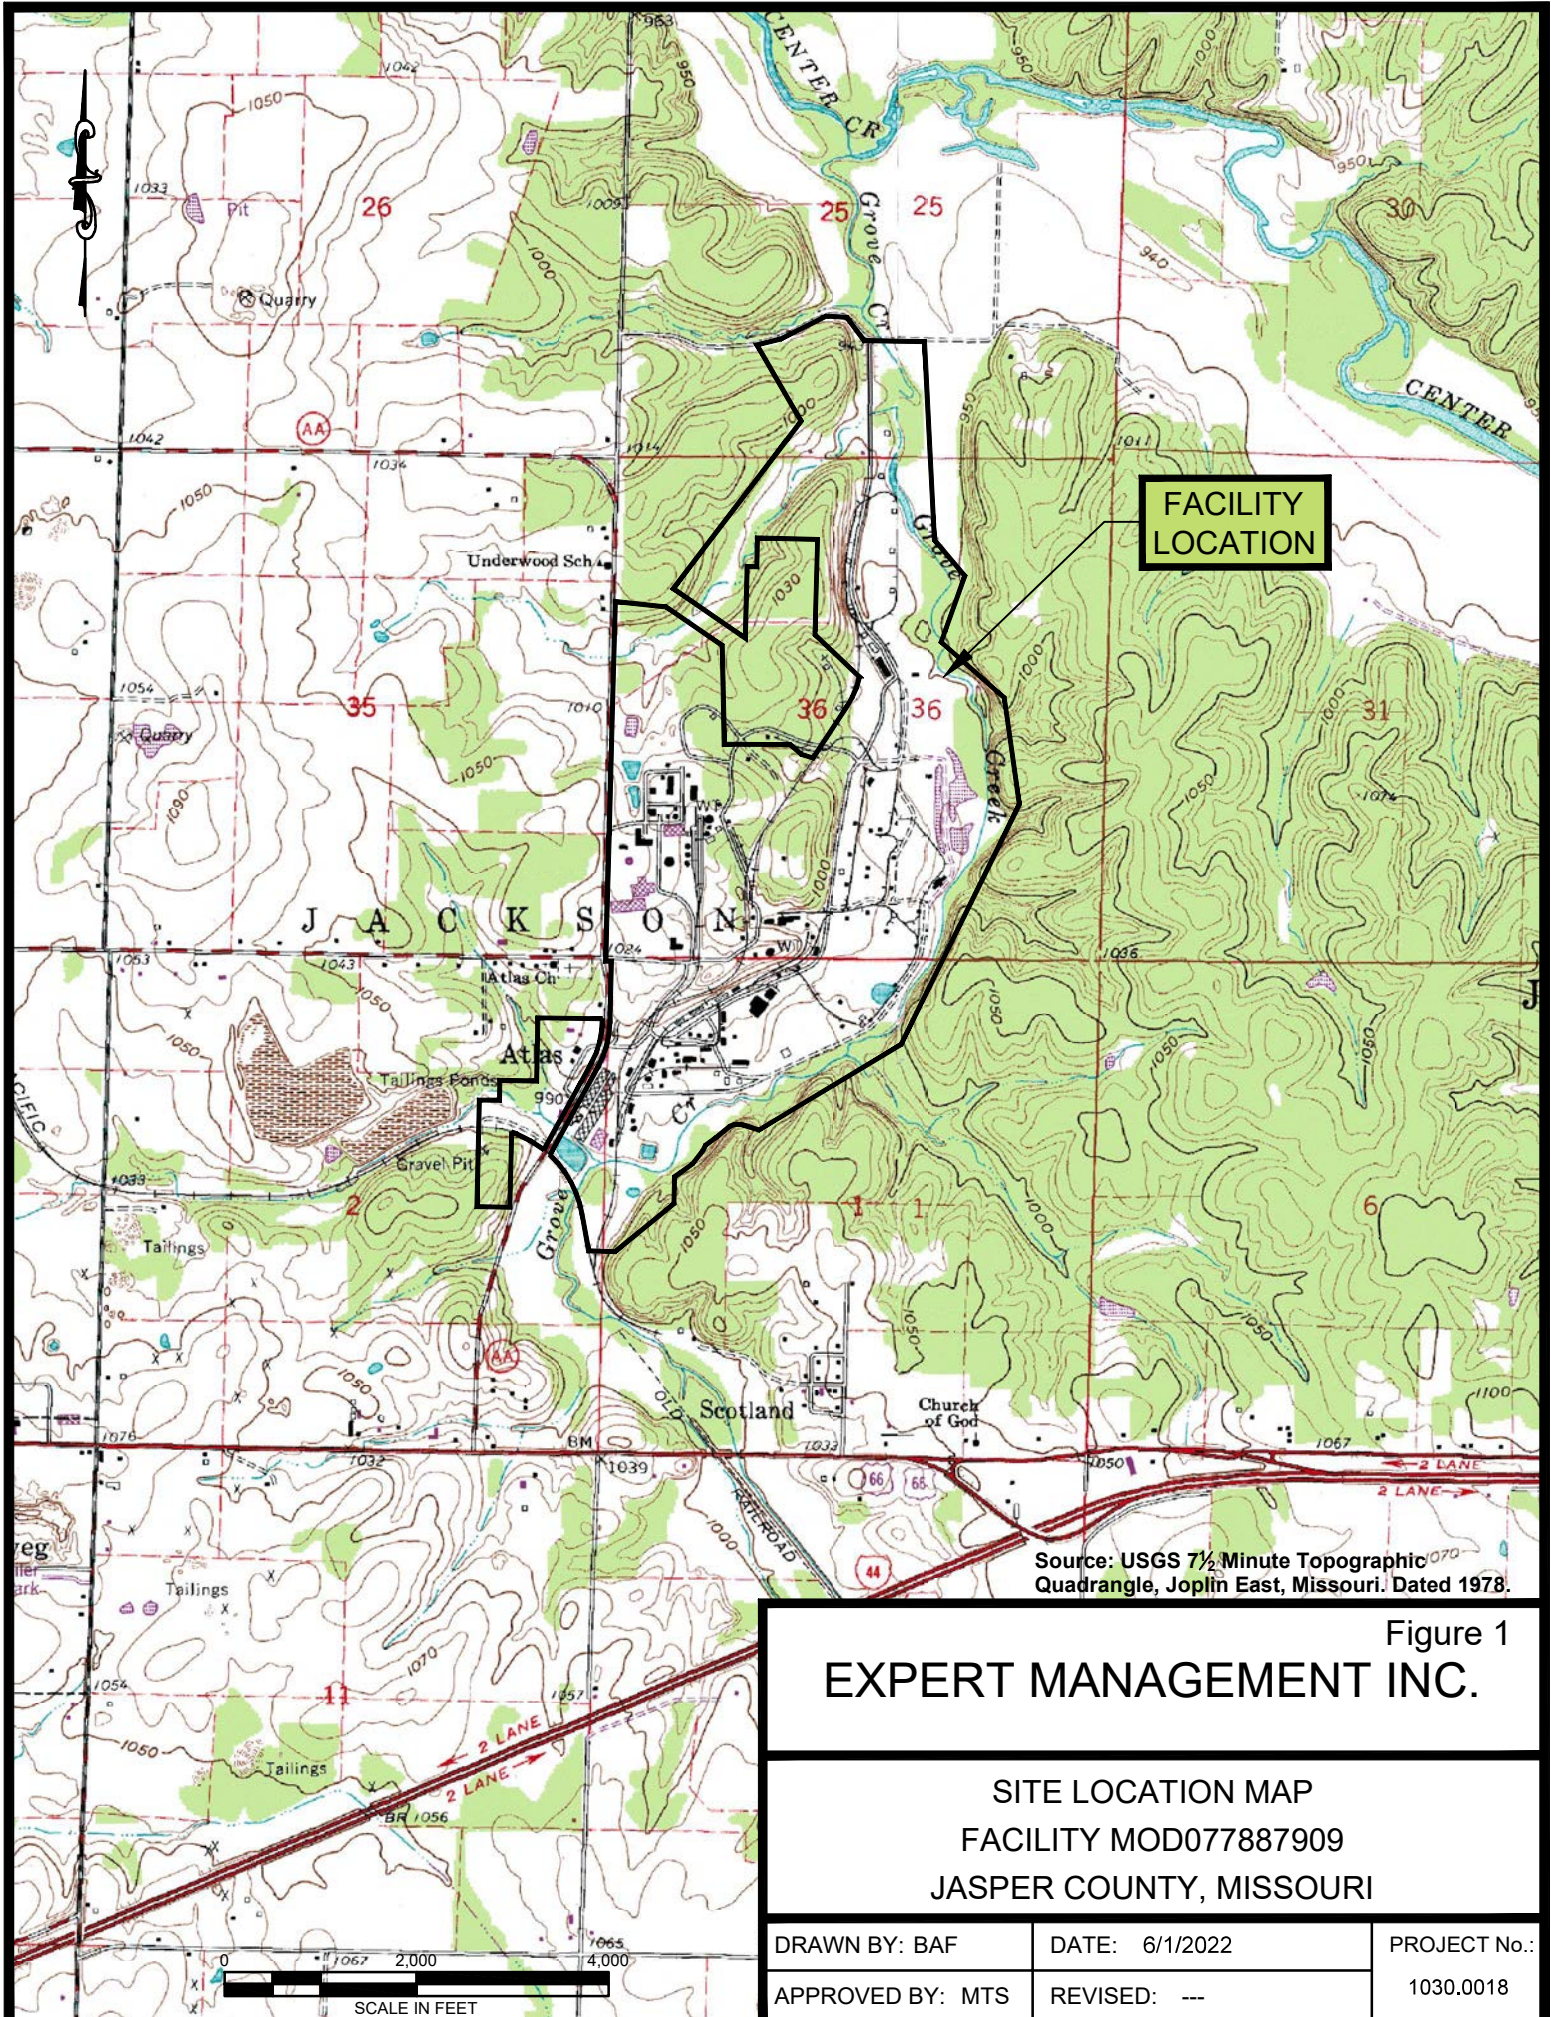

Source: USGS 7½ Minute Topographic Quadrangle, Joplin East, Missouri. Dated 1978.

Figure 1
EXPERT MANAGEMENT INC.

SITE LOCATION MAP
FACILITY MOD077887909
JASPER COUNTY, MISSOURI

DRAWN BY: BAF


DATE: 6/1/2022

PROJECT No.:

APPROVED BY: MTS

REVISED: ---

1030.0018

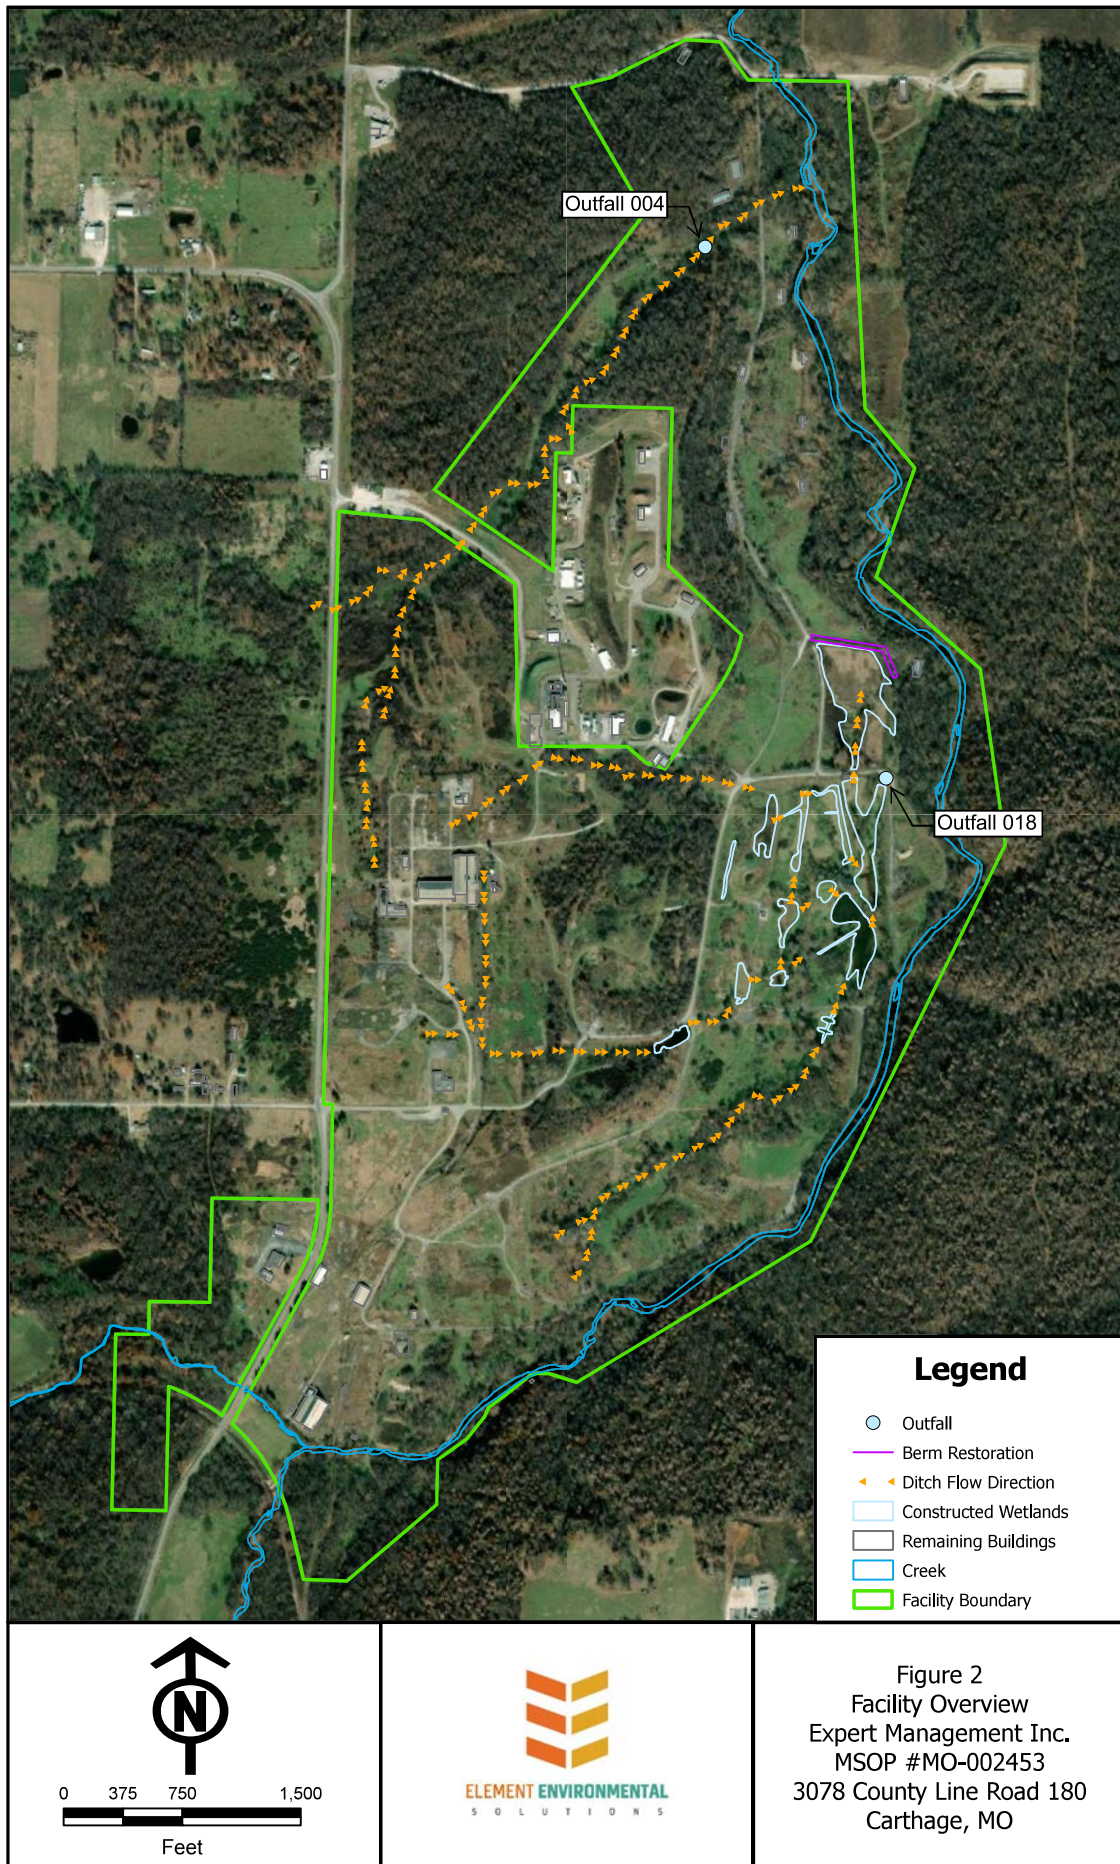

2.0 OUTFALLS

The following outfalls are to be retained for the Facility:

- Outfall 004: Stormwater runoff from areas with Solid Waste Management Units (SWMU).
- Outfall 018: “Overflow” stormwater runoff from the Facility constructed wetlands.

Outfall 018 does not discharge under normal weather conditions. Both outfalls have monitoring limits only.

2.1 Outfall 004 Description

Outfall 004 collects stormwater from an approximately 246-acre portion of the Facility that previously housed production facilities. This area has been the subject of several corrective actions. Some stormwater runoff from the Northwest portion of the adjacent EBV Explosives Environmental Company dba General Dynamics Ordnance and Tactical System (“GD-OTS”) facility drains both toward this Outfall and into the EMI constructed wetlands. Outfall 004 discharges to an Unnamed Tributary to Grove Creek, an unclassified stream, before flowing to Grove Creek approximately 1,500-feet downstream. This area is shown on Figure 2.

2.2 Outfall 018 Description

Outfall 018 is designed to receive overflow from an approximately 231-acre portion of the Facility. The flow is directed toward Grove Creek through a series of ditches, uplands, and wetlands. Outfall 018 discharges to a Tributary of Grove Creek, an unclassified stream, before flowing to Grove Creek approximately 1,600-feet downstream. These areas are shown on Figure 2.

Some stormwater runoff from the southern portion of the adjacent GD-OTS facility drains through the constructed wetlands toward this Outfall. EMI proposes to retain this outfall as in the current permit.

3.0 PERMIT

EMI proposes no changes to the existing MSOP Permit.

EMI proposes Outfalls 004 and 018 continue to be treated as stormwater runoff outfalls and the sampling frequency and current monitoring conditions be maintained.

4.0 REFERENCES

MDNR, 2018. Missouri State Operating Permit, Permit Number MO-0002453. Missouri Department of Natural Resources. February 2018.

Appendix A

Missouri Form A



MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM
**FORM A – APPLICATION FOR NONDOMESTIC PERMIT UNDER MISSOURI
CLEAN WATER LAW**

FOR AGENCY USE ONLY

CHECK NUMBER

DATE RECEIVED

FEE SUBMITTED

JET PAY CONFIRMATION NUMBER

**PLEASE READ ALL THE ACCOMPANYING INSTRUCTIONS BEFORE COMPLETING THIS FORM.
SUBMITTAL OF AN INCOMPLETE APPLICATION MAY RESULT IN THE APPLICATION BEING RETURNED.**

IF YOUR FACILITY IS ELIGIBLE FOR A NO EXPOSURE EXEMPTION:

Fill out the No Exposure Certification Form (Mo 780-2828): <https://dnr.mo.gov/forms/780-2828-f.pdf>

1. REASON FOR APPLICATION:

- ☒ a. This facility is now in operation under Missouri State Operating Permit (permit) MO – 002453, is submitting an application for renewal, and there is no proposed increase in design wastewater flow. Annual fees will be paid when invoiced and there is no additional permit fee required for renewal.
- ☐ b. This facility is now in operation under permit MO – _____, is submitting an application for renewal, and there is a proposed increase in design wastewater flow. Antidegradation Review may be required. Annual fees will be paid when invoiced and there is no additional permit fee required for renewal.
- ☐ c. This is a facility submitting an application for a new permit (for a new facility). Antidegradation Review may be required. New permit fee is required.
- ☐ d. This facility is now in operation under Missouri State Operating Permit (permit) MO – _____ and is requesting a modification to the permit. Antidegradation Review may be required. Modification fee is required.

2. FACILITY

NAME Expert Management Inc.		TELEPHONE NUMBER WITH AREA CODE (417) 624-8891	
ADDRESS (PHYSICAL) 3078 County Road 180	CITY Carthage	STATE MO	ZIP CODE 64836

3. OWNER

NAME Expert Management Inc (c/o Akzo Nobel Inc). Attn: Peter Drucker		TELEPHONE NUMBER WITH AREA CODE (629) 208-2383	
EMAIL ADDRESS peter.drucker@akzonobel.com			
ADDRESS (MAILING) 525 Marriot Drive, Suite 500	CITY Nashville	STATE TN	ZIP CODE 37214

4. CONTINUING AUTHORITY

NAME Same as 3.0 above		TELEPHONE NUMBER WITH AREA CODE	
EMAIL ADDRESS			
ADDRESS (MAILING)	CITY	STATE	ZIP CODE

5. OPERATOR CERTIFICATION

NAME Not Applicable	CERTIFICATE NUMBER	TELEPHONE NUMBER WITH AREA CODE	
ADDRESS (MAILING)	CITY	STATE	ZIP CODE

6. FACILITY CONTACT

NAME Expert Management Inc. (c/o Akzo Nobel Inc.)Att: Frank Lagrotta	TITLE Project Manager	TELEPHONE NUMBER WITH AREA CODE (416) 665-5084	
E-MAIL ADDRESS frank.lagrotta@akzonobel.com			

7. DOWNSTREAM LANDOWNER(S) Attach additional sheets as necessary.

NAME East Joplin Development			
ADDRESS 2601 Callaway Ridge	CITY Joplin	STATE MO	ZIP CODE 64804

8.1 Legal Description of Outfalls. (Attach additional sheets if necessary.)
 For Universal Transverse Mercator (UTM), use Zone 15 North referenced to North American Datum 1983 (NAD83)

001	<u>SE</u> ¼	<u>SW</u> ¼	Sec <u>25</u>	T <u>28N</u>	R <u>32W</u>	<u>Jasp</u> County
UTM Coordinates Easting (X): <u>377679</u>			Northing (Y): <u>4108254</u>			
002	<u>NW</u> ¼	<u>SE</u> ¼	Sec <u>36</u>	T <u>28N</u>	R <u>32W</u>	<u>Jasp</u> County
UTM Coordinates Easting (X): <u>377679</u>			Northing (Y): <u>4017175</u>			
003	<u> </u> ¼	<u> </u> ¼	Sec <u> </u>	T <u> </u>	R <u> </u>	<u> </u> County
UTM Coordinates Easting (X): <u> </u>			Northing (Y): <u> </u>			
004	<u> </u> ¼	<u> </u> ¼	Sec <u> </u>	T <u> </u>	R <u> </u>	<u> </u> County
UTM Coordinates Easting (X): <u> </u>			Northing (Y): <u> </u>			

Include all subsurface discharges and underground injection systems for permit consideration.

8.2 Primary Standard Industrial Classification (SIC) and Facility North American Industrial Classification System (NAICS) Codes.

Primary SIC <u>2892</u>	and NAICS _____	SIC <u>2892</u>	and NAICS _____
SIC _____	and NAICS _____	SIC _____	and NAICS _____

A. Is this permit for a manufacturing, commercial, mining, solid/hazardous waste, or silviculture facility? YES ☒ NO ☐
If yes, complete Form C.

B. Is the facility considered a "Primary Industry" under EPA guidelines (40 CFR Part 122, Appendix A) : YES ☐ NO ☒
If yes, complete Forms C and D.

C. Is wastewater land applied? YES ☐ NO ☒
If yes, complete Form I.

D. Are sludge, biosolids, ash, or residuals generated, treated, stored, or land applied? YES ☐ NO ☒
If yes, complete Form R.

E. Have you received or applied for any permit or construction approval under the CWA or any other environmental regulatory authority? YES ☒ NO ☐
If yes, please include a list of all permits or approvals for this facility:
Environmental Permits for this facility: Hazardous Waste Management Facility Permit MOD0077887909

F. Do you use cooling water in your operations at this facility? YES ☐ NO ☒
If yes, please indicate the source of the water: _____

G. Attach a map showing all outfalls and the receiving stream at 1" = 2,000' scale.

Per 40 CFR Part 127 National Pollutant Discharge Elimination System (NPDES) Electronic Reporting Rule, reporting of effluent limits and monitoring shall be submitted by the permittee via an electronic system to ensure timely, complete, accurate, and nationally consistent set of data. **One of the following must be checked in order for this application to be considered complete.** Please visit <https://dnr.mo.gov/env/wpp/edmr.htm> for information on the Department's eDMR system and how to register.

☐ - I will register an account online to participate in the Department's eDMR system through the Missouri Gateway for Environmental Management (MoGEM) before any reporting is due, in compliance with the Electronic Reporting Rule.

☒ - I have already registered an account online to participate in the Department's eDMR system through MoGEM.

☐ - I have submitted a written request for a waiver from electronic reporting. See instructions for further information regarding waivers.

☐ - The permit I am applying for does not require the submission of discharge monitoring reports.

11. FEES

Permit fees may be paid by attaching a check, or online by credit card or eCheck through the JetPay system. Use the URL provided to access JetPay and make an online payment:

For new permits: <https://magic.collectorsolutions.com/magic-ui/payments/mo-natural-resources/591>

For modifications: <https://magic.collectorsolutions.com/magic-ui/payments/mo-natural-resources/596>

12. CERTIFICATION

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

NAME AND OFFICIAL TITLE (TYPE OR PRINT)

Peter Drucker - VP, General Counsel/ Secretary

TELEPHONE NUMBER WITH AREA CODE

(629) 208-2383

SIGNATURE

Drucker, A.

Digitally signed by Drucker, A. (Peter)
DN: cn=Drucker, A. (Peter),
ou=Users
Reason: I am approving this
document
Date: 2022.06.27 08:10:58 -05'00'

DATE SIGNED


June 27, 2022

MO 780-1479 (04-21)

(Peter)

Appendix B

Missouri Form C and Supplement



MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM, WATER POLLUTION CONTROL BRANCH
**FORM C – APPLICATION FOR DISCHARGE PERMIT – MANUFACTURING, COMMERCIAL,
MINING, SILVICULTURE OPERATIONS, AND STORMWATER**

GENERAL INFORMATION (PLEASE SEE INSTRUCTIONS)

1.0 NAME OF FACILITY

Expert Management Inc.

1.1 THIS FACILITY IS OPERATING UNDER MISSOURI STATE OPERATING PERMIT (MSOP) NUMBER:

MO-0002453

1.2 IS THIS A NEW FACILITY? PROVIDE CONSTRUCTION PERMIT (CP) NUMBER IF APPLICABLE.

No

1.3 Describe the nature of the business, in detail. Identify the goods and services provided by the business. Include descriptions of all raw, intermediate, final products, byproducts, or waste products used in the production or manufacturing process, stored outdoors, loaded or transferred and any other pertinent information for potential sources of wastewater or stormwater discharges.

Facility is no longer operational. Flow only occurs at outfalls following heavy precipitation events. All discharge is stormwater, no current site activities contribute to discharge.

FLOWS, TYPE, AND FREQUENCY

2.0 Attach a line drawing showing the water flow through the facility. Indicate sources of intake water, operations contributing wastewater to the effluent, and treatment units labeled to correspond to the more detailed descriptions in item B. Construct a water balance on the line drawing by showing average and maximum flows between intakes, operations, treatment units, evaporation, public sewers, and outfalls. If a water balance cannot be determined (e.g., for certain mining activities), provide a pictorial description of the nature and amount of any sources of water and any collection or treatment measures.

2.1 For each outfall (1) below, provide: (2) a description of all operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water, stormwater runoff, and any other process or non-process wastewater, (3) the average flow and maximum flow (put max in parentheses) contributed by each operation and the sum of those operations, (4) the treatment received by the wastewater, and (5) the treatment type code. Continue on additional sheets if necessary.

1. OUTFALL NO.	2. OPERATION(S) CONTRIBUTING FLOW; INCLUDE ALL PROCESSES AND SUB PROCESSES AT EACH OUTFALL	3. AVERAGE FLOW AND (MAXIMUM FLOW), INCLUDE UNITS.	4. TREATMENT DESCRIPTION	5. TREATMENT CODES FROM TABLE A
004	Stormwater runoff	0.905(2.720)Mgal/d	Discharge to surface water	4-A
018	Stormwater runoff	1.325(2.534) Mgal/d	Discharge to surface water	4-A

Attach additional pages if necessary.

2.2 INTERMITTENT DISCHARGES

Except for stormwater runoff, leaks, or spills, are any of the discharges described in items 2.0 or 2.1 intermittent or seasonal?

☐ Yes (complete the following table)

☒ No (go to section 2.3)

1. OUTFALL NUMBER	2. OPERATION(S) CONTRIBUTING FLOW	3. FREQUENCY		4. FLOW				C. DURATION (in days)
				A. FLOW RATE (in mgd)		B. TOTAL VOLUME (specify with units)		
		A. DAYS PER WEEK (specify average)	B. MONTHS PER YEAR (specify average)	1. MAXIMUM DAILY	2. LONG TERM AVERAGE	4. LONG TERM DAILY	3. MAXIMUM AVERAGE	

2.3 PRODUCTION

A. Does an effluent limitation guideline (ELG) promulgated by EPA under section 304 of the Clean Water Act apply to your facility? Indicate the part and subparts applicable.

☐ Yes 40 CFR _____ Subpart(s) _____ ☒ No (go to section 2.5)

B. Are the limitations in the effluent guideline(s) expressed in terms of production (or other measure of operation)? Describe in C below.

☐ Yes (complete C.) ☐ No (go to section 2.5)

C. If you answered "yes" to B, list the quantity representing an actual measurement of your maximum level of production, expressed in the terms and units used in the applicable effluent guideline and indicate the affected outfalls.

A. OUTFALL(S)	B. QUANTITY PER DAY	C. UNITS OF MEASURE	D. OPERATION, PRODUCT, MATERIAL, ETC. (specify)

2.4 IMPROVEMENTS

A. Are you required by any federal, state, or local authority to meet any implementation schedule for the construction, upgrading, or operation of wastewater treatment equipment or practices or any other environmental programs which may affect the discharges described in this application? This includes, but is not limited to, permit conditions, administrative or enforcement orders, enforcement compliance schedule letters, stipulations, court orders, and grant or loan conditions.

☒ Yes (complete the following table) ☐ No (go to 2.6)

1. IDENTIFICATION OF CONDITION, AGREEMENT, ETC.	2. AFFECTED OUTFALLS	3. BRIEF DESCRIPTION OF PROJECT	4. FINAL COMPLIANCE DATE	
			A. REQUIRED	B. PROJECTED
RCRA Corrective Action	004/018	Groundwater corrective action		

B. Optional: provide below or attach additional sheets describing water pollution control programs or other environmental projects which may affect discharges. Indicate whether each program is underway or planned, and indicate actual or planned schedules for construction. This may include proposed bmp projects for stormwater.

Permit MOD077887909, RCRA corrective action permit for groundwater at the facility.

2.5 SLUDGE MANAGEMENT

Describe the removal of any industrial or domestic biosolids or sludges generated at your facility. Include names and contact information for any haulers used. Note the frequency, volume, and methods (incineration, landfilling, composting, etc) used. See Form A for additional forms which may need to be completed.

Not applicable.

DATA COLLECTION AND REPORTING REQUIREMENTS FOR APPLICANTS

3.0 EFFLUENT (AND INTAKE) CHARACTERISTICS (SEE INSTRUCTIONS)

A. & B. See instructions before continuing – complete one Table 1 for **each outfall** (and intake) – annotate the outfall (intake) number or designation in the space provided. The facility is not required to complete intake data unless required by the department or rule.

C. Use the space below to list any pollutants listed in the instructions section 3.0 C. Table B which you know or have reason to believe is discharged or may be discharged from any outfall not listed in parts 3.0 A or B on Table 1. For every pollutant listed, briefly describe the reasons you believe it to be present and report any analytical data in your possession.

1. POLLUTANT	2. SOURCE	3. OUTFALL(S)	4. ANALYTICAL RESULTS (INCLUDE UNITS)
2,4-dinitrotoluene 121-14-2	Historic facility operations	004	0.11 ug/L
2,6-dinitrotoluene 606-20-2	Historic facility operations	004	0.096 ug/L
Perchlorate 14797-73-0	Historic facility operations	004	2.0 ug/L
2,4-dinitrotoluene 121-14-2	Historic facility operations	018	<0.097 ug/L
2,6-dinitrotoluene 606-20-2	Historic facility operations	018	<0.019 ug/L
Perchlorate 14797-73-0	Historic facility operations	018	2.1 ug/L

3.1 Whole Effluent Toxicity Testing

A. To your knowledge, have any Whole Effluent Toxicity (WET) tests been performed on the facility discharges (or on receiving waters in relation to your discharge) within the last three years?

☐ Yes (go to 3.1 B)

☒ No (go to 3.2)

3.1 B

Disclose wet testing conditions, including test duration (chronic or acute), the organisms tested, and the testing results. Provide any results of toxicity identification evaluations (TIE) or toxicity reduction evaluations (TRE) if applicable. Please indicate the conclusions of the test(s) including any pollutants identified as causing toxicity and steps the facility is taking to remedy the toxicity.

3.2 CONTRACT ANALYSIS INFORMATION

Were any of the analyses reported herein, above, or on Table 1 performed by a contract laboratory or consulting firm?

☒ Yes (list the name, address, telephone number, and pollutants analyzed by each laboratory or firm.) ☐ No (go to 4.0)

A. LAB NAME	B. ADDRESS	C. TELEPHONE (area code and number)	D. POLLUTANTS ANALYZED (list or group)
Eurofins Seattle	5755 8th Street East, Tacoma, WA 98424	(253)-922-2310	Settleable Solids
Eurofins Denver	4955 Yarrow Street, Arvada, CO 80002	(303)-736-0100	Perchlorate, 2,4-dinitrotoluene, 2,6-dinitrotoluene, Ammonia (as N), Nitrate as N, Total Suspended Solid

4.0 STORMWATER			
4.1 Do you have industrial stormwater discharges from the site? If so, attach a site map outlining drainage areas served by each outfall. Indicate the following attributes within each drainage area: pavement or other impervious surfaces; buildings; outdoor storage areas; material loading and unloading areas; outdoor industrial activities; structural stormwater control measures; hazardous waste treatment, storage, and disposal units; and wells or springs in the area.			
OUTFALL NUMBER	TOTAL AREA DRAINED (PROVIDE UNITS)	TYPES OF SURFACES (VEGETATED, STONE , PAVED, ETC)	BEST MANAGEMENT PRACTICES EMPLOYED; INCLUDE STRUCTURAL BMPS AND TREATMENT DESIGN FLOW FOR BMPS DESCRIBE HOW FLOW IS MEASURED
004	246 acres	95% vegetated, 5% imperv.	N/A
018	231 acres	90% vegetated; 10% imperv.	Maintenance of constructed wetlands and berm
4.2 STORMWATER FLOWS Provide the date of sampling with the flows, and how the flows were estimated. Sampling occurs on a quarterly basis when flow is occurring. Flow is estimated with a gauge. See supplement.			
SIGNATORY REQUIREMENTS			
5.0 CERTIFICATION I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.			
NAME AND OFFICIAL TITLE (TYPE OR PRINT)			TELEPHONE NUMBER WITH AREA CODE
Peter Drucker - VP, General Counsel/ Secretary			(417) 624-8891
SIGNATURE (SEE INSTRUCTIONS) <div style="display: flex; align-items: center;"> <div style="text-align: center; margin-right: 10px;"> Drucker, A. (Peter) </div> <div style="font-size: 0.8em; line-height: 1.2;"> Digitally signed by Drucker, A. (Peter) DN: cn=Drucker, A. (Peter), ou=Users Reason: I am approving this document Date: 2022.06.27 10:20:54 -05'00' </div> </div>			DATE SIGNED
			June 27, 2022

SEE INSTRUCTIONS; PLEASE PRINT OR TYPE.

You may report some or all of this information on separate sheet (use *similar format*) instead of completing these pages.

FORM C TABLE 1 FOR 3.0 - ITEMS A AND B

EFFLUENT (AND INTAKE) CHARACTERISTICS										OUTFALL NO.			
3.0 PART A – You must provide the results of at least one analysis for every pollutant in Part A. Complete one table for each outfall or proposed outfall. See instructions.													
2. VALUES													
1. POLLUTANT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUES		C. LONG TERM AVERAGE VALUES		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS				
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS							
A. Biochemical Oxygen Demand, 5-day (BOD ₅)													
B. Chemical Oxygen Demand (COD)													
C. Total Organic Carbon (TOC)													
D. Total Suspended Solids (TSS)													
E. Ammonia as N													
F. Flow	VALUE		VALUE		VALUE			MILLIONS OF GALLONS PER DAY (MGD)					
G. Temperature (winter)	VALUE		VALUE		VALUE			°F					
H. Temperature (summer)	VALUE		VALUE		VALUE			°F					
I. pH	MINIMUM		MAXIMUM		AVERAGE			STANDARD UNITS (SU)					
3.0 PART B – Mark “X” in column 2A for each pollutant you know or have reason to believe is present. Mark “X” in column 2B for each pollutant you believe to be absent. If you mark Column 2A for any pollutant, you must provide the results for at least one analysis for the pollutant. Complete one table for each outfall (intake). Provide results for additional parameters not listed here in Part 3.0 C.													
3. VALUES													
1. POLLUTANT AND CAS NUMBER (if available)	2. MARK “X”		A. MAXIMUM DAILY VALUE				B. MAXIMUM 30 DAY VALUES		C. LONG TERM AVERAGE VALUES		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	CONCENTRATION	MASS	CONCENTRATION	MASS	CONCENTRATION	MASS	CONCENTRATION	MASS			
Subpart 1 – Conventional and Non-Conventional Pollutants													
A. Alkalinity (CaCO ₃)			MINIMUM				MINIMUM						
B. Bromide (24959-67-9)													
C. Chloride (16887-00-6)													
D. Chlorine, Total Residual													
E. Color													
F. Conductivity													
F. Cyanide, Amenable to Chlorination													

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. VALUES						4. UNITS		
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE		C. LONG TERM AVERAGE VALUE		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS
			CONCENTRATION	MASS	CONCENTRATION	MASS	CONCENTRATION	MASS			
Subpart 1 – Conventional and Non-Conventional Pollutants (Continued)											
G. <i>E. coli</i>											
H. Fluoride (16984-48-8)											
I. Nitrate plus Nitrate (as N)											
J. Kjeldahl, Total (as N)											
K. Nitrogen, Total Organic (as N)											
L. Oil and Grease											
M. Phenols, Total											
N. Phosphorus (as P), Total (7723-14-0)											
O. Sulfate (as SO ₄) (14808-79-8)											
P. Sulfide (as S)											
Q. Sulfite (as SO ₃) (14265-45-3)											
R. Surfactants											
S. Trihalomethanes, Total											
Subpart 2 – Metals											
1M. Aluminum, Total Recoverable (7429-90-5)											
2M. Antimony, Total Recoverable (7440-36-9)											
3M. Arsenic, Total Recoverable (7440-38-2)											
4M. Barium, Total Recoverable (7440-39-3)											
5M. Beryllium, Total Recoverable (7440-41-7)											
6M. Boron, Total Recoverable (7440-42-8)											
7M. Cadmium, Total Recoverable (7440-43-9)											
8M. Chromium III Total Recoverable (16065-83-1)											
9M. Chromium VI, Dissolved (18540-29-9)											
10M. Cobalt, Total Recoverable (7440-48-4)											

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. VALUES						4. UNITS		
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE		C. LONG TERM AVERAGE VALUE		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS
			CONCENTRATION	MASS	CONCENTRATION	MASS	CONCENTRATION	MASS			
Subpart 2 – Metals (Continued)											
11M. Copper, Total Recoverable (7440-50-8)											
12M. Iron, Total Recoverable (7439-89-6)											
13M. Lead, Total Recoverable (7439-92-1)											
14M. Magnesium, Total Recoverable (7439-95-4)											
15M. Manganese, Total Recoverable (7439-96-5)											
16M. Mercury, Total Recoverable (7439-97-6)											
17M. Methylmercury (22967926)											
18M. Molybdenum, Total Recoverable (7439-98-7)											
19M. Nickel, Total Recoverable (7440-02-0)											
20M. Selenium, Total Recoverable (7782-49-2)											
21M. Silver, Total Recoverable (7440-22-4)											
22M. Thallium, Total Recoverable (7440-28-0)											
23M. Tin, Total Recoverable (7440-31-5)											
24M. Titanium, Total Recoverable (7440-32-6)											
25M. Zinc, Total Recoverable (7440-66-6)											
Subpart 3 – Radioactivity											
1R. Alpha Total											
2R. Beta Total											
3R. Radium Total											
4R. Radium 226 plus 228 Total											

INSTRUCTIONS FOR FILLING OUT APPLICATION FOR NPDES DISCHARGE PERMIT – FORM C –
MANUFACTURING, COMMERCIAL, MINING, SILVICULTURE OPERATIONS, PROCESS WASTEWATER, NON-
PROCESS WASTEWATER, AND INDUSTRIAL STORMWATER DISCHARGES.

All applicable sections must be filled in when the application is submitted. The form must be signed as indicated. This application is to be completed only for facilities with a discharge. Non-discharging (land application facilities) should fill out the appropriate forms for the activity. Include any area with potential discharge, even if there is normally no discharge. If this form is not adequate for you to describe your existing operations, then sufficient information should be attached so an evaluation of the discharges can be made. Attach additional sheets as necessary for any additional information. If an applicant believes previous outfalls are no longer applicable to the facility, please indicate so. Certain parts of the application may be submitted electronically, such as extensive analytical data, or project plans relating to improvements. This may be included using a thumb drive or CD. If extensive data is submitted without an electronic copy, the department may request the submission at a later time so the permit writer can mathematically evaluate the data. If you have any questions regarding this form please contact the Water Protection Program Operating Permits Administrative Assistant at 800-361-4827 or 573-571-6825 and you will be directed to a permit writer.

GENERAL INFORMATION

1.0 Name of Facility – By what title or name is this facility known? Has the official name changed? Please indicate both the previous and current name you wish to be listed on the permit.


1.1 Operating permit number as assigned (MO-#####)

1.2 Indicate if this is a new facility or if there are any new discharges. Has the facility completed an antidegradation review? Is this facility being moved from a general permit to a site specific permit? If so, indicate general permit number.

1.3 Self-explanatory.

FLOWS, TYPE, AND FREQUENCY

2.0 The line drawing should show the route taken by water in your facility from intake to discharge. Show all operations contributing wastewater, including process and production areas, sanitary flows, cooling water, and stormwater runoff. Indicate any alternate treatment trains available. You may group similar operations into a single unit labeled to correspond to the more detailed listing. More than one drawing may be required depending on the complexity of the system. The water balance should show average and maximum flows. Show all significant losses of water to: products, atmosphere, public sewer systems; both storm sewer and sewer. You should use actual measurements whenever available; otherwise, use your best estimate. An example of an acceptable line drawing appears below.

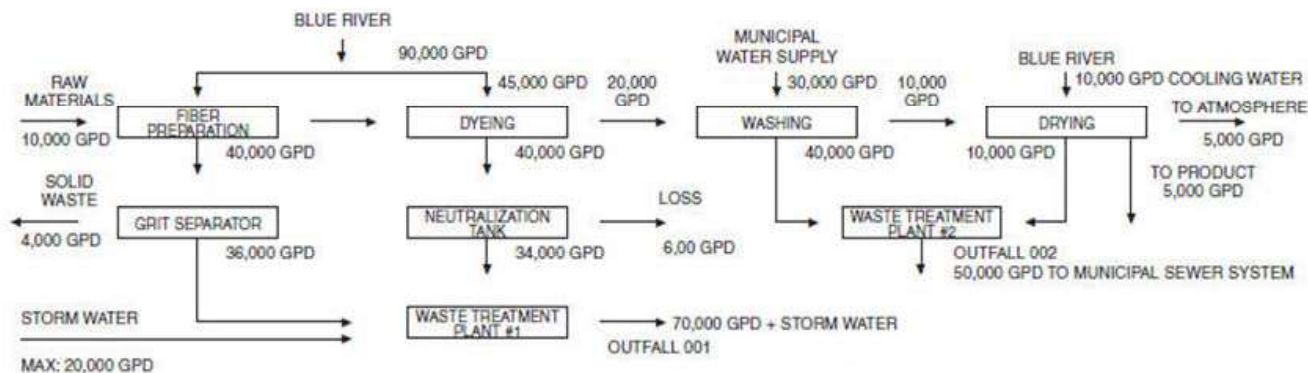

2.1 List all sources of wastewater to each outfall. Operations may be described in general terms (for example, “dye-making reactor” or a “distillation tower”). You may estimate the flow contributed by each source if no data is available, and for stormwater, you may use any reasonable measure of duration, volume, or frequency. For each treatment unit, indicate its size, flow rate, and retention time, and describe the ultimate disposal of any solid or liquid wastes not discharged. Treatment units should be listed in order and you should select the proper code from Table A to fill in column 3B for each treatment unit. Insert “XX” into column 3B if no code corresponds to a treatment unit you list.

TABLE A – CODES FOR TREATMENT UNITS

PHYSICAL TREATMENT PROCESSES			
1-A	Ammonia Stripping	1-M	Grit Removal
1-B	Dialysis	1-N	Microstraining
1-C	Diatomaceous Earth Filtration	1-O	Mixing
1-D	Distillation	1-P	Moving Bed Filters
1-E	Electrodialysis	1-Q	Multimedia Filtration
1-F	Evaporation	1-R	Rapid Sand Filtration
1-G	Flocculation	1-S	Reverse Osmosis (Hyper Filtration)
1-H	Flotation	1-T	Screening
1-I	Foam Fractionation	1-U	Sedimentation (Settling)
1-J	Freezing	1-V	Slow Sand Filtration
1-K	Gas-Phase Separation	1-W	Solvent Extraction
1-L	Grinding (Comminutors)	1-X	Sorption
CHEMICAL TREATMENT PROCESSES			
2-A	Carbon Absorption	2-G	Disinfection (Ozone)
2-B	Chemical Oxidation	2-H	Disinfection (Other)
2-C	Chemical Precipitation	2-I	Electrochemical Treatment
2-D	Coagulation	2-J	Ion Exchange
2-E	Dechlorination	2-K	Neutralization
2-F	Disinfection (Chlorine)	2-L	Reduction
BIOLOGICAL TREATMENT PROCESSES			
3-A	Activated Sludge	3-E	Pre-Aeration
3-B	Aerated Lagoons	3-F	Spray Irrigation/Land Application
3-C	Anaerobic Treatment	3-G	Stabilization Ponds
3-D	Nitrification-Denitrification	3-H	Trickling Filtration
OTHER PROCESSES			
4-A	Discharge to Surface Water	4-C	Reuse/Recycle of Treated Effluent
4-B	Ocean Discharge Through Outfall	4-D	Underground Injection
SLUDGE TREATMENT AND DISPOSAL PROCESSES			
5-A	Aerobic Digestion	5-M	Heat Drying
5-B	Anaerobic Digestion	5-N	Heat Treatment
5-C	Belt Filtration	5-O	Incineration
5-D	Centrifugation	5-P	Land Application
5-E	Chemical Conditioning	5-Q	Landfill
5-F	Chlorine Treatment	5-R	Pressure Filtration
5-G	Composting	5-S	Pyrolysis
5-H	Drying Beds	5-T	Sludge Lagoons
5-I	Elutriation	5-U	Vacuum Filtration
5-J	Flotation Thickening	5-V	Vibration
5-K	Freezing	5-W	Web Oxidation
5-L	Gravity Thickening		

2.2 A discharge is intermittent unless it occurs without interruption during the operating hours of the facility, except for infrequent shutdowns for maintenance, process changes, or other similar activities. A discharge is seasonal if it occurs only during certain parts of the year. Fill in every applicable column in this item for each source of intermittent or seasonal discharges. Base your answers on actual data whenever available; otherwise, provide your best estimate. Report the highest daily value for flow rate and total volume in the "Maximum Daily" columns. Report the average of all daily values measures during days when discharge occurred within the last year in the "Long Term Average" columns.

PRODUCTION

2.3 A. All effluent limitation guidelines (ELGs) promulgated by EPA appear in the Federal Register and are published annually in 40 CFR Subchapter N (400-499). A guideline applies to you based on the applicability sections within each subpart. If you are unsure you are covered by an ELG, check with your Missouri Department of Natural Resources' Regional Office. You must check yes if an applicable effluent guideline has been promulgated, even if the guideline limitations are being contested in court. If you believe a promulgated effluent guideline has been remanded for reconsideration by a court and does not apply to your operations, you may check no. The ELG number and subpart(s) must be included.

2.3 B. An ELG is expressed in terms of production (or other measure of operation) if the limitations are expressed as mass of pollutant per operational parameter; for example, "pounds of BOD per cubic foot of logs from which bark is removed," or "pounds of TSS per megawatt hour of electrical energy consumed by smelting furnace." An example of a guideline not expressed in terms of a measure of operation is one which limits the concentration of pollutants, or requires no discharge of the wastewater.

2.3 C. This item must be completed if you checked "yes" to item B. The production information requested here is necessary to apply effluent guidelines to your facility and you may not claim it as confidential. However, you do not have to indicate how the reported information was calculated. Report quantities and the units of measurement used in the applicable effluent guideline. The data provided must be a measure of actual operation over a one month period, such as the production for the highest month during the last twelve months, or the monthly average production for the highest year of the last five years, or other reasonable measure of actual operation, but may not be based on design capacity or on predictions of future increases in operation. This data must be concurrent of facility operations.

2.4 IMPROVEMENTS If you check yes to this question, complete all parts of the table, or attach a copy of any previous submission you have made containing the same information. You are not required to submit a description of future pollution control projects if you do not wish to, or if none are planned.

2.5 SLUDGE MANAGEMENT If the facility generates any sludge or biosolids, please indicate where the sludge accumulates (lagoon, tank, etc.) and the methods of disposal. Please include the volume and frequency of sludge removal/disposal and any haulers used. Please indicate if the facility composts, incinerates, landfills, stores, sells, or other methods of eliminating the sludge from lagoons or holding tanks. Consider submitting a sludge or biosolids management plan electronically if additional description is needed.

DATA COLLECTION AND REPORTING REQUIREMENTS FOR APPLICANTS

3.0 This section requires collection and reporting of data on pollutants discharged from each outfall, including stormwater outfalls, non-process wastewater, and any intake data you wish to provide. Parts A, B, and C address different sets of pollutants and must be completed in accordance with the specific instructions for the part. All data must be reported as a concentration **and** as total mass. You may report some or all of the required data by attaching separate sheets of paper.

3.0 A. and B. These sections are found on Table 1. Complete a separate table for each outfall and intake.

3.0 A. Requires reporting at least one analysis for each pollutant. Part A must be completed by all applicants for all outfalls, including outfalls containing only noncontact cooling water, stormwater runoff, or other discharges; intake values are not required in this Part. Upon written request, (email is suitable) prior to submitting the application, the department may waive the requirements to test for one or more of these pollutants upon determining testing for the pollutant(s) is not applicable for your effluent.

3.0 B. Mark "X" in either "Believed Present", Column 2A, or "Believed Absent", Column 2B, for each pollutant, based on your best estimate, and test those you believe present. Base your determination a pollutant is present in, or absent from, your discharge on your knowledge of your raw materials, source water, maintenance chemicals, intermediate, byproduct, and final products, and any previous analyses known to you of the facility's effluent, or of any similar effluent. If either chloride or sulfate is believed present, the department asks you to test for both chloride and sulfate. If you expect a pollutant is present as a result your intake water, you should mark "Believed Present" and analyze for the pollutant. Provide analysis of the intake or source water as well; this includes water withdrawn from wells or obtained from a potable water source. Presence of a pollutant in the discharge from sourced water does not eliminate disclosure requirements. If a

pollutant is reported as not present, the pollutant will be considered “believed absent” for the purposes of application shield.

3.0 A and B Continued

Use the following abbreviations (or other as applicable) in Column 4, “Units”. Mass must be specified as per day, month, or year.

CONCENTRATION		MASS	
ppm	parts per million	lbs	pounds
mg/L	milligrams per liter	ton	tons (English tons)
ppb	parts per billion	mg	Milligrams
ug/L	micrograms per liter	g	grams
pCi/L	picocuries per liter	kg	kilograms
		T	tonnes (metric tons)

MAXIMUM DAILY VALUE. If you measure a pollutant only once, complete only the “Maximum Daily Value” columns and insert “1” into the “number of analyses” in Column D. The Missouri Department of Natural Resources may require you to conduct additional analyses to further characterize your discharge. If the pollutant is sampled but not detected, a less than “<” symbol should be used next to the detection limit (or laboratory reporting limit). Simply stating “below detection limits” without quantifying the limit of detection may not be appropriate and additional information may be required.

MAXIMUM 30 DAY VALUES. “Maximum 30 Day Values” are not compulsory but should be filled out if data is available. The department suggests at least 4 samples (one per week) be collected over a one month period for averaging purposes, but is not required. Determine the average of all daily values taken during one calendar month, and report the highest average of all daily values taken during all calendar months, and report the highest average in Column B. Column D must show the number of samples used in the calculation.

LONG TERM AVERAGES. “Long Term Average Values” are not compulsory but should be filled out if data is available. Determine the long term average of all the data and report in Column C. Column D must show the number of samples used in the calculations. The facility should include a statement describing the timeframe of the data used in the calculations. Consider including an electronic copy of the data with the application.

SAMPLING. The collection of samples for analyses should be supervised by a person experienced in performing sampling of industrial wastewater and/or stormwater. You may contact your Missouri Department of Natural Resources’ Regional Office for detailed guidance on sampling techniques and for answers to specific questions. Any specific requirements contained in the applicable analytical methods should be followed for sample containers, sample preservation, holding times, the collection of duplicate or blank samples, etc. The time when you sample should be representative of your normal operation, with all processes contributing wastewater in normal operation, and with your treatment system operating properly with no system upsets. Samples should be collected from the center of the flow channel, at a site specified in your present permit, or for new discharges, at any site adequate for the collection of a representative sample.

GRAB SAMPLE. An individual sample of sufficient volume for analysis, collected at a randomly selected time, over a period not exceeding 15 minutes, which is representative of the discharge. Grab samples must be used for temperature, pH, total residual chlorine, oil and grease, *E. coli*, and any pollutant considered to be volatile. Grab samples are typically appropriate for stormwater.

COMPOSITE SAMPLE. Use composite sampling (if available) for all pollutants (except above). A combination of at least eight sample aliquots of at least 100 milliliters, collected at periodic intervals during the operating hours of a facility over a 24 hour period. For volatile pollutants, aliquots must be combined in the laboratory immediately before analysis. The composite must be proportional; either time interval proportional, or flow proportional. Aliquots may be collected manually or automatically.

ANALYSIS. You must use test methods promulgated in 40 CFR Part 136 for all analyses. The facility must use a sufficiently sensitive method to determine compliance with Missouri Water Quality Standards in accordance with Standard Conditions Part I. If no method has been promulgated for a particular pollutant, you may use any suitable method for measuring the level of the pollutant in your discharge. If there is no promulgated method, your attached description should include the preservation techniques, sample holding times, the quality control measures which you used, and any other

pertinent information, such as filtering or what fraction the method detects. For obscure methods or new contaminants, consider including an electronic copy of the method with the application and the laboratory analysis sheets.

IDENTICAL OUTFALL CONSIDERATION. If you have two or more substantially identical outfalls, you may submit the results of the analysis for one substantially identical outfall in its place. Identify which outfall you did test and describe why the outfalls which you did not test are substantially identical to the outfall you did test.

REPORTING OF INTAKE DATA. You are not required to report intake data unless you wish apply for “net” effluent limitations for one or more pollutants. Net limitations are technology limits adjusted by subtracting the level of the pollutant present in the intake water from the discharge. National Pollutant Discharge Elimination System (NPDES) regulations allow net limitations only in certain circumstances. To demonstrate eligibility, report the maximum and average of the results of analyses on the intake water, attach a statement the intake water is drawn from the same body of water into which the discharge is made, and a statement how the pollutant level is reduced by the wastewater treatment. When applicable, a demonstration to the extent the pollutants in the intake vary physically, chemically, or biologically from the pollutants contained in the discharge; for example, when the pollutant represents a class of compounds.

3.0. C. requires listing any pollutants from “TABLE B – TOXIC POLLUTANTS AND HAZARDOUS SUBSTANCES REQUIRED TO BE IDENTIFIED BY APPLICANTS IF EXPECTED TO BE PRESENT” you believe to be present and explain why you believe them to be present. If you have analytical data, you must report it. You may include other pollutants not listed below but present in your discharge in 3.0 C. Please provide Chemical Abstract Service (CAS) numbers for any additional pollutants described. If the facility is required to complete Form D, duplication of the parameters here is not required.

TABLE B – TOXIC POLLUTANTS AND HAZARDOUS SUBSTANCES REQUIRED TO BE IDENTIFIED BY APPLICANTS IF EXPECTED TO BE PRESENT		
TOXIC POLLUTANT	HAZARDOUS SUBSTANCES	HAZARDOUS SUBSTANCES
Asbestos	Dimethylamine	Napthenic acid
HAZARDOUS SUBSTANCES	Dintrobenzene	Nitrotoluene
Acetaldehyde	Diquat	Parathion
Allyl alcohol	Disulfoton	Phenolsulfonate
Allyl chloride	Diuron	Phosgene
Amyl acetate	Epichlorohydrin	Propargite
Aniline	Ethion	Propylene oxide
Benzonitrile	Ethylene diamine	Pyrethrins
Benzyl chloride	Ethylene dibromide	Quinoline
Butyl acetate	Formaldehyde	Resorcinol
Butylamine	Furfural	Strontium
Captan	Guthion	Strychnine
Carbaryl	Isoprene	Sytrene
Carbofuran	Isopropanolamine	2,4,5-T (2,4,5-Trichloro-phenoxyacetic acid)
Carbon disulfide	Kelthane	TDE (Tetrachlorodiphenyl ethane)
Chlorpyrifos	Kepone	2, 4, 5-TP (2-(2,4,5-Trichloro-phenoxy) propanoic acid)
Coumaphos	Malathion	Trichlorofon
Cresol	Mercaptodimethur	Triethanolamine
Crotonaldehyde	Methoxychlor	Triethaylamine
2,4-D (2,4-Dichloro-Phenoxyacetic acid)	Methyl mercaptan	Uranium
Diazinon	Methyl parathion	Vanadium
Dicamba	Mevinphos	Vinyl acetate
Dichlobenil	Mexacarbate	Xylene
2,2-Dichloropropionic acid	Monethyl amine	Xylenol
Dichlorvos	Monomethyl amine	Zirconium
Diethylamine	Nalad	

3.1 Self-explanatory.

3.2 Self-explanatory.

4.0 STORMWATER [10 CSR 20-6.200(2)(C)1.]

In accordance with 10 CSR 20-6.200(2)(C)1.E(I) and (II), the facility must sample the stormwater for any pollutant listed in the permit for process wastewater discharges and/or the applicable Effluent Limitation Guideline. All industrial stormwater must be sampled for parameters listed in 10 CSR 20-6.200(2)(C)1.E.(III); these are: oil and grease, pH, biochemical oxygen demands (BOD₅), chemical oxygen demands (COD), total suspended solids (TSS), conductivity, total phosphorus, total Kjeldahl nitrogen, and nitrate plus nitrite nitrogen.

4.1 Indicate the outfall numbers for industrial stormwater discharges. Provide the area drained by each outfall. Indicate the type and percentages of surface(s), for example: 60% grass or vegetated areas, 10% non-vegetated soils, 30% pavement, etc., the outfall drains. The facility must indicate any structural best management practices, such as settling/retention, rain garden/infiltration, filter socks, etc, employed at each outfall.


4.2 Describe the method used to determine the flow rate in accordance with 10 CSR 20-6.200(2)(C)1., and the flow rate; submit the date and duration of the storm event from which the samples were taken.

5.0 SIGNATORY REQUIREMENTS The Clean Water Act provides for severe penalties for submitting false information on this application form. Section 309(c)(2) of the Clean Water Act provides "Any person who knowingly makes any false statement, representation, or certification in any application . . . shall upon conviction, be punished by a fine of no more \$10,000 or by imprisonment for not more than six months, or both.

All applications must be signed as follows and the signature must be original. For a corporation: by an officer having responsibility for the overall operation of the regulated facility or activity or for environmental matters. For a partnership or sole proprietorship: by a general partner or the proprietor. For a municipal, state, federal or other public facility: by either a principal executive officer or by an individual having overall responsibility for environmental matters at the facility.

Supplement to Form C

Section 2.0

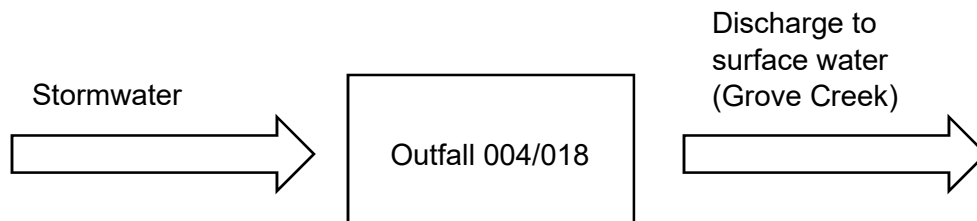

Section 3.0 Parts A & B

The latest sampling results for Outfall 004 and 018 are included below. Outfall 004 was sampled on April 11, 2022 following a precipitation event of approximately 3.03 inches. Flow at Outfall 004 was recorded to be 2.202 Mgal/day. Outfall 018 was sampled on April 12, 2022 following a precipitation event of approximately 0.31 inches. Flow at Outfall 018 was recorded to be 0.485 Mgal/day.

Analyte	Units	Outfall 004	Outfall 018
Perchlorate	ug/L	2.0	2.1
2,4-Dinitrotoluene	ug/L	0.11	<0.097
2,6-Dinitrotoluene	ug/L	0.096	<0.019
Ammonia (as N)	mg/L	0.41	1.5
Nitrate as N	mg/L	2.9	21
Settleable Solids	mL/L	<0.10	<0.10
Total Suspended Solids	mg/L	7.6	<4.0
pH	SU	6.7	6.9

Section 4.2

Outfall 004 was sampled on April 11, 2022, following a precipitation event of approximately 3.03 inches. Flow at Outfall 004 was recorded to be 2.202 Mgal/day. Outfall 018 was sampled on April 12, 2022, following a precipitation event of approximately 0.31 inches. Flow at Outfall 018 was recorded to be 0.485 Mgal/day. All flow measurements were estimated by direct read of a gauge at each outfall location.