

STATE OF MISSOURI  
**DEPARTMENT OF NATURAL RESOURCES**  
MISSOURI CLEAN WATER COMMISSION



**MISSOURI STATE OPERATING PERMIT**

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92<sup>nd</sup> Congress) as amended,

Permit No. MO-0004391

Owner: Metropolitan St. Louis Sewer District  
Address: 2350 Market Street, St. Louis, MO 63103

Continuing Authority:  
Address: Same as above

Facility Name: MSD, Missouri River Wastewater Treatment Plant  
Facility Address: 3455 Creve Coeur Mill Road, St. Louis, MO 63103

Legal Description: See Page 2  
UTM Coordinates: See Page 2

Receiving Stream: See Page 2  
First Classified Stream and ID: See Page 2  
USGS Basin & Sub-watershed No.: See Page 2

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

**FACILITY DESCRIPTION**

See Page 2

This permit authorizes only wastewater and stormwater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 621.250 RSMo, Section 640.013 RSMo and Section 644.051.6 of the Law.

January 1, 2018  
Effective Date

October 1, 2018  
Modification Date

Edward B. Galbraith  
Edward B. Galbraith, Director, Division of Environmental Quality

December 31, 2022  
Expiration Date

Chris Wieberg  
Chris Wieberg, Director, Water Protection Program

**FACILITY DESCRIPTION (continued):**

**Outfall #005** – Emergency overflow from the influent structure

Discharges from this outfall is no longer authorized, and shall be subject to 40 CFR 122.41(m) and reported according to 40 CFR 122.41(m)(3)(i) & (ii).

Legal Description: Landgrant 3094, St. Louis County  
UTM Coordinates: X= 717889, Y= 4291843  
USGS Basin & Sub-watershed No.: (10300200-0704)

**Outfall #006** – Stormwater

Legal Description: Landgrant 3094, St. Louis County  
UTM Coordinates: X= 718143, Y= 4290901  
USGS Basin & Sub-watershed No.: (10300200-0703)

**Outfall #007** – POTW – SIC #4952

The use or operation of this facility shall be by or under the supervision of a Certified “A” Operator.

Six (6) fine bar screens / three (3) washer compactor units / four (4) grit removal chambers / four (4) peak flow storage basins / four (4) pre-aeration basins / four (4) primary clarifiers / six (6) cell equalization tank / six (6) aeration tanks / six (6) final clarifiers / UV disinfection / four (4) effluent pumps / four (4) rotary drum thickeners / five (5) anaerobic sludge digesters / three (3) sludge centrifuges / two (2) sludge storage silos / sludge is hauled for subsequent land application, composting, incineration, or landfilling.

Design population equivalent is 380,000.

Design flow is 38 MGD.

Actual flow is 26 MGD.

Design sludge production is 8,030 dry tons/year.

Legal Description: Landgrant 3094, St. Louis County  
UTM Coordinates: X= 717587, Y= 4291619

Receiving Stream: Missouri River (P)  
First Classified Stream and ID: Missouri River (P) (1604) 303(d) List  
USGS Basin & Sub-watershed No.: (10300200-0704)

OUTFALL #007	TABLE A-1 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS					
	The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>January 1, 2018</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:					
EFFLUENT PARAMETER(S)	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
Flow	MGD	*		*	once/day	24 hr. total
Carbonaceous Biochemical Oxygen Demand <sub>5</sub>	mg/L		40	25	once/weekday***	composite**
Total Suspended Solids	mg/L		45	30	once/weekday***	composite**
<i>E. coli</i> (Note 1, Page 4)	#/100mL		1,030	206	once/week	grab
Ammonia, Total as N	mg/L	*		*	once/month	composite**
Oil & Grease	mg/L	15		10	once/month	grab
Phosphorus, Total as P	mg/L	*		*	once/month	grab
Nitrogen, Total as N	mg/L	*		*	once/month	grab
Nitrate plus Nitrite, Total as N	mg/L	*		*	once/month	grab
Kjeldahl Nitrogen, Total as N	mg/L	*		*	once/month	grab
MONITORING REPORTS SHALL BE SUBMITTED <u>MONTHLY</u> ; THE FIRST REPORT IS DUE <u>FEBRUARY 28, 2018</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						
EFFLUENT PARAMETER(S)	UNITS	MINIMUM		MAXIMUM	MEASUREMENT FREQUENCY	SAMPLE TYPE
pH – Units ****	SU	6.0		9.0	once/month	grab
MONITORING REPORTS SHALL BE SUBMITTED <u>MONTHLY</u> ; THE FIRST REPORT IS DUE <u>FEBRUARY 28, 2018</u> .						
EFFLUENT PARAMETER(S)			UNITS	MONTHLY AVERAGE MINIMUM	MEASUREMENT FREQUENCY	SAMPLE TYPE
Carbonaceous Biochemical Oxygen Demand <sub>5</sub> – Percent Removal (Note 2, Page 4)			%	85	once/month	calculated
Total Suspended Solids – Percent Removal (Note 2, Page 4)			%	85	once/month	calculated
MONITORING REPORTS SHALL BE SUBMITTED <u>MONTHLY</u> ; THE FIRST REPORT IS DUE <u>FEBRUARY 28, 2018</u> .						

\* Monitoring requirement only.

\*\* A 24-hour composite sample is composed of 48 aliquots (subsamples) collected at regular intervals no more than 30 minutes apart by an automatic sampling device. If there is a failure of the automatic sampling device, then the composite sample may be made up from a minimum of four grab samples collected within a 24-hour period with a minimum of 2 hours between each grab sample, until the automatic sampling device is repaired or replaced. Other alternate compositing approaches will be allowed with department approval.

\*\*\* Once each weekday means: Monday, Tuesday, Wednesday, Thursday, and Friday.

\*\*\*\* pH is measured in pH units and is not to be averaged.

Note 1 - Effluent limitations and monitoring requirements for *E. coli* are applicable only during the recreational season from April 1 through October 31. The Monthly Average Limit for *E. coli* is expressed as a geometric mean. The Weekly Average for *E. coli* will be expressed as a geometric mean if more than one (1) sample is collected during a calendar week (Sunday through Saturday).

Note 2 – Influent sampling is not required when the facility does not discharge effluent during the reporting period. Samples are to be collected prior to any treatment process. Percent removal is calculated by the following formula:  $[(\text{Influent} - \text{Effluent}) / \text{Influent}] \times 100\% = \text{Percent Removal}$ . The Monthly Average Minimum Percent removal is to be reported as the average of all daily calculated removal efficiencies. Influent samples are to be collected as a 24-hour composite sample, composed of 48 aliquots (subsamples) collected at 30 minute intervals by an automatic sampling device.

OUTFALL #007	<b>TABLE A-2</b> <b>WHOLE EFFLUENT TOXICITY</b> <b>FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS</b>					
	The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>January 1, 2018</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:					
EFFLUENT PARAMETER(S)	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
Acute Whole Effluent Toxicity (Note 3)	TU <sub>a</sub>	*			once/year	composite**
MONITORING REPORTS SHALL BE SUBMITTED DURING THE 1 <sup>ST</sup> , 2 <sup>ND</sup> , 3 <sup>RD</sup> , AND 5 <sup>TH</sup> YEARS OF THE PERMIT CYCLE; THE FIRST REPORT IS DUE <u>JUNE 28, 2018</u> .						
Chronic Whole Effluent Toxicity (Note 3)	TU <sub>c</sub>	*			once/permit cycle	composite**
MONITORING REPORTS SHALL BE SUBMITTED DURING THE 4 <sup>TH</sup> YEAR OF THE PERMIT CYCLE; THE FIRST REPORT IS DUE <u>JUNE 28, 2021</u> .						

\* Monitoring requirement only.

\*\* A 24-hour composite sample is composed of 48 aliquots (subsamples) collected at regular intervals no more than 30 minutes apart by an automatic sampling device. If there is a failure of the automatic sampling device, then the composite sample may be made up from a minimum of four grab samples collected within a 24-hour period with a minimum of 2 hours between each grab sample, until the automatic sampling device is repaired or replaced. Other alternate compositing approaches will be allowed with department approval.

Note 3 – A Whole Effluent Toxicity (WET) test is to be conducted once per year: Acute WET tests are to be completed and submitted in the 1<sup>st</sup>, 2<sup>nd</sup>, 3<sup>rd</sup>, and 5<sup>th</sup> years of the permit cycle. The Chronic WET test is to be completed and submitted in the 4<sup>th</sup> year of the permit cycle. See Special Conditions #19 and #20 for additional requirements.

## **B. STANDARD CONDITIONS**

In addition to specified conditions stated herein, this permit is subject to the attached Parts I, II, & III standard conditions dated August 1, 2014, May 1, 2013, and March 1, 2015, and hereby incorporated as though fully set forth herein.

### **C. SPECIAL CONDITIONS**

1. Electronic Discharge Monitoring Report (eDMR) Submission System.

- (a) Discharge Monitoring Reporting Requirements. The permittee must electronically submit compliance monitoring data via the eDMR system. In regards to Standard Conditions Part I, Section B, #7, the eDMR system is currently the only Department approved reporting method for this permit.
  - (b) Programmatic Reporting Requirements. The following reports (if required by this permit) must be electronically submitted as an attachment to the eDMR system until such a time when the current or a new system is available to allow direct input of the data:
    - (1) Collection System Maintenance Annual Reports;
    - (2) Sludge/Biosolids Annual Reports;
      - i. In addition to the annual Sludge/Biosolids report submitted to the Department, the permittee must submit Sludge/Biosolids Annual Reports electronically using EPA's NPDES Electronic Reporting Tool ("NeT") (<https://cdx.epa.gov/>).
    - (3) Municipal Separate Storm Sewer System (MS4) Program Reports;
    - (4) Pretreatment Program Reports; and
    - (5) Any additional report required by the permit excluding bypass reporting.After such a system has been made available by the Department, required data shall be directly input into the system by the next report due date.
  - (c) Other actions. The following shall be submitted electronically after such a system has been made available by the Department:
    - (1) General Permit Applications/Notices of Intent to discharge (NOIs);
    - (2) Notices of Termination (NOTs);
    - (3) No Exposure Certifications (NOEs); and
    - (4) Bypass reporting, See Special Condition #11 for 24-hr. bypass reporting requirements.
  - (d) Electronic Submissions. To access the eDMR system, use the following link in your web browser: <https://edmr.dnr.mo.gov/edmr/E2/Shared/Pages/Main/Login.aspx>.
  - (e) Waivers from Electronic Reporting. The permittee must electronically submit compliance monitoring data and reports unless a waiver is granted by the Department in compliance with 40 CFR Part 127. The permittee may obtain an electronic reporting waiver by first submitting an eDMR Waiver Request Form: <http://dnr.mo.gov/forms/780-2692-f.pdf>. The Department will either approve or deny this electronic reporting waiver request within 120 calendar days. Only permittees with an approved waiver request may submit monitoring data and reports on paper to the Department for the period that the approved electronic reporting waiver is effective.
2. The full implementation of this operating permit, which includes implementation of any applicable schedules of compliance, shall constitute compliance with all applicable federal and state statutes and regulations in accordance with §644.051.16, RSMo, and the CWA section 402(k); however, this permit may be reopened and modified, or alternatively revoked and reissued:
- (a) To comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
    - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
    - (2) controls any pollutant not limited in the permit.
  - (b) To incorporate an approved pretreatment program pursuant to 40 CFR 403.8(a).

- 3. Treatment facility outfalls must be clearly marked in the field. Stormwater outfalls shall either be marked in the field or clearly marked on a map and maintained with the Stormwater Pollution Prevention Plan.
- 4. Permittee will cease discharge by connection to a facility with an area-wide management plan per 10 CSR 20-6.010(3)(B) within 90 days of notice of its availability.
- 5. Report as no-discharge when a discharge does not occur during the report period.
- 6. Changes in existing pollutants or the addition of new pollutants to the treatment facility

The permittee must provide adequate notice to the Director of the following:

- (a) Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to section 301 or 306 of CWA if it were directly discharging those pollutants; and
- (b) Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit.
- (c) For purposes of this paragraph, adequate notice shall include information on:
  - (1) the quality and quantity of effluent introduced into the POTW, and
  - (2) any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

**C. SPECIAL CONDITIONS (continued)**

7. Reporting of Non-Detects:
  - (a) An analysis conducted by the permittee or their contracted laboratory shall be conducted in such a way that the precision and accuracy of the analyzed result can be enumerated.
  - (b) The permittee shall not report a sample result as "Non-Detect" without also reporting the detection limit of the test. Reporting as "Non Detect" without also including the detection limit will be considered failure to report, which is a violation of this permit.
  - (c) The permittee shall provide the "Non-Detect" sample result using the less than sign and the minimum detection limit (e.g. <10).
  - (d) Where the permit contains a Minimum Level (ML) and the permittee is granted authority in the permit to report zero in lieu of the < ML for a specified parameter (conventional, priority pollutants, metals, etc.), then zero (0) is to be reported for that parameter.
  - (e) See Standard Conditions Part I, Section A, #4 regarding proper detection limits used for sample analysis.
  - (f) When calculating monthly averages, one-half of the method detection limit (MDL) should be used instead of a zero. Where all data are below the MDL, the "<MDL" shall be reported as indicated in item (c).
8. It is a violation of the Missouri Clean Water Law to fail to pay fees associated with this permit (644.055 RSMo).
9. The permittee shall comply with any applicable requirements listed in 10 CSR 20-9, unless the facility has received written notification that the Department has approved a modification to the requirements. The monitoring frequencies contained in this permit shall not be construed by the permittee as a modification of the monitoring frequencies listed in 10 CSR 20-9. If a modification of the monitoring frequencies listed in 10 CSR 20-9 is needed, the permittee shall submit a written request to the Department for review and, if deemed necessary, approval.
10. The permittee has developed and is currently implementing a program for maintenance and repair of the collection system. The permittee's program is consistent with the US EPA's Guide for Evaluating Capacity, Management, Operation, and Maintenance (CMOM) Programs at Sanitary Sewer Collection Systems (Document number EPA 305-B-05-002). The permittee shall continue to submit semi-annual and annual reports as required by the federal consent decree entered in the matter of *The United States et al. v. The Metropolitan St. Louis Sewer District, No. 4:07-CV-1120 (E.D. Mo.)* which was entered on April 27, 2012.
11. Bypasses are not authorized at this facility unless they meet the criteria in 40 CFR 122.41(m). If a bypass occurs, the permittee shall report in accordance to 40 CFR 122.41(m)(3), and with Standard Condition Part I, Section B, subsection 2.b. Bypasses are to be reported to the St. Louis Regional Office during normal business hours or by using the online Sanitary Sewer Overflow/Facility Bypass Application located at: <http://dnr.mo.gov/modnrcag/> or the Environmental Emergency Response hotline at 573-634-2436 outside of normal business hours. Once an electronic reporting system compliant with 40 CFR Part 127, the National Pollutant Discharge Elimination System (NPDES) Electronic Reporting Rule, is available all bypasses must be reported electronically via the new system. Blending, which is the practice of combining a partially-treated wastewater process stream with a fully-treated wastewater process stream prior to discharge, is not considered a form of bypass. If the permittee wishes to utilize blending, the permittee shall file an application to modify this permit to facilitate the inclusion of appropriate monitoring conditions.
12. The facility must be sufficiently secured to restrict entry by children, livestock and unauthorized persons as well as to protect the facility from vandalism.
13. At least one gate must be provided to access the wastewater treatment facility and provide for maintenance and mowing. The gate shall remain closed except when temporarily opened by; the permittee to access the facility, perform operational monitoring, sampling, maintenance, mowing, or for inspections by the Department. The gate shall be closed and locked when the facility is not staffed.
14. At least one (1) warning sign shall be placed on each side of the facility enclosure in such positions as to be clearly visible from all directions of approach. There shall also be one (1) sign placed for every five hundred feet (500') (150 m) of the perimeter fence. A sign shall also be placed on each gate. Minimum wording shall be SEWAGE TREATMENT FACILITY—KEEP OUT. Signs shall be made of durable materials with characters at least two inches (2") high and shall be securely fastened to the fence, equipment or other suitable locations.
15. An Operation and Maintenance (O & M) manual shall be maintained by the permittee and made available to the operator. The O & M manual shall include key operating procedures and a brief summary of the operation of the facility.
16. An all-weather access road shall be provided to the treatment facility.

**C. SPECIAL CONDITIONS (continued)**

17. The discharge from the wastewater treatment facility shall be conveyed to the receiving stream via a closed pipe or a paved or rip-rapped open channel. Sheet or meandering drainage is not acceptable. The outfall sewer shall be protected against the effects of floodwater, ice or other hazards as to reasonably insure its structural stability and freedom from stoppage. The outfall shall be maintained so that a sample of the effluent can be obtained at a point after the final treatment process and before the discharge mixes with the receiving waters.
18. Land application of biosolids shall be conducted in accordance with Standard Conditions III and a Department approved biosolids management plan. Land application of biosolids during frozen, snow covered, or saturated soil conditions in accordance with the additional requirements specified in WQ426 shall occur only with prior approval from the Department.
19. Acute Whole Effluent Toxicity (WET) tests shall be conducted as follows:
  - (a) Freshwater Species and Test Methods: Species and short-term test methods for estimating the acute toxicity of NPDES effluents are found in the most recent edition of *Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms* (EPA/821/R-02/012; Table IA, 40 CFR Part 136). The permittee shall concurrently conduct 48-hour, static, non-renewal toxicity tests with the following species:
    - o The fathead minnow, *Pimephales promelas* (Acute Toxicity EPA Test Method 2000.0).
    - o The daphnid, *Ceriodaphnia dubia* (Acute Toxicity EPA Test Method 2002.0).
  - (b) Chemical and physical analysis of the upstream control sample and effluent sample shall occur immediately upon being received by the laboratory, prior to any manipulation of the effluent sample beyond preservation methods consistent with federal guidelines for WET testing that are required to stabilize the sample during shipping. Where upstream receiving water is not available or known to be toxic, other approved control water may be used.
  - (c) Test conditions must meet all test acceptability criteria required by the EPA Method used in the analysis.
  - (d) The Allowable Effluent Concentration (AEC) for this facility is 9.1% with the dilution series being: 40%, 20%, 10%, 5%, and 2.5%.
  - (e) All chemical and physical analysis of the effluent sample performed in conjunction with the WET test shall be performed at the 100% effluent concentration.
  - (f) The facility must submit a full laboratory report for all toxicity testing. The report must include a quantification of acute toxic units ( $TU_a = 100/LC_{50}$ ) reported according to the test methods manual chapter on report preparation and test review. The Lethal Concentration 50 Percent ( $LC_{50}$ ) is the effluent concentration that would cause death in 50 percent of the test organisms at a specific time.
20. Chronic Whole Effluent Toxicity (WET) tests shall be conducted as follows:
  - (a) Freshwater Species and Test Methods: Species and short-term test methods for estimating the chronic toxicity of NPDES effluents are found in the most recent edition of *Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms* (EPA/821/R-02/013; Table IA, 40 CFR Part 136). The permittee shall concurrently conduct 7-day, static, renewal toxicity tests with the following species:
    - o The fathead minnow, *Pimephales promelas* (Survival and Growth Test Method 1000.0).
    - o The daphnid, *Ceriodaphnia dubia* (Survival and Reproduction Test Method 1002.0).
  - (b) Chemical and physical analysis of the upstream control sample and effluent sample shall occur immediately upon being received by the laboratory, prior to any manipulation of the effluent sample beyond preservation methods consistent with federal guidelines for WET testing that are required to stabilize the sample during shipping. Where upstream receiving water is not available or known to be toxic, other approved control water may be used.
  - (c) Test conditions must meet all test acceptability criteria required by the EPA Method used in the analysis.
  - (d) The Allowable Effluent Concentration (AEC) is 1%, the dilution series is: 25%, 5%, 1%, 0.2%, and 0.04%.
  - (e) All chemical and physical analysis of the effluent sample performed in conjunction with the WET test shall be performed at the 100% effluent concentration.
  - (f) The facility must submit a full laboratory report for all toxicity testing. The report must include a quantification of chronic toxic units ( $TU_c = 100/IC_{25}$ ) reported according to the *Methods for Measuring the Chronic Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms* chapter on report preparation and test review. The 25 percent Inhibition Effect Concentration ( $IC_{25}$ ) is the toxic or effluent concentration that would cause 25 percent reduction in mean young per female or in growth for the test populations.

**C. SPECIAL CONDITIONS (continued)**

21. **Pretreatment:** The permittee shall implement and enforce its approved pretreatment program in accordance with the requirements of 10 CSR 20-6.100. The approved pretreatment program is hereby incorporated by reference.
- (a) The permittee shall submit to the Department via the Electronic Discharge Monitoring Report (eDMR) Submission System on or before September 30<sup>th</sup> of each year a report briefly describing its pretreatment activities during the previous calendar year. At a minimum, the report shall include the following:
- (1) An updated list of the Permittee's Industrial Users, including their names and addresses, or a list of deletions and additions keyed to a previously submitted list. The Permittee shall provide a brief explanation of each deletion. This list shall identify which Industrial Users are subject to categorical pretreatment Standards and specify which Standards are applicable to each Industrial User. The list shall indicate which Industrial Users are subject to local standards that are more stringent than the categorical Pretreatment Standards. The Permittee shall also list the Industrial Users that are subject only to local Requirements;
  - (2) A summary of the status of Industrial User compliance over the reporting period;
  - (3) A summary of compliance and enforcement activities (including inspections) conducted by the Permittee during the reporting period; and
  - (4) Any other relevant information requested by the Department.
- (b) Pursuant to 40 CFR 122.44(j)(2)(ii), the permittee shall submit to the Department a written technical evaluation of the need to revise local limits under 40 CFR 403.5(c)(1) within 180 days of the effective date of this permit.

22. **Sewer Extension Authority Supervised Program:**

The Department approved the Sewer Extension Authority Supervised Program for the St. Louis Metropolitan Sewer District (MSD) to regulate and approve construction of sanitary sewers and pump stations, which are tributary to this wastewater treatment facility on November 15, 2017. MSD shall act as the continuing authority for the operation, maintenance, and modernization of the constructed collection system. This approval may be modified or revoked by the Department if the wastewater collection, transportation, or treatment facilities reach their design capacity, if the treatment facility falls into chronic noncompliance with the permit, or if the permittee fails to follow the terms and conditions of the submitted and approved program.

This permit may be reopened and modified or alternatively revoked and reissued to incorporate new or modified conditions to the Sewer Extension Authority Supervised Program, if information indicates changes are necessary to assure compliance with Missouri's Clean Water Law and associated regulations. When any of the above mentioned conditions occur, the permittee will be notified prior to any modifications of this permit condition.

An annual report on the Sewer Extension Authority Supervised Program must be submitted by January 28 of each year to the Missouri Department of Natural Resources' Water Protection Program's Engineering Section. The electronic submittals may be emailed to [DNR.WPPEngineerSection@dnr.mo.gov](mailto:DNR.WPPEngineerSection@dnr.mo.gov). Detailed project information on leakage, deflection, and inspection shall be available for review upon request. The report shall contain the following for each sewer extension:

- (a) Name of sewer extension;
- (b) Length of sewer and force main;
- (c) Capacity of each new or upgraded pump station, if applicable;
- (d) Date sewer extension permit is issued;
- (e) Date sewer extension construction is accepted;
- (f) The ultimate receiving wastewater treatment facility; and
- (g) The remaining long term average capacity of each wastewater treatment facility.

The Department's Water Protection Program's, Engineering Section will reevaluate the MSD's Authority Supervised Program for reauthorization when they file an application for permit renewal to determine if it is current, complete, and meets the requirements of 10 CSR 20-8 Design Guides. Once the Sewer Extension Authority Supervised Program is reauthorized or denied, this condition will be updated accordingly.

23. **Expanded Effluent Testing:**

Permittee must sample and analyze for the pollutants listed in 40 CFR 122.21 Appendix J, Table 2 in addition to Iron and Aluminum. Pursuant to 40 CFR 122.21(j)(4) the permittee shall provide this data with the permit renewal application from a minimum of three samples taken within four and one-half years prior to the date of the permit application. Samples must be representative of the seasonal variation in the discharge from each POTW outfall.



**C. SPECIAL CONDITIONS (continued)**

24. Stormwater Pollution Prevention Plan (SWPPP): A SWPPP must be developed and implemented within 180 days of the effective date of this permit. Through implementation of the SWPPP, the permittee shall minimize the release of pollutants in stormwater from the facility to the waters of the state. The SWPPP shall be developed in consultation with the concepts and methods described in the following document: Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators, (Document number EPA 833-B-09-002) published by the United States Environmental Protection Agency (USEPA) in February 2009.
- (a) The SWPPP must identify any stormwater outfall from the facility and Best Management Practices (BMPs) used to prevent or reduce the discharge of contaminants in stormwater. The stormwater outfalls shall either be marked in the field or clearly marked on a map and maintained with the SWPPP.
  - (b) The SWPPP must include a schedule and procedures for a once per month routine site inspection.
    - (1) The monthly routine inspection shall be documented in a brief written report, which shall include:
      - i. The person(s) conducting the inspection.
      - ii. The inspection date and time.
      - iii. Weather information for the day of the inspection.
      - iv. Precipitation information for the entire period since the last inspection.
      - v. Description of the discharges observed, including visual quality of the discharges (sheen, turbid, etc.).
      - vi. Condition of BMPs
      - vii. If BMPs were replaced or repaired.
      - viii. Observations and evaluations of BMP effectiveness.
    - (2) Any deficiency observed during the routine inspection must be corrected within seven (7) days and the actions taken to correct the deficiencies shall be included with the written report.
    - (3) The routine inspection reports must be kept onsite with the SWPPP and maintained for a period of five (5) years.
    - (4) The routine inspection reports shall be made available to Department personnel upon request.
  - (c) The SWPPP must include a schedule and procedures for a once per year comprehensive site inspection.
    - (1) The annual comprehensive inspection shall be documented in a written report, which shall include:
      - i. The person(s) conducting the inspection.
      - ii. The inspection date and time.
      - iii. Findings from the areas of your facility that were examined;
      - iv. All observations relating to the implementation of your control measures including:
        - 1. Previously unidentified discharges from the site,
        - 2. Previously unidentified pollutants in existing discharges,
        - 3. Evidence of, or the potential for, pollutants entering the drainage system;
        - 4. Evidence of pollutants discharging to receiving waters at all facility outfall(s), and the condition of and around the outfall, and
        - 5. Additional control measures needed to address any conditions requiring corrective action identified during the inspection.
      - v. Any required revisions to the SWPPP resulting from the inspection;
      - vi. Any incidence of noncompliance observed or a certification stating that the facility is in compliance.
    - (2) Any deficiency observed during the comprehensive inspection must be corrected within seven (7) days and the actions taken to correct the deficiencies shall be included with the written report.
    - (3) The comprehensive inspection reports must be kept onsite with the SWPPP and maintained for a period of five (5) years.
    - (4) The comprehensive inspection reports shall be made available to Department personnel upon request.
  - (d) The SWPPP must be kept on-site and should not be sent to the Department unless specifically requested.
  - (e) The SWPPP must be reviewed and updated at a minimum once per permit cycle, as site conditions or control measures change.

**C. SPECIAL CONDITIONS (continued)**

25. The permittee shall select, install, use, operate, and maintain the Best Management Practices prescribed in the SWPPP.
- (a) Permittee shall adhere to the following minimum Best Management Practices (BMPs):
- (1) Minimize the exposure of industrial material storage areas, loading and unloading areas, dumpsters and other disposal areas, maintenance activities, and fueling operations to rain, snow, snowmelt, and runoff, by locating industrial materials and activities inside or protecting them with storm resistant coverings, if warranted and practicable.
  - (2) Provide good housekeeping practices on the site to prevent potential pollution sources from coming into contact with stormwater and provide collection facilities and arrange for proper disposal of waste products, including sludge.
  - (3) Implement a maintenance program to ensure that the structural control measures and industrial equipment is kept in good operating condition and to prevent or minimize leaks and other releases of pollutants.
  - (4) Prevent or minimize the spillage or leaks of fluids, oil, grease, fuel, etc. from equipment and vehicle maintenance, equipment and vehicle cleaning, or activities.
  - (5) Provide sediment and erosion control sufficient to prevent or control sediment loss off of the property. This could include the use of straw bales, silt fences, or sediment basins, if needed.
  - (6) Provide stormwater runoff controls to divert, infiltrate, reuse, contain, or otherwise minimize pollutants in the stormwater discharge.
  - (7) Enclose or cover storage piles of salt or piles containing salt, used for deicing or other commercial or industrial purposes.
  - (8) Provide training to all employees who; work in areas where industrial materials or activities are exposed to stormwater, are responsible for stormwater inspections, are members of the Pollution Prevention Team. Training must cover the specific control measures and monitoring, inspection, planning, reporting and documentation requirements of this permit. Training is recommended annually for any applicable staff and whenever a new employee is hired who meets the description above.
  - (9) Eliminate and prevent unauthorized non-stormwater discharges at the facility.
  - (10) Minimize generation of dust and off-site tracking of raw, final, or waste materials by implementing appropriate control measures.

**Missouri Department of Natural Resources  
Factsheet Addendum  
For Pretreatment Program Modification  
#MO-0004391  
Metropolitan St. Louis Sewer District**

This addendum gives pertinent information regarding minor/simple modification(s) to the above listed operating permit for a public comment process.

An addendum is not an enforceable part of a Missouri State Operating Permit.

In accordance with the state Clean Water Law, Chapter 644, RSMo and the Federal Clean Water Act, the Metropolitan St. Louis Sewer District (MSD) has an approved pretreatment program to meet the requirements of 40 CFR Part 403 and 10 CSR 20-6.100. The Department, as Approval Authority, reviewed the proposed program modifications and, by issuance of this permit, grants its approval as required by 40 CFR 403.18 and 10 CSR 20-6.100.

**Part I – Pretreatment Program Modification**

The pretreatment program modification:

The MSD's ordinance No. 12559 was revised to implement a recommendation that was made in the May 14, 2018, report of the Department's February 14, 2018, inspection of MSD's pretreatment program. In the inspection report, the Department highly recommended that MSD modify its ordinance to clearly identify the Control Authority's legal authority by November 12, 2018. MSD should consider incorporation of the definition of significant industrial user, as found in 40 CR 403.3(v), into ordinance to clearly identify criteria.

MSD modified its ordinance to add the definition of significant industrial user or SIU and non-significant industrial user or NSCIU and the annual certification statement for the NSCIU.

☒ - The Department is not required public notice this program modification

This is a non-substantial modification of the district's pretreatment program, according to the 40 CFR 403.18(b)(1). These changes do not require public notice and are hereby approved pursuant to 40 CFR 403.18 (adopted in 10 CSR 20-6.100) and the Metropolitan St. Louis Sewer District should proceed to implement the pretreatment program requirements.

**Part II – Reason for the NPDES Permit Modification**

In accordance with 40 CFR 403.18(e), "all modifications shall be incorporated into the POTW's NPDES permit upon approval. The permit will be modified to incorporate the approved modification in accordance with 40 CFR 122.63(g)." Upon the consent of the permittee, the Director may modify a permit to make the corrections or allowances for changes in the permitted activity listed in this section, without following the procedures of part 124. Any permit modification not processed as a minor modification under this section must be made for cause and with part 124 draft permit and public notice as required in § 122.62. Minor modifications include:

(g) Incorporate conditions of a POTW pretreatment program that has been approved in accordance with the procedures in 40 CFR 403.11 (or a modification thereto that has been approved in accordance with the procedures in 40 CFR 403.18) as enforceable conditions of the POTW's permits.

**Date of addendum:** 09/25/2018

Completed by:

Todd Blanc,  
Pretreatment Coordinator  
Water Protection Program  
314-416-2064  
[todd.blanc@dnr.mo.gov](mailto:todd.blanc@dnr.mo.gov)

**MISSOURI DEPARTMENT OF NATURAL RESOURCES**  
**FACT SHEET**  
**FOR THE PURPOSE OF RENEWAL**  
**OF**  
**MO-0004391**  
**MSD, MISSOURI RIVER WASTEWATER TREATMENT PLANT**

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollutant Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of stormwater from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)(A)2.] a Factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (operating permit) listed below.

A Factsheet is not an enforceable part of an operating permit.

This Factsheet is for a Major.

**Part I – Facility Information**

Facility Type: POTW - SIC #4952

**Facility Description:**

Six (6) fine bar screens / three (3) washer compactor units / four (4) grit removal chambers / four (4) peak flow storage basins / four (4) pre-aeration basins / four (4) primary clarifiers / six (6) cell equalization tank / six (6) aeration tanks / six (6) final clarifiers / UV disinfection / four (4) effluent pumps / four (4) rotary drum thickeners / five (5) anaerobic sludge digesters / three (3) sludge centrifuges / two (2) sludge storage silos / sludge is hauled for subsequent land application, composting, incineration, or landfilling.

The average design flow for the facility is 38 MGD. Preliminary treatment can process up to 190 MGD. Flows that are greater than 80 MGD are diverted from primary and secondary treatment to one of four peak flow storage basins. The wastewater stored in these basins is pumped back to the headworks of the plant for treatment.

Application Date: 07/25/16  
Expiration Date: 01/19/17

**OUTFALL(S) TABLE:**

OUTFALL	DESIGN FLOW (CFS)	TREATMENT LEVEL	EFFLUENT TYPE
#005	<i>Emergency Overflow from Influent Structure</i>		
#006	<i>Stormwater Outfall</i>		
#007	58.9	Secondary	Domestic

**Facility Performance History:**

This facility was last inspected on June 22, 2016. The conditions of the facility at the time of inspection were found to be satisfactory. A review of the past five years of monitoring data submitted by the permittee shows an exceedance of CBOD<sub>5</sub> in January 2013. No other exceedances were reported.

Comments:

Monitoring requirements for stormwater Outfall #006 have been removed and replaced with a requirement to develop and implement a Stormwater Pollution Prevention Plan (SWPP). See Special Conditions #25 and #26.

Changes in this permit include the addition of Voluntary Early Nutrient Monitoring Program effluent parameters at the request of the permittee in order to simplify the reporting process. Chronic WET monitoring of the effluent has also been added. Changes in this permit also include the removal of cadmium, chromium, lead, hardness, and COD monitoring. See Part VI of the Fact Sheet for further information regarding the addition and removal of effluent parameters. Special conditions were updated to include the addition of reporting of Non-detects requirements, bypass reporting requirements, chronic WET testing requirements, eDMR reporting requirements, expanded effluent testing requirements, and requirements for the development and implementation of a SWPPP.

## **Part II – Operator Certification Requirements**

As per [10 CSR 20-6.010(8) Terms and Conditions of a Permit], the permittee shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions and regulations. Operators or supervisors of operations at regulated wastewater treatment facilities shall be certified in accordance with [10 CSR 20-9.020(2)] and any other applicable state law or regulation. As per [10 CSR 20-9.020(2)(A)], requirements for operation by certified personnel shall apply to all wastewater treatment systems, if applicable, as listed below:

Owned or operated by or for a

☐ - Municipalities

☐ - Federal agency

☐ - County

☒ - Public Sewer District

☐ - State agency

☐ - Private Sewer Company regulated by the Public Service Commission

☐ - Public Water Supply Districts

Each of the above entities are only applicable if they have a Population Equivalent greater than two hundred (200) or fifty (50) or more service connections.

This facility currently requires an operator with an A Certification Level. Please see **Appendix - Classification Worksheet**. Modifications made to the wastewater treatment facility may cause the classification to be modified.

Operator's Name: Kenneth Gambaro  
Certification Number: 3809  
Certification Level: A

The listing of the operator above only signifies that staff drafting this operating permit have reviewed appropriate Department records and determined that the name listed on the operating permit application has the correct and applicable Certification Level.

## **Part III– Operational Monitoring**

☒ - As per [10 CSR 20-9.010(4)], the facility is required to conduct operational monitoring.

## Part IV – Receiving Stream Information

### RECEIVING STREAM(S) TABLE: OUTFALL #007

WATER-BODY NAME	CLASS	WBID	DESIGNATED USES*	12-DIGIT HUC	DISTANCE TO CLASSIFIED SEGMENT (MI)
Missouri River	P	1604	AQL, WBC-B, SCR, HHP, IRR, LWW, DWS, IND	10300200-0704	Direct Discharge

\*As per 10 CSR 20-7.031 Missouri Water Quality Standards, the Department defines the Clean Water Commission's water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and 1<sup>st</sup> classified receiving stream's beneficial water uses to be maintained are in the receiving stream table in accordance with [10 CSR 20-7.031(1)(C)].

Uses which may be found in the receiving streams table, above:

10 CSR 20-7.031(1)(C)1.:

**AQL** = Protection of aquatic life (Current narrative use(s) are defined to ensure the protection and propagation of fish shellfish and wildlife, which is further subcategorized as: **WWH** = Warm Water Habitat; **CDF** = Cold-water fishery (Current narrative use is cold-water habitat.); **CLF** = Cool-water fishery (Current narrative use is cool-water habitat); **EAH** = Ephemeral Aquatic Habitat; **MAH** = Modified Aquatic Habitat; **LAH** = Limited Aquatic Habitat. This permit uses AQL effluent limitations in 10 CSR 20-7.031 Table A for all habitat designations unless otherwise specified.)

10 CSR 20-7.031(1)(C)2.: Recreation in and on the water

**WBC** = Whole Body Contact recreation where the entire body is capable of being submerged;

**WBC-A** = Whole body contact recreation that supports swimming uses and has public access;

**WBC-B** = Whole body contact recreation that supports swimming;

**SCR** = Secondary Contact Recreation (like fishing, wading, and boating).

10 CSR 20-7.031(1)(C)3. to 7.:

**HHP** (formerly HHF) = Human Health Protection as it relates to the consumption of fish;

**IRR** = Irrigation for use on crops utilized for human or livestock consumption;

**LWW** = Livestock and wildlife watering (Current narrative use is defined as LWP = Livestock and Wildlife Protection);

**DWS** = Drinking Water Supply;

**IND** = Industrial water supply

10 CSR 20-7.031(1)(C)8-11.: Wetlands (10 CSR 20-7.031 Table A currently does not have corresponding habitat use criteria for these defined uses)

**WSA** = Storm- and flood-water storage and attenuation; **WHP** = Habitat for resident and migratory wildlife species;

**WRC** = Recreational, cultural, educational, scientific, and natural aesthetic values and uses; **WHC** = Hydrologic cycle maintenance.

10 CSR 20-7.031(6): **GRW** = Groundwater

### RECEIVING STREAM(S) LOW-FLOW VALUES:

RECEIVING STREAM (C, E, P, P1)	LOW-FLOW VALUES (CFS)*		
	1Q10	7Q10	30Q10
Missouri River (P)	23,816	24,339	26,412

\* - Data from USGS Gauge Station 06935965 located on the Missouri River at St. Charles, MO

### MIXING CONSIDERATIONS TABLE:

MIXING ZONE (CFS) [10 CSR 20-7.031(5)(A)4.B.(II)(a)]			ZONE OF INITIAL DILUTION (CFS) [10 CSR 20-7.031(5)(A)4.B.(II)(b)]*		
1Q10	7Q10	30Q10	1Q10	7Q10	30Q10
5,954	6,085	6,603	589	589	NA

\* - Zone of initial dilution shall be no more than ten (10) times the design flow volume.

### RECEIVING STREAM MONITORING REQUIREMENTS:

No receiving water monitoring requirements recommended at this time.

### Receiving Water Body's Water Quality

This facility discharges to a 303(d) listed stream. The Missouri River (P) (1604) is listed on the 2016 Missouri 303(d) List for *E. coli*. This facility has the potential to contribute to this pollutant, although not significantly as their effluent is disinfected in order to comply with *E. coli* effluent limits. The Missouri River also has a Total Maximum Daily Load (TMDL) for Chlordanes and PCBs in fish tissue; however, this facility is not a source of the impairment.

## **Part V – Rationale and Derivation of Effluent Limitations & Permit Conditions**

### **ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:**

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

☒ - The facility does not discharge to a Losing Stream as defined by [10 CSR 20-2.010(36)] & [10 CSR 20-7.031(1)(N)], or is an existing facility.

### **ANTI-BACKSLIDING:**

A provision in the Federal Regulations [CWA §303(d)(4); CWA §402(o); 40 CFR Part 122.44(l)] that requires a reissued permit to be as stringent as the previous permit with some exceptions. Limitations in this operating permit for the reissuance of this permit conform to the anti-backsliding provisions of Section 402(o) of the Clean Water Act, and 40 CFR Part 122.44.

☒ - Information is available which was not available at the time of permit issuance (other than revised regulations, guidance, or test methods) and which would have justified the application of a less stringent effluent limitation at the time of permit issuance.

- **pH.** 6.0-9.0 SU pH limitations [10 CSR 20-7.015] are protective of the water quality standard [10 CSR 20-7.031(5)(E)] due to the buffering capacity of the mixing zone.
- **Whole Effluent Toxicity.** WET testing requirements were changed from pass/fail to monitoring only for toxic units. This change reflects modifications to Missouri's Effluent Regulation found at 10 CSR 20-7.015. 40 CFR 122.44(d)(1)(ii) requiring the Department to establish effluent limitations to control all parameters which have the reasonable potential to cause or contribute to an excursion above any state water quality standard, including state narrative criteria. The previous permit imposed a pass/fail limitation without collecting sufficient numerical data to conduct an analytical reasonable potential analysis. The permit writer has made a reasonable potential determination which concluded the facility does not have reasonable potential at this time but monitoring is required. Implementation of the toxic unit monitoring requirement will allow the Department to effect numeric criteria in accordance with water quality standards established under §303 of the CWA.
- **Stormwater Parameters.** The previous permit established monitoring requirements for flow, precipitation, BOD<sub>5</sub>, pH, Oil & Grease, and Settleable Solids in Outfall #006. These parameters have all been removed from the permit and replaced with a requirement to develop and implement a Stormwater Pollution Prevention Plan (SWPPP). After reviewing the past five years of stormwater sampling data submitted by the permittee, the Department believes the requirements of developing and implementing a SWPPP will still be protective of water quality.

☒ - The Department determines that technical mistakes or mistaken interpretations of law were made in issuing the permit under section 402(a)(1)(b).

- **General Criteria.** The previous permit contained a special condition which described a specific set of prohibitions related to general criteria found in 10 CSR 20-7.031(4). In order to comply with 40 CFR 122.44(d)(1), the permit writer has conducted reasonable potential determinations for each general criterion and established numeric effluent limitations where reasonable potential exists. While the removal of the previous permit special condition creates the appearance of backsliding, since this permit establishes numeric limitations where reasonable potential to cause or contribute to an excursion of the general criteria exists the permit maintains sufficient effluent limitations and monitoring requirements in order to protect water quality, this permit is equally protective as compared to the previous permit. Therefore, given this new information, and the fact that the previous permit special condition was not consistent with 40 CFR 122.44(d)(1), an error occurred in the establishment of the general criteria as a special condition of the previous permit. Please see Part VII – Effluent Limits Determination for more information regarding the reasonable potential determinations for each general criterion related to this facility.

### **ANTIDEGRADATION:**

In accordance with Missouri's Water Quality Standard [10 CSR 20-7.031(3)], for domestic wastewater discharge with new, altered, or expanding discharges, the Department is to document by means of Antidegradation Review that the use of a water body's available assimilative capacity is justified. In accordance with Missouri's water quality regulations for antidegradation [10 CSR 20-7.031(3)], degradation may be justified by documenting the socio-economic importance of a discharge after determining the necessity of the discharge. Facilities must submit the antidegradation review request to the Department prior to establishing, altering, or expanding discharges. See <http://dnr.mo.gov/env/wpp/permits/antideg-implementation.htm>

☒ - No degradation proposed and no further review necessary. Facility did not apply for authorization to increase pollutant loading or to add additional pollutants to their discharge.

For stormwater discharges, the stormwater BMP chosen for the facility, through the antidegradation analysis performed by the facility, must be implemented and maintained at the facility. Failure to implement and maintain the chosen BMP alternative is a permit violation; see SWPPP.

☒ - The facility must review and maintain stormwater BMPs as appropriate.

**AREA-WIDE WASTE TREATMENT MANAGEMENT & CONTINUING AUTHORITY:**

As per [10 CSR 20-6.010(3)(B)], ...An applicant may utilize a lower preference continuing authority by submitting, as part of the application, a statement waiving preferential status from each existing higher preference authority, providing the waiver does not conflict with any area-wide management plan approved under section 208 of the Federal Clean Water Act or any other regional sewage service and treatment plan approved for higher preference authority by the Department.

**BIOSOLIDS & SEWAGE SLUDGE:**

Biosolids are solid materials resulting from domestic wastewater treatment that meet federal and state criteria for beneficial uses (i.e. fertilizer). Sewage sludge is solids, semi-solids, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information regarding biosolids and sludge is located at the following web address:

<http://extension.missouri.edu/main/DisplayCategory.aspx?C=74>, items WQ422 through WQ449.

☒ - Permittee has and a Department approved biosolids management plan, and is authorized to land applies biosolids in accordance with Standard Conditions III.

**COMPLIANCE AND ENFORCEMENT:**

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

☒ - The facility is not currently under Water Protection Program enforcement action.

**ELECTRONIC DISCHARGE MONITORING REPORT (EDMR) SUBMISSION SYSTEM:**

The U.S. Environmental Protection Agency (EPA) promulgated a final rule on October 22, 2015, to modernize Clean Water Act reporting for municipalities, industries, and other facilities by converting to an electronic data reporting system. This final rule requires regulated entities and state and federal regulators to use information technology to electronically report data required by the National Pollutant Discharge Elimination System (NPDES) permit program instead of filing paper reports. To comply with the federal rule, the Department is requiring all permittees to begin submitting discharge monitoring data and reports online. In an effort to aid facilities in the reporting of applicable information electronically, the Department has created several new forms including operational control monitoring forms and an I&I location and reduction form. These forms are for optional use and can be found on the Department's website at the following locations:

Operational Monitoring Lagoon: <http://dnr.mo.gov/forms/780-2801-f.pdf>

Operational Monitoring Mechanical: <http://dnr.mo.gov/forms/780-2800-f.pdf>

I&I Report: <http://dnr.mo.gov/forms/780-2690-f.pdf>

Per 40 CFR 127.15 and 127.24, permitted facilities may request a temporary waiver for up to 5 years or a permanent waiver from electronic reporting from the Department. To obtain an electronic reporting waiver, a permittee must first submit an eDMR Waiver Request Form: <http://dnr.mo.gov/forms/780-2692-f.pdf>. A request must be made for each facility. If more than one facility is owned or operated by a single entity, then the entity must submit a separate request for each facility based on its specific circumstances. An approved waiver is non-transferable.

The Department must review and notify the facility within 120 calendar days of receipt if the waiver request has been approved or rejected [40 CFR 124.27(a)]. During the Department review period as well as after a waiver is granted, the facility must continue submitting a hard-copy of any reports required by their permit. The Department will enter data submitted in hard-copy from those facilities allowed to do so and electronically submit the data to the EPA on behalf of the facility.

☒ - The permittee/facility is currently using the eDMR data reporting system.



**PRETREATMENT PROGRAM:**

The reduction of the amount of pollutants, the elimination of pollutants, or the alteration of the nature of pollutant properties in wastewater prior to or in lieu of discharging or otherwise introducing such pollutants into a Publicly Owned Treatment Works [40 CFR Part 403.3(q)].

Pretreatment programs are required at any POTW (or combination of POTW operated by the same authority) and/or municipality with a total design flow greater than 5.0 MGD and receiving industrial wastes that interfere with or pass through the treatment works or are otherwise subject to the pretreatment standards. Pretreatment programs can also be required at POTWs/municipals with a design flow less than 5.0 MGD if needed to prevent interference with operations or pass through.

Several special conditions pertaining to the permittee's pretreatment program may be included in the permit, and are as follows:

- Implementation and enforcement of the program,
- Annual pretreatment report submittal,
- Submittal of list of industrial users,
- Technical evaluation of need to establish local limitations, and
- Submittal of the results of the evaluation

☒ - This permittee has an approved pretreatment program in accordance with the requirements of [40 CFR Part 403] and [10 CSR 20-6.100] and is expected to implement and enforce its approved program.

**REASONABLE POTENTIAL ANALYSIS (RPA):**

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants that are or may be discharged at a level that will cause or have the reasonable potential to cause or contribute to an in-stream excursion above narrative or numeric water quality standard.

In accordance with [40 CFR Part 122.44(d)(1)(iii)] if the permit writer determines that any given pollutant has the reasonable potential to cause, or contribute to an in-stream excursion above the WQS, the permit must contain effluent limits for that pollutant.

☒ - A RPA was conducted on appropriate parameters. Please see **APPENDIX – RPA RESULTS**.

**REMOVAL EFFICIENCY:**

Removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Carbonaceous Biochemical Oxygen Demand 5-day (CBOD<sub>5</sub>) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals.

☒ - Secondary Treatment is 85% removal [40 CFR Part 133.102(a)(3) & (b)(3)].

**SANITARY SEWER OVERFLOWS (SSO) AND INFLOW AND INFILTRATION (I&I):**

Sanitary Sewer Overflows (SSOs) are defined as untreated sewage releases and are considered bypassing under state regulation [10 CSR 20-2.010(11)] and should not be confused with the federal definition of bypass. SSOs result from a variety of causes including blockages, line breaks, and sewer defects that can either allow wastewater to backup within the collection system during dry weather conditions or allow excess stormwater and groundwater to enter and overload the collection system during wet weather conditions. SSOs can also result from lapses in sewer system operation and maintenance, inadequate sewer design and construction, power failures, and vandalism. SSOs include overflows out of manholes, cleanouts, broken pipes, and other into waters of the state and onto city streets, sidewalks, and other terrestrial locations.

Inflow and Infiltration (I&I) is defined as unwanted intrusion of stormwater or groundwater into a collection system. This can occur from points of direct connection such as sump pumps, roof drain downspouts, foundation drains, and storm drain cross-connections or through cracks, holes, joint failures, faulty line connections, damaged manholes, and other openings in the collection system itself. I&I results from a variety of causes including line breaks, improperly sealed connections, cracks caused by soil erosion/settling, penetration of vegetative roots, and other sewer defects. In addition, excess stormwater and groundwater entering the collection system from line breaks and sewer defects have the potential to negatively impact the treatment facility.

Missouri RSMo §644.026.1.(13) mandates that the Department issue permits for discharges of water contaminants into the waters of this state, and also for the operation of sewer systems. Such permit conditions shall ensure compliance with all requirements as established by sections 644.006 to 644.141. Standard Conditions Part I, referenced in the permit, contains provisions requiring proper operation and maintenance of all facilities and systems of treatment and control. Missouri RSMo §644.026.1.(15) instructs the Department to require proper maintenance and operation of treatment facilities and sewer systems and proper disposal of residual waste from all such facilities. To ensure that public health and the environment are protected, any noncompliance which may endanger public health or the environment must be reported to the Department within 24 hours of the time the permittee becomes aware of the noncompliance. Standard Conditions Part I, referenced in the permit, contains the reporting requirements for the permittee when bypasses and upsets occur.

☒ - The permittee has developed and is currently implementing a program for maintenance and repair of the collection system. The permittee's program is consistent with the US EPA's Guide for Evaluating Capacity, Management, Operation, and Maintenance (CMOM) Programs at Sanitary Sewer Collection Systems (Document number EPA 305-B-05-002). The permittee shall continue to submit semi-annual and annual reports as required by the federal consent decree entered in the matter of *The United States et al. v. The Metropolitan St. Louis Sewer District*, No. 4:07-CV-1120 (E.D. Mo.) which was entered on April 27, 2012.

**SCHEDULE OF COMPLIANCE (SOC):**

Per 644.051.4 RSMo, a permit may be issued with a Schedule of Compliance (SOC) to provide time for a facility to come into compliance with new state or federal effluent regulations, water quality standards, or other requirements. Such a schedule is not allowed if the facility is already in compliance with the new requirement, or if prohibited by other statute or regulation. A SOC includes an enforceable sequence of interim requirements (actions, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit. *See also* Section 502(17) of the Clean Water Act, and 40 CFR §122.2. For new effluent limitations, the permit includes interim monitoring for the specific parameter to demonstrate the facility is not already in compliance with the new requirement. Per 40 CFR § 122.47(a)(1) and 10 CSR 20-7.031(11), compliance must occur as soon as possible. If the permit provides a schedule for meeting new water quality based effluent limits, a SOC must include an enforceable, final effluent limitation in the permit even if the SOC extends beyond the life of the permit.

A SOC is not allowed:

- For effluent limitations based on technology-based standards established in accordance with federal requirements, if the deadline for compliance established in federal regulations has passed. 40 CFR § 125.3.
- For a newly constructed facility in most cases. Newly constructed facilities must meet applicable effluent limitations when discharge begins, because the facility has installed the appropriate control technology as specified in a permit or antidegradation review. A SOC is allowed for a new water quality based effluent limit that was not included in a previously public noticed permit or antidegradation review, which may occur if a regulation changes during construction.
- To develop a TMDL, UAA, or other study associated with development of a site specific criterion. A facility is not prohibited from conducting these activities, but a SOC may not be granted for conducting these activities.

In order to provide guidance to Permit Writers in developing SOC's, and attain a greater level of consistency, on April 9, 2015 the Department issued an updated policy on development of SOC's. This policy provides guidance to Permit Writers on the standard time frames for schedules for common activities, and guidance on factors that may modify the length of the schedule such as a Cost Analysis for Compliance.

☒ - This permit does not contain a SOC.

**SEWER EXTENSION AUTHORITY SUPERVISED PROGRAM:**

In accordance with [10 CSR 20-6.010(6)(A)], the Department may grant approval of a permittee's Sewer Extension Authority Supervised Program. These approved permittees regulate and approve construction of sanitary sewers and pump stations, which are tributary to this wastewater treatment facility. The permittee shall act as the continuing authority for the operation, maintenance, and modernization of the constructed collection system. See <http://dnr.mo.gov/env/wpp/permits/sewer-extension.htm>.

☒ - The permittee's Sewer Extension Authority Supervised Program has been reauthorized. Please see Special Condition #22 for applicable conditions.

**STORMWATER POLLUTION PREVENTION PLAN (SWPPP):**

In accordance with 40 CFR 122.44(k) *Best Management Practices (BMPs)* to control or abate the discharge of pollutants when: (1) Authorized under section 304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities; (2) Authorized under section 402(p) of the CWA for the control of stormwater discharges; (3) Numeric effluent limitations are infeasible; or (4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA.

In accordance with the EPA's *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (Document number EPA 833-B-09-002) [published by the United States Environmental Protection Agency (USEPA) in February 2009], BMPs are measures or practices used to reduce the amount of pollution entering (regarding this operating permit) waters of the state. BMPs may take the form of a process, activity, or physical structure.

Additionally in accordance with the Stormwater Management, a SWPPP is a series of steps and activities to (1) identify sources of pollution or contamination, and (2) select and carry out actions which prevent or control the pollution of stormwater discharges. The purpose of a SWPPP is to comply with all applicable stormwater regulations by creating an adaptive management plan to control and mitigate stream pollution from stormwater runoff. Developing a SWPPP provides opportunities to employ appropriate BMPs to minimize the risk of pollutants being discharged during storm events. The following paragraph outlines the general steps the permittee should take to determine which BMPs will work to achieve the benchmark values or limits in the permit. This section is not intended to be all encompassing or restrict the use of any physical BMP or operational and maintenance procedure assisting in pollution control. Additional steps or revisions to the SWPPP may be required to meet the requirements of the permit.

Areas which should be included in the SWPPP are identified in 40 CFR 122.26(b)(14). Once the potential sources of stormwater pollution have been identified, a plan should be formulated to best control the amount of pollutant being released and discharged by each activity or source. This should include, but is not limited to, minimizing exposure to stormwater, good housekeeping measures, proper facility and equipment maintenance, spill prevention and response, vehicle traffic control, and proper materials handling. Once a plan has been developed the facility will employ the control measures determined to be adequate to achieve the benchmark values discussed above. The facility will conduct monitoring and inspections of the BMPs to ensure they are working properly and re-evaluate any BMP not achieving compliance with permitting requirements. For example, if sample results from an outfall show values of TSS above the benchmark value, the BMP being employed is deficient in controlling stormwater pollution. Corrective action should be taken to repair, improve, or replace the failing BMP. This internal evaluation is required at least once per month but should be continued more frequently if BMPs continue to fail. If failures do occur, continue this trial and error process until appropriate BMPs have been established.

For new, altered, or expanded stormwater discharges, the SWPPP shall identify reasonable and effective BMPs while accounting for environmental impacts of varying control methods. The antidegradation analysis must document why no discharge or no exposure options are not feasible. The selection and documentation of appropriate control measures shall serve as an alternative analysis of technology and fulfill the requirements of antidegradation [10 CSR 20-7.031(3)]. For further guidance, consult the antidegradation implementation procedure (<http://dnr.mo.gov/env/wpp/docs/AIP050212.pdf>).

Alternative Analysis (AA) evaluation of the BMPs is a structured evaluation of BMPs that are reasonable and cost effective. The AA evaluation should include practices that are designed to be: 1) non-degrading; 2) less degrading; or 3) degrading water quality. The glossary of AIP defines these three terms. The chosen BMP will be the most reasonable and effective management strategy while ensuring the highest statutory and regulatory requirements are achieved and the highest quality water attainable for the facility is discharged. The AA evaluation must demonstrate why “no discharge” or “no exposure” is not a feasible alternative at the facility. This structured analysis of BMPs serves as the antidegradation review, fulfilling the requirements of 10 CSR 20-7.031(3) Water Quality Standards and *Antidegradation Implementation Procedure* (AIP), Section II.B.

If parameter-specific numeric exceedances continue to occur and the permittee feels there are no practicable or cost-effective BMPs which will sufficiently reduce a pollutant concentration in the discharge to the benchmark values established in the permit, the permittee can submit a request to re-evaluate the benchmark values. This request needs to include 1) a detailed explanation of why the facility is unable to comply with the permit conditions and unable to establish BMPs to achieve the benchmark values; 2) financial data of the company and documentation of cost associated with BMPs for review and 3) the SWPPP, which should contain adequate documentation of BMPs employed, failed BMPs, corrective actions, and all other required information. This will allow the Department to conduct a cost analysis on control measures and actions taken by the facility to determine cost-effectiveness of BMPs. The request shall be submitted in the form of an operating permit modification; the application is found at: <http://dnr.mo.gov/forms/index.html>.

☒ - 10 CSR 20-6.200 and 40 CFR 122.26 includes treatment works treating domestic sewage or any other sewage sludge or wastewater treatment device or system, used in the storage treatment, recycling, and reclamation of municipal or domestic sewage, including land dedicated to the disposal of sewage sludge that is located within the confines of the facility, with a design flow of 1.0 mgd or more, or are required to have an approved pretreatment program under 40 CFR part 403, as an industrial activity in which permit coverage is required.

In lieu of requiring sampling in the site-specific permit, the facility is required to develop and implement a Stormwater Pollution Prevention Plan (SWPPP). A facility can apply for conditional exclusion for “no exposure” of industrial activities and materials to stormwater by submitting a permit modification via Form B2 (<http://dnr.mo.gov/forms/780-1805-f.pdf>) appropriate application filing fees and a completed NPDES Form 3510-11 – No Exposure Certification for Exclusion from NPDES Stormwater Permitting ([https://www3.epa.gov/npdes/pubs/msgp2008\\_appendixk.pdf](https://www3.epa.gov/npdes/pubs/msgp2008_appendixk.pdf)) to the Department’s Water Protection Program, Operating Permits Section. Upon approval of the No Exposure Certification, the permit will be modified and the Special Condition to develop and implement a SWPPP will be removed. This information will be reevaluated at the time of renewal.

**VARIANCE:**

As per the Missouri Clean Water Law § 644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §§644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §§644.006 to 644.141.

☒ - This operating permit is not drafted under premises of a petition for variance.

**WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:**

As per [10 CSR 20-2.010(78)], the amount of pollutant each discharger is allowed by the Department to release into a given stream after the Department has determined total amount of pollutant that may be discharged into that stream without endangering its water quality.

☒ - Wasteload allocations were calculated where applicable using water quality criteria or water quality model results and the dilution equation below:

$$C_e = \frac{(Q_e + Q_s)C - (Q_s \times C_s)}{(Q_e)} \quad (\text{EPA/505/2-90-001, Section 4.5.5})$$

Where C = downstream concentration      C<sub>e</sub> = effluent concentration  
Cs = upstream concentration              Q<sub>e</sub> = effluent flow  
Q<sub>s</sub> = upstream flow

Chronic wasteload allocations were determined using applicable chronic water quality criteria (CCC: criteria continuous concentration) and stream volume of flow at the edge of the mixing zone (MZ). Acute wasteload allocations were determined using applicable water quality criteria (CMC: criteria maximum concentration) and stream volume of flow at the edge of the zone of initial dilution (ZID).

Water quality based maximum daily and average monthly effluent limitations were calculated using methods and procedures outlined in USEPA's "Technical Support Document For Water Quality-based Toxics Control" (EPA/505/2-90-001).

**Number of Samples "n":**

Additionally, in accordance with the TSD for water quality-based permitting, effluent quality is determined by the underlying distribution of daily values, which is determined by the Long Term Average (LTA) associated with a particular Wasteload Allocation (WLA) and by the Coefficient of Variation (CV) of the effluent concentrations. Increasing or decreasing the monitoring frequency does not affect this underlying distribution or treatment performance, which should be, at a minimum, be targeted to comply with the values dictated by the WLA. Therefore, it is recommended that the actual planned frequency of monitoring normally be used to determine the value of "n" for calculating the AML. However, in situations where monitoring frequency is once per month or less, a higher value for "n" must be assumed for AML derivation purposes. Thus, the statistical procedure being employed using an assumed number of samples is "n = 4" at a minimum. For Total Ammonia as Nitrogen, "n = 30" is used

**WLA MODELING:**

There are two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs). If TBELs do not provide adequate protection for the receiving waters, then WQBEL must be used.

☒ - A WLA study was either not submitted or determined not applicable by Department staff.

**WATER QUALITY STANDARDS:**

Per [10 CSR 20-7.031(4)], General Criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, [40 CFR 122.44(d)(1)] directs the Department to establish in each NPDES permit to include conditions to achieve water quality established under Section 303 of the Clean Water Act, including State narrative criteria for water quality.

**WHOLE EFFLUENT TOXICITY (WET) TEST:**

A WET test is a quantifiable method of determining if a discharge from a facility may be causing toxicity to aquatic life by itself, in combination with or through synergistic responses when mixed with receiving stream water.

☒ - The permittee is required to conduct WET test for this facility.

Under the federal Clean Water Act (CWA) §101(a)(3), requiring WET testing is reasonably appropriate for site-specific Missouri State Operating Permits for discharges to waters of the state issued under the National Pollutant Discharge Elimination System (NPDES). WET testing is also required by 40 CFR 122.44(d)(1). WET testing ensures that the provisions in the 10 CSR 20-6.010(8)(A)7. and the Water Quality Standards 10 CSR 20-7.031(4)(D),(F),(G),(I)2.A & B are being met. Under [10 CSR 20-6.010(8)(A)4], the Department may require other terms and conditions that it deems necessary to assure compliance with the Clean Water Act and related regulations of the Missouri Clean Water Commission. In addition the following MCWL apply: §§644.051.3 requires the Department to set permit conditions that comply with the MCWL and CWA; 644.051.4 specifically references toxicity as an item we must consider in writing permits (along with water quality-based effluent limits, pretreatment, etc...); and 644.051.5 is the basic authority to require testing conditions. WET test will be required by facilities meeting the following criteria:

- ☒ Facility is a designated Major.
- ☐ Facility continuously or routinely exceeds its design flow.
- ☐ Facility that exceeds its design population equivalent (PE) for BOD<sub>5</sub> whether or not its design flow is being exceeded.
- ☐ Facility (whether primarily domestic or industrial) that alters its production process throughout the year.
- ☐ Facility handles large quantities of toxic substances, or substances that are toxic in large amounts.
- ☐ Facility has Water Quality-based Effluent Limitations for toxic substances (other than NH<sub>3</sub>)
- ☒ Facility is a municipality with a Design Flow ≥ 22,500 gpd.
- ☐ Other – please justify.

**40 CFR 122.41(M) - BYPASSES:**

The federal Clean Water Act (CWA), Section 402 prohibits wastewater dischargers from “bypassing” untreated or partially treated sewage (wastewater) beyond the headworks. A bypass is defined as an intentional diversion of waste streams from any portion of a treatment facility, [40 CFR 122.41(m)(1)(i)]. Additionally, Missouri regulation 10 CSR 20-7.015(9)(G) states a bypass means the intentional diversion of waste streams from any portion of a treatment facility, except in the case of blending, to waters of the state. Only under exceptional and specified limitations do the federal regulations allow for a facility to bypass some or all of the flow from its treatment process. Bypasses are prohibited by the CWA unless a permittee can meet all of the criteria listed in 40 CFR 122.41(m)(4)(i)(A), (B), & (C). Any bypasses from this facility are subject to the reporting required in 40 CFR 122.41(l)(6) and per Missouri’s Standard Conditions I, Section B, part 2.b. Additionally, Anticipated Bypasses include bypasses from peak flow basins or similar devices designed for peak wet weather flows.

☒ - This facility does not anticipate bypassing.

**303(d) LIST & TOTAL MAXIMUM DAILY LOAD (TMDL):**

Section 303(d) of the federal Clean Water Act requires that each state identify waters that are not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock and wildlife. The 303(d) list helps state and federal agencies keep track of waters that are impaired but not addressed by normal water pollution control programs.

A TMDL is a calculation of the maximum amount of a given pollutant that a body of water can absorb before its water quality is affected. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan will be developed that shall include the TMDL calculation

☒ - This facility discharges to a 303(d) listed stream. The Missouri River (P) (1604) is listed on the 2016 Missouri 303(d) List for *E. coli*. This facility has the potential to contribute to this pollutant, although not significantly as their effluent is disinfected in order to comply with *E. coli* effluent limits.

☒ - This facility discharges to a stream with an EPA approved TMDL. The Missouri River (P) (1604) has a Total Maximum Daily Load (TMDL) for Chlordanes and PCBs in fish tissue; however, this facility is not a source of the impairment.

## Part VI – Effluent Limits Determination

### APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:

As per Missouri's Effluent Regulations [10 CSR 20-7.015], the waters of the state are divided into the below listed seven (7) categories. Each category lists effluent limitations for specific parameters, which are presented in each outfall's Effluent Limitation Table and further discussed in the Derivation & Discussion of Limits section.

- |                                                                                        |                                                                         |
|----------------------------------------------------------------------------------------|-------------------------------------------------------------------------|
| <input checked="" type="checkbox"/> Missouri or Mississippi River [10 CSR 20-7.015(2)] | <input type="checkbox"/> Metropolitan No-Discharge [10 CSR 20-7.015(5)] |
| <input type="checkbox"/> Lake or Reservoir [10 CSR 20-7.015(3)]                        | <input type="checkbox"/> Subsurface Water [10 CSR 20-7.015(7)]          |
| <input type="checkbox"/> Losing [10 CSR 20-7.015(4)]                                   | <input type="checkbox"/> All Other Waters [10 CSR 20-7.015(8)]          |

### OUTFALL #007 – MAIN FACILITY OUTFALL

Effluent limitations derived and established in the below Effluent Limitations Table are based on current operations of the facility. Future permit action due to facility modification may contain new operating permit terms and conditions that supersede the terms and conditions, including effluent limitations, of this operating permit.

### EFFLUENT LIMITATIONS TABLE:

PARAMETER	Unit	Basis for Limits	Daily Maximum	Weekly Average	Monthly Average	Previous Permit Limit	Sampling Frequency	Reporting Frequency	Sample Type ****
Flow	MGD	1	*		*	*/	Daily	Monthly	T
CBOD <sub>5</sub>	mg/L	1		40	25	40/25	Weekdays	Monthly	C
TSS	mg/L	1		45	30	45/30	Weekdays	Monthly	C
<i>Escherichia coli</i> **	#/100mL	1, 3		1,030	206	1,030/206	Weekly	Monthly	G
Ammonia, Total as N	mg/L	2, 3	*		*	*/	Monthly	Monthly	C
Oil & Grease	mg/L	1, 3	15		10	15/10	Monthly	Monthly	G
Phosphorus, Total as P	mg/L	1, 11	*		*	*/	Monthly	Monthly	G
Nitrogen, Total as N	mg/L	1, 11	*		*	*/	Monthly	Monthly	G
Nitrate plus Nitrite, Total as N	mg/L	11	*		*	*/	Monthly	Monthly	G
Kjeldahl Nitrogen, Total as N	mg/L	11	*		*	***	Monthly	Monthly	G
Acute Whole Effluent Toxicity	TUa	1, 9	*			Pass/Fail	Annually	Annually	C
Chronic Whole Effluent Toxicity	TUc	1, 9	*			***	Once/permit cycle	Once/permit cycle	C
PARAMETER	Unit	Basis for Limits	Minimum		Maximum	Previous Permit Limit	Sampling Frequency	Reporting Frequency	Sample Type
pH	SU	1	6.0		9.0	6.5-9.0	Monthly	Monthly	G
PARAMETER	Unit	Basis for Limits	Daily Minimum		Monthly Avg Min	Previous Permit Limit	Sampling Frequency	Reporting Frequency	Sample Type
CBOD <sub>5</sub> Percent Removal	%	1			85	85	Monthly	Monthly	M
TSS Percent Removal	%	1			85	85	Monthly	Monthly	M

\* - Monitoring requirement only.

\*\* - #/100mL; the Monthly Average for *E. coli* is a geometric mean.

\*\*\* - Parameter was not previously established in previous state operating permit.

\*\*\*\* - C = 24-hour composite

G = Grab

T = 24-hr. total

M = Measured/calculated

#### Basis for Limitations Codes:

- |                                          |                                   |                                                 |
|------------------------------------------|-----------------------------------|-------------------------------------------------|
| 1. State or Federal Regulation/Law       | 5. Antidegradation Policy         | 9. WET Test Policy                              |
| 2. Water Quality Standard (includes RPA) | 6. Water Quality Model            | 10. Multiple Discharger Variance                |
| 3. Water Quality Based Effluent Limits   | 7. Best Professional Judgment     | 11. Voluntary Early Nutrient Monitoring Program |
| 4. Antidegradation Review                | 8. TMDL or Permit in lieu of TMDL |                                                 |

**OUTFALL #007 – DERIVATION AND DISCUSSION OF LIMITS:**

- **Flow.** In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification.
- **Carbonaceous Biochemical Oxygen Demand (CBOD<sub>5</sub>).** Effluent limitations have been retained from previous state operating permit, please see the **APPLICABLE DESIGNATION OF WATERS OF THE STATE** sub-section of the **Effluent Limits Determination.**
- **Total Suspended Solids (TSS).** Effluent limitations have been retained from previous state operating permit, please see the **APPLICABLE DESIGNATION OF WATERS OF THE STATE** sub-section of the **Effluent Limits Determination.**
- **Escherichia coli (E. coli).** Monthly average of 206 per 100 mL as a geometric mean and Weekly Average of 1,030 per 100 mL as a geometric mean during the recreational season (April 1 – October 31), to protect Whole Body Contact Recreation (B) designated use of the receiving stream, as per 10 CSR 20-7.031(5)(C). An effluent limit for both monthly average and weekly average is required by 40 CFR 122.45(d). The Geometric Mean is calculated by multiplying all of the data points and then taking the nth root of this product, where n = # of samples collected. For example: Five E. coli samples were collected with results of 1, 4, 6, 10, and 5 (#/100mL). Geometric Mean = 5<sup>th</sup> root of (1)(4)(6)(10)(5) = 5<sup>th</sup> root of 1,200 = 4.1 #/100mL.
- **Total Ammonia Nitrogen.** Monitoring only; statistical analysis conducted using the past five years of effluent data provided by the permittee indicates there is no reasonable potential for ammonia to cause or contribute to an instream excursion of water quality standards. Monitoring data will be used during the next renewal period to determine reasonable potential.
- **Oil & Grease.** Conventional pollutant, effluent limitation for protection of aquatic life; 10 mg/L monthly average, 15 mg/L daily maximum.
- **Total Phosphorus and Total Nitrogen.** Monitoring required for facilities greater than 100,000 gpd design flow per 10 CSR 20-7.015(9)(D)7. Total Nitrogen shall be determined by testing for Total Kjeldahl Nitrogen (TKN) and Nitrate + Nitrite and reporting the sum of the results (reported as N). Nitrate + Nitrite can be analyzed together or separately.
- **Nitrate plus Nitrite as Nitrogen, and Total Kjeldahl Nitrogen.** This facility participates in the Voluntary Early Nutrient Monitoring Program and requested that these parameters be included as a requirement of their permit to simplify the reporting process.
- **pH.** 6.0-9.0 SU pH limitations [10 CSR 20-7.015] are protective of the water quality standard [10 CSR 20-7.031(5)(E)] due to the buffering capacity of the mixing zone.
- **Carbonaceous Biochemical Oxygen Demand (CBOD<sub>5</sub>) Percent Removal.** In accordance with 40 CFR Part 133, removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Carbonaceous Biochemical Oxygen Demand 5-day (CBOD<sub>5</sub>) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals. This facility is required to meet 85% removal efficiency for CBOD<sub>5</sub>.
- **Total Suspended Solids (TSS) Percent Removal.** In accordance with 40 CFR Part 133, removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Carbonaceous Biochemical Oxygen Demand 5-day (CBOD<sub>5</sub>) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals. This facility is required to meet 85% removal efficiency for TSS.
- **Acute Whole Effluent Toxicity.** Monitoring requirement only. Monitoring is required to determine if reasonable potential exists for this facility's discharge to exceed water quality standards.

The acute Allowable Effluent Concentration (AEC) is determined as follows:

$$\text{Acute AEC\%} = (((58.9 + 589) / 58.9)^{-1})100 = 9.1\%$$

The resulting dilution series is: 40%, 20%, 10%, 5%, and 2.5%.

- **Chronic Whole Effluent Toxicity.** Monitoring requirement only. Monitoring is required to determine if reasonable potential exists for this facility's discharge to exceed water quality standards.

The chronic Allowable Effluent Concentration (AEC) is determined as follows:

$$\text{Chronic AEC\%} = (((58.9 + 6,085) / 58.9)^{-1})100 = 1\%$$

The resulting dilution series is: 25%, 5%, 1%, 0.2%, and 0.04%.

**Parameters Removed.**

- **Cadmium, Chromium III, Chromium VI, and Lead.** Statistical analysis conducted showed no reasonable potential for a water quality standard excursion for these parameters. As these parameters had a monitoring only requirement in the previous permit and not effluent limitations, a determination has been made to remove the monitoring requirement. These parameters will still be tested as a part of the expanded effluent testing requirement upon the next permit renewal.
- **Chemical Oxygen Demand (COD).** COD monitoring is no longer needed to determine facility performance or compliance with water quality standards.
- **Total Hardness.** Total hardness monitoring of the effluent is no longer needed to determine effluent limits for metals.

**Sampling Frequency Justification:**

The sampling and reporting frequency for all parameters has been reassessed. Monitoring for nutrient parameters has been set at monthly frequencies to coincide with the Program for Voluntary Early Nutrient Monitoring as requested by the permittee. Acute WET testing shall be conducted annually and chronic WET testing shall be conducted no less than once per permit cycle for those facilities designated as majors. Ammonia and pH frequencies have been reduced to monthly due to consistent effluent results. All other frequencies have been determined to be appropriate; therefore, they have been retained from the previous permit.

**Sampling Type Justification:**

As per 10 CSR 20-7.015, CBOD<sub>5</sub>, TSS, and WET test samples collected for mechanical plants shall be a 24 hour composite sample. Grab samples, however, must be collected for pH, *E. coli*, Oil & Grease, and nutrient parameters. This is due to the holding time restriction for *E. coli* and the fact that pH cannot be preserved and must be sampled in the field. As Oil & Grease and nutrient samples must be immediately preserved, these samples are to be collected as a grab. Ammonia must also be immediately preserved but may be collected as composite as the permittee has an equipment setup to handle composite collections with immediate preservation.

**OUTFALL #006 – STORMWATER OUTFALL**

**Parameters Removed**

The previous permit established monitoring requirements for flow, precipitation, BOD<sub>5</sub>, pH, Oil & Grease, and Settleable Solids in Outfall #006. These parameters have all been removed from the permit and replaced with a requirement to develop and implement a Stormwater Pollution Prevention Plan (SWPPP). After reviewing the past five years of stormwater sampling data submitted by the permittee, the Department believes the requirements of developing and implementing a SWPPP will still be protective of water quality.



**OUTFALLS #006 AND #007 – GENERAL CRITERIA CONSIDERATIONS:**

In accordance with 40 CFR 122.44(d)(1), effluent limitations shall be placed into the permit for those pollutants which have been determined to cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality. The rule further states that pollutants which have been determined to cause, have the reasonable potential to cause, or contribute to an excursion above a narrative criterion within an applicable State water quality standard, the permit shall contain a numeric effluent limitation to protect that narrative criterion. In order to comply with this regulation, the permit writer will complete reasonable potential determinations on whether the discharge will violate any of the general criteria listed in 10 CSR 20-7.031(4). These specific requirements are listed below followed by derivation and discussion (the lettering matches that of the rule itself, under 10 CSR 20-7.031(4)). It should also be noted that Section 644.076.1, RSMo as well as Section D – Administrative Requirements of Standard Conditions Part I of this permit states that it shall be unlawful for any person to cause or permit any discharge of water contaminants from any water contaminant or point source located in Missouri that is in violation of sections 644.006 to 644.141 of the Missouri Clean Water Law or any standard, rule or regulation promulgated by the commission.

- (A) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses. The discharge from this facility is made up of treated domestic wastewater. No evidence of an excursion of this criterion has been observed by the Department in the past and the facility has not disclosed any other information related to the characteristics of the discharge on their permit application which has the potential to cause or contribute to an excursion of this narrative criterion. Additionally, this facility utilizes secondary treatment technology and is currently in compliance with secondary treatment technology based effluent limits established in this permit and there has been no indication to the Department that the stream has had issues maintaining beneficial uses as a result of this discharge. Based on the information reviewed during the drafting of this permit, these final effluent limitations appear to have protected against the excursion of this criterion in the past. Therefore, the discharge does not have the reasonable potential to cause or contribute to an excursion of this criterion.
- (B) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses. Please see (A) above as justification is the same.
- (C) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses. Please see (A) above as justification is the same.
- (D) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life. This permit contains final effluent limitations which are protective of both acute and chronic toxicity for various pollutants that are either expected to be discharged by domestic wastewater facilities or that were disclosed by this facility on the application for permit coverage. Based on the information reviewed during the drafting of this permit, it has been determined if the facility meets final effluent limitations established in this permit, there is no reasonable potential for the discharge to cause an excursion of this criterion.
- (E) There shall be no significant human health hazard from incidental contact with the water. Please see (D) above as justification is the same.
- (F) There shall be no acute toxicity to livestock or wildlife watering. Please see (D) above as justification is the same.
- (G) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community. Please see (A) above as justification is the same.
- (H) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247. The discharge from this facility is made up of treated domestic wastewater. No evidence of an excursion of this criterion has been observed by the Department in the past and the facility has not disclosed any other information related to the characteristics of the discharge on their permit application which has the potential to cause or contribute to an excursion of this narrative criterion. Additionally, any solid wastes received or produced at this facility are wholly contained in appropriate storage facilities, are not discharged, and are disposed of offsite. This discharge is subject to Standard Conditions Part III, which contains requirements for the management and disposal of sludge to prevent its discharge. Therefore, this discharge does not have reasonable potential to cause or contribute to an excursion of this criterion.

**Part VII – Cost Analysis for Compliance**

Pursuant to Section 644.145, RSMo, when issuing permits under this chapter that incorporate a new requirement for discharges from publicly owned combined or separate sanitary or storm sewer systems or publicly owned treatment works, or when enforcing provisions of this chapter or the Federal Water Pollution Control Act, 33 U.S.C. 1251 et seq., pertaining to any portion of a publicly owned combined or separate sanitary or storm sewer system or [publicly owned] treatment works, the Department of Natural Resources shall make a “finding of affordability” on the costs to be incurred and the impact of any rate changes on ratepayers upon which to base such permits and decisions, to the extent allowable under this chapter and the Federal Water Pollution Control Act. This process is completed through a cost analysis for compliance. Permits that do not include new requirements may be deemed affordable.

☒ - The permittee has waived the Cost Analysis for Compliance.

## **Part VIII – Administrative Requirements**

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

### **PERMIT SYNCHRONIZATION:**

The Department of Natural Resources is currently undergoing a synchronization process for operating permits. Permits are normally issued on a five-year term, but to achieve synchronization many permits will need to be issued for less than the full five years allowed by regulation. The intent is that all permits within a watershed will move through the Watershed Based Management (WBM) cycle together and all expire in the same fiscal year. This will allow further streamlining by placing multiple permits within a smaller geographic area on public notice simultaneously, thereby reducing repeated administrative efforts. This will also allow the Department to explore a watershed based permitting effort at some point in the future. The permits issued to the Metropolitan St. Louis Sewer District (MSD) will all be issued for a period of five years which does not follow this synchronization policy. The approach to synchronize MSD's permits together instead of by watershed is appropriate as it will allow for MSD to assess permit requirements more effectively.

### **PUBLIC NOTICE:**

The Department shall give public notice that a draft permit has been prepared and its issuance is pending. Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in and water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing. The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit. For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

☒ - The Public Notice period for this operating permit was from November 3, 2017 – December 4, 2017. Responses to the Public Notice of this operating permit did not warrant the modification of effluent limits and/or the terms and conditions of this permit.

**DATE OF FACT SHEET:** MAY 30, 2017

### **COMPLETED BY:**

**ANGELA FALLS, ENVIRONMENTAL SPECIALIST  
MISSOURI DEPARTMENT OF NATURAL RESOURCES  
WATER PROTECTION PROGRAM  
OPERATING PERMITS SECTION - DOMESTIC WASTEWATER UNIT  
(573) 751-1419  
angela.falls@dnr.mo.gov**

## Appendices

### APPENDIX - CLASSIFICATION WORKSHEET:

ITEM	POINTS POSSIBLE	POINTS ASSIGNED
Maximum Population Equivalent (P.E.) served (Max 10 pts.)	1 pt./10,000 PE or major fraction thereof.	10
Maximum: 10 pt Design Flow (avg. day) or peak month; use greater (Max 10 pts.)	1 pt. / MGD or major fraction thereof.	10
EFFLUENT DISCHARGE RECEIVING WATER SENSITIVITY:		
Missouri or Mississippi River	0	0
All other stream discharges except to losing streams and stream reaches supporting whole body contact	1	-
Discharge to lake or reservoir outside of designated whole body contact recreational area	2	-
Discharge to losing stream, or stream, lake or reservoir area supporting whole body contact recreation	3	-
PRELIMINARY TREATMENT – Headworks		
Screening and/or comminution	3	3
Grit removal	3	3
Plant pumping of main flow (lift station at the headworks)	3	3
PRIMARY TREATMENT		
Primary clarifiers	5	5
Combined sedimentation/digestion	5	-
Chemical addition (except chlorine, enzymes)	4	-
REQUIRED LABORATORY CONTROL – performed by plant personnel (highest level only)		
Push – button or visual methods for simple test such as pH, Settleable solids	3	3
Additional procedures such as DO, COD, BOD, titrations, solids, volatile content	5	-
More advanced determinations such as BOD seeding procedures, fecal coliform, nutrients, total oils, phenols, etc.	7	-
Highly sophisticated instrumentation, such as atomic absorption and gas chromatograph	10	-
ALTERNATIVE FATE OF EFFLUENT		
Direct reuse or recycle of effluent	6	-
Land Disposal – low rate	3	-
High rate	5	-
Overland flow	4	-
Total from page <b>ONE (1)</b>	----	37

**APPENDIX - CLASSIFICATION WORKSHEET (CONTINUED):**

ITEM	POINTS POSSIBLE	POINTS ASSIGNED
<b>VARIATION IN RAW WASTE (highest level only) (DMR exceedances and Design Flow exceedances)</b>		
Variation do not exceed those normally or typically expected	0	-
Recurring deviations or excessive variations of 100 to 200 % in strength and/or flow	2	2
Recurring deviations or excessive variations of more than 200 % in strength and/or flow	4	-
Raw wastes subject to toxic waste discharge	6	-
<b>SECONDARY TREATMENT</b>		
Trickling filter and other fixed film media with secondary clarifiers	10	-
Activated sludge with secondary clarifiers (including extended aeration and oxidation ditches)	15	15
Stabilization ponds without aeration	5	-
Aerated lagoon	8	-
Advanced Waste Treatment Polishing Pond	2	-
Chemical/physical – without secondary	15	-
Chemical/physical – following secondary	10	-
Biological or chemical/biological	12	-
Carbon regeneration	4	-
<b>DISINFECTION</b>		
Chlorination or comparable	5	-
Dechlorination	2	-
On-site generation of disinfectant (except UV light)	5	-
UV light	4	4
<b>SOLIDS HANDLING – SLUDGE</b>		
Solids Handling Thickening	5	5
Anaerobic digestion	10	10
Aerobic digestion	6	-
Evaporative sludge drying	2	-
Mechanical dewatering	8	8
Solids reduction (incineration, wet oxidation)	12	-
Land application	6	6
Total from page <b>TWO (2)</b>	----	50
Total from page <b>ONE (1)</b>	---	37
Grand Total	---	87

- ☒ - A: 71 points and greater  
☐ - B: 51 points – 70 points  
☐ - C: 26 points – 50 points  
☐ - D: 0 points – 25 points

**APPENDIX – RPA RESULTS:**

Parameter	CMC*	RWC Acute*	CCC*	RWC Chronic*	n**	Range max/min	CV***	MF	RP Yes/No
Total Ammonia as Nitrogen (Summer) mg/L	12.1	6.82	1.5	0.67	29.00	32.5/2	0.73	2.30	NO
Total Ammonia as Nitrogen (Winter) mg/L	12.1	5.90	3.1	0.58	30.00	33.6/2	0.56	1.93	NO
Cadmium, Total Recoverable	8.2	0.05	0.4	0.01	13.00	0.4/0.015	0.7	1.45	NO
Chromium III, Total Recoverable	All reported results were non-detects								NO
Chromium VI, Total Dissolved	All reported results were non-detects								NO
Lead, Total Recoverable	All reported results were non-detects								NO

N/A – Not Applicable

\* - Units are (µg/L) unless otherwise noted.

\*\* - If the number of samples is 10 or greater, then the CV value must be used in the WQBEL for the applicable constituent. If the number of samples is < 10, then the default CV value must be used in the WQBEL for the applicable constituent.

\*\*\* - Coefficient of Variation (CV) is calculated by dividing the Standard Deviation of the sample set by the Mean of the same sample set.

RWC – Receiving Water Concentration. It is the concentration of a toxicant or the parameter toxicity in the receiving water after mixing (if applicable).

n – Is the number of samples.

MF – Multiplying Factor. 99% Confidence Level and 99% Probability Basis.

RP – Reasonable Potential. It is where an effluent is projected or calculated to cause an excursion above a water quality standard based on a number of factors including, as a minimum, the four factors listed in 40 CFR 122.44(d)(1)(ii).

Reasonable Potential Analysis is conducted as per (TSD, EPA/505/2-90-001, Section 3.3.2). A more detailed version including calculations of this RPA is available upon request.


**APPENDIX – OUTFALL MAP:**





**APPENDIX – FACILITY LAYOUT:**

Six (6) fine bar screens / three (3) washer compactor units / four (4) grit removal chambers / four (4) peak flow storage basins / four (4) pre-aeration basins / four (4) primary clarifiers / six (6) cell equalization tank / six (6) aeration tanks / six (6) final clarifiers / UV disinfection / four (4) rotary drum thickeners / five (5) anaerobic sludge digesters / three (3) sludge centrifuges / two (2) sludge storage silos / sludge is hauled for subsequent land application, composting, incineration, or landfilling.

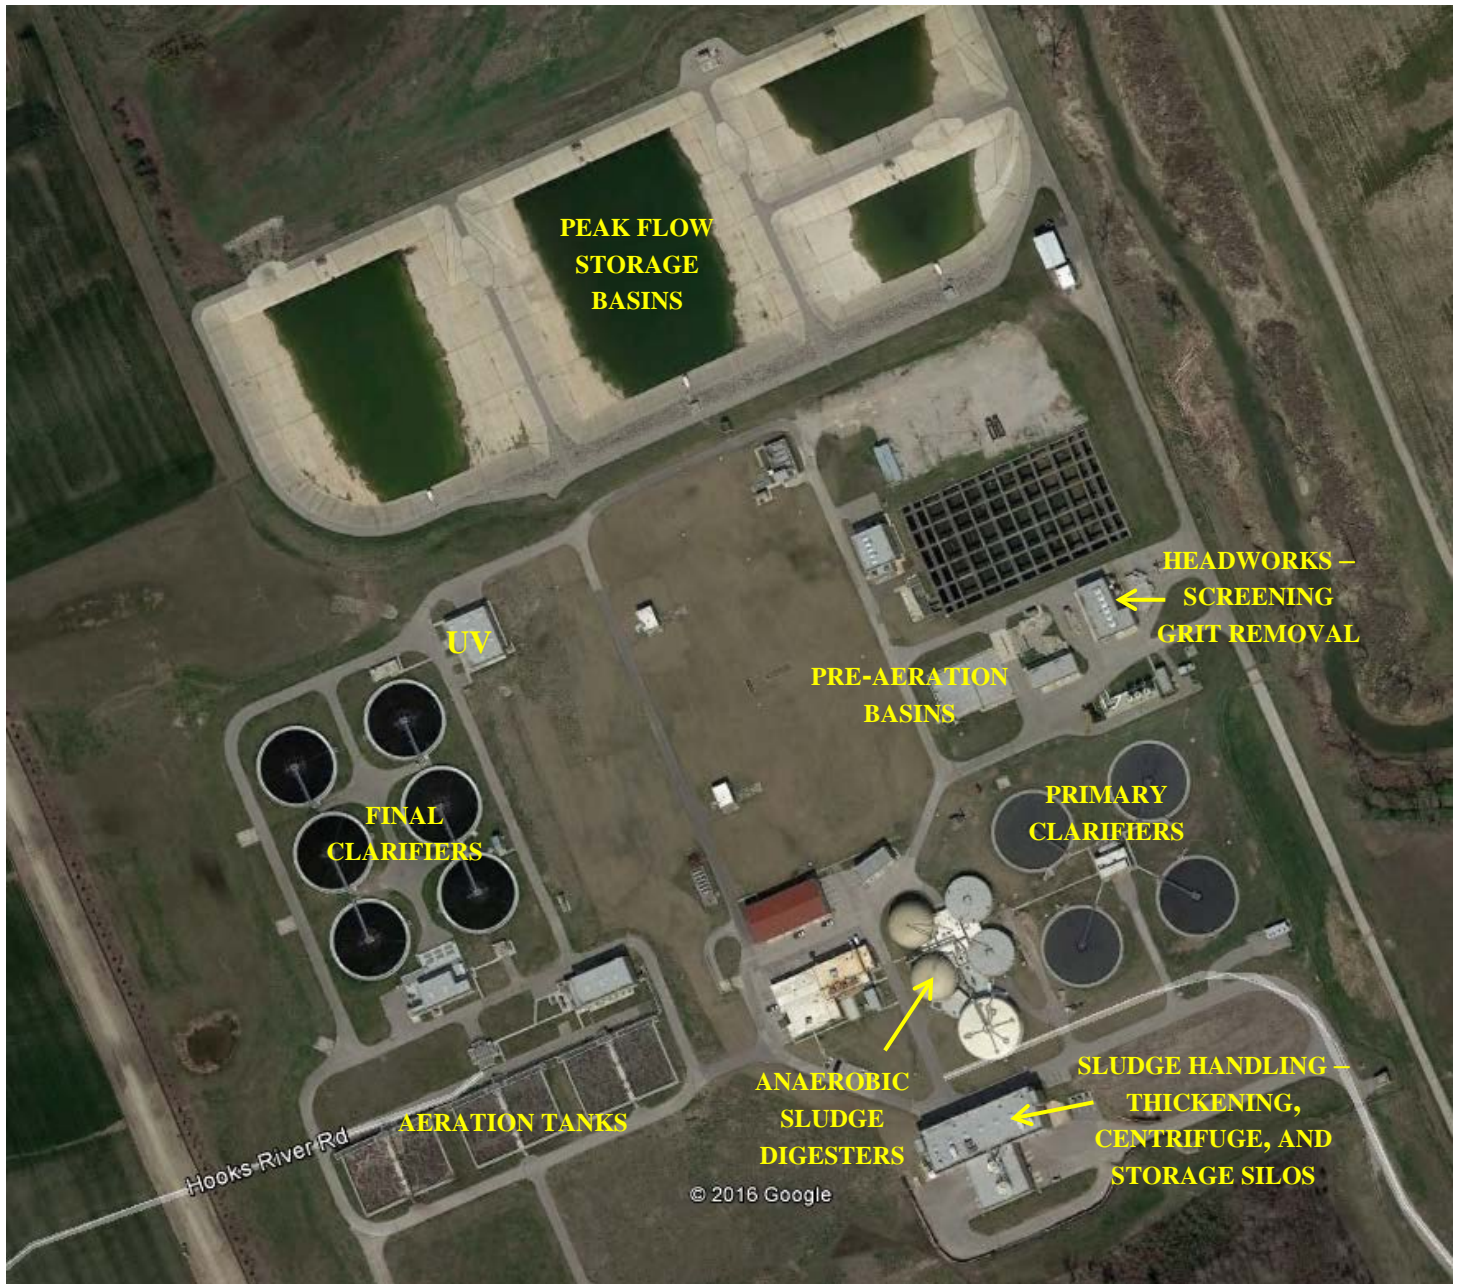



STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

These Standard Conditions incorporate permit conditions as required by 40 CFR 122.41 or other applicable state statutes or regulations. These minimum conditions apply unless superseded by requirements specified in the permit.

## Part I – General Conditions

### Section A – Sampling, Monitoring, and Recording

1. **Sampling Requirements.**
  - a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
  - b. All samples shall be taken at the outfall(s) or Missouri Department of Natural Resources (Department) approved sampling location(s), and unless specified, before the effluent joins or is diluted by any other body of water or substance.
2. **Monitoring Requirements.**
  - a. Records of monitoring information shall include:
    - i. The date, exact place, and time of sampling or measurements;
    - ii. The individual(s) who performed the sampling or measurements;
    - iii. The date(s) analyses were performed;
    - iv. The individual(s) who performed the analyses;
    - v. The analytical techniques or methods used; and
    - vi. The results of such analyses.
  - b. If the permittee monitors any pollutant more frequently than required by the permit at the location specified in the permit using test procedures approved under 40 CFR Part 136, or another method required for an industry-specific waste stream under 40 CFR subchapters N or O, the results of such monitoring shall be included in the calculation and reported to the Department with the discharge monitoring report data (DMR) submitted to the Department pursuant to Section B, paragraph 7.
3. **Sample and Monitoring Calculations.** Calculations for all sample and monitoring results which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in the permit.
4. **Test Procedures.** The analytical and sampling methods used shall conform to the reference methods listed in 10 CSR 20-7.015 unless alternates are approved by the Department. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. The facility shall ensure that the selected methods are able to quantify the presence of pollutants in a given discharge at concentrations that are low enough to determine compliance with Water Quality Standards in 10 CSR 20-7.031 or effluent limitations unless provisions in the permit allow for other alternatives. A method is “sufficiently sensitive” when; 1) the method minimum level is at or below the level of the applicable water quality criterion for the pollutant or, 2) the method minimum level is above the applicable water quality criterion, but the amount of pollutant in a facility’s discharge is high enough that the method detects and quantifies the level of pollutant in the discharge, or 3) the method has the lowest minimum level of the analytical methods approved under 10 CSR 20-7.015. These methods are also required for parameters that are listed as monitoring only, as the data collected may be used to determine if limitations need to be established. A permittee is responsible for working with their contractors to ensure that the analysis performed is sufficiently sensitive.
5. **Record Retention.** Except for records of monitoring information required by the permit related to the permittee’s sewage sludge use and disposal activities, which shall be retained for a period of at least five (5) years (or longer as required by 40 CFR part 503), the permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the application for the permit, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.

6. **Illegal Activities.**
  - a. The Federal Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under the permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than two (2) years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than four (4) years, or both.
  - b. The Missouri Clean Water Law provides that any person or who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than six (6) months, or by both. Second and successive convictions for violation under this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.

### Section B – Reporting Requirements

1. **Planned Changes.**
  - a. The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility when:
    - i. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b); or
    - ii. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in the permit, nor to notification requirements under 40 CFR 122.42;
    - iii. The alteration or addition results in a significant change in the permittee’s sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan;
    - iv. Any facility expansions, production increases, or process modifications which will result in a new or substantially different discharge or sludge characteristics must be reported to the Department 60 days before the facility or process modification begins. Notification may be accomplished by application for a new permit. If the discharge does not violate effluent limitations specified in the permit, the facility is to submit a notice to the Department of the changed discharge at least 30 days before such changes. The Department may require a construction permit and/or permit modification as a result of the proposed changes at the facility.
2. **Non-compliance Reporting.**
  - a. The permittee shall report any noncompliance which may endanger health or the environment. Relevant information shall be provided orally or via the current electronic method approved by the Department, within 24 hours from the time the permittee becomes aware of the circumstances, and shall be reported to the appropriate Regional Office during normal business hours or the Environmental Emergency Response hotline at 573-634-2436 outside of normal business hours. A written submission shall also be provided within five (5) business days of the time the permittee becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.





STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

- b. The following shall be included as information which must be reported within 24 hours under this paragraph.
    - i. Any unanticipated bypass which exceeds any effluent limitation in the permit.
    - ii. Any upset which exceeds any effluent limitation in the permit.
    - iii. Violation of a maximum daily discharge limitation for any of the pollutants listed by the Department in the permit required to be reported within 24 hours.
  - c. The Department may waive the written report on a case-by-case basis for reports under paragraph 2. b. of this section if the oral report has been received within 24 hours.
3. **Anticipated Noncompliance.** The permittee shall give advance notice to the Department of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements. The notice shall be submitted to the Department 60 days prior to such changes or activity.
  4. **Compliance Schedules.** Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of the permit shall be submitted no later than 14 days following each schedule date. The report shall provide an explanation for the instance of noncompliance and a proposed schedule or anticipated date, for achieving compliance with the compliance schedule requirement.
  5. **Other Noncompliance.** The permittee shall report all instances of noncompliance not reported under paragraphs 2, 3, and 6 of this section, at the time monitoring reports are submitted. The reports shall contain the information listed in paragraph 2. a. of this section.
  6. **Other Information.** Where the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Department, it shall promptly submit such facts or information.
  7. **Discharge Monitoring Reports.**
    - a. Monitoring results shall be reported at the intervals specified in the permit.
    - b. Monitoring results must be reported to the Department via the current method approved by the Department, unless the permittee has been granted a waiver from using the method. If the permittee has been granted a waiver, the permittee must use forms provided by the Department.
    - c. Monitoring results shall be reported to the Department no later than the 28<sup>th</sup> day of the month following the end of the reporting period.
- b. Notice.
    - i. Anticipated bypass. If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible at least 10 days before the date of the bypass.
    - ii. Unanticipated bypass. The permittee shall submit notice of an unanticipated bypass as required in Section B – Reporting Requirements, paragraph 5 (24-hour notice).
  - c. Prohibition of bypass.
    - i. Bypass is prohibited, and the Department may take enforcement action against a permittee for bypass, unless:
      1. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
      2. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and
      3. The permittee submitted notices as required under paragraph 2. b. of this section.
    - ii. The Department may approve an anticipated bypass, after considering its adverse effects, if the Department determines that it will meet the three (3) conditions listed above in paragraph 2. c. i. of this section.
3. **Upset Requirements.**
    - a. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of paragraph 3. b. of this section are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review.
    - b. Conditions necessary for a demonstration of upset. A permittee who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:
      - i. An upset occurred and that the permittee can identify the cause(s) of the upset;
      - ii. The permitted facility was at the time being properly operated; and
      - iii. The permittee submitted notice of the upset as required in Section B – Reporting Requirements, paragraph 2. b. ii. (24-hour notice).
      - iv. The permittee complied with any remedial measures required under Section D – Administrative Requirements, paragraph 4.
    - c. Burden of proof. In any enforcement proceeding, the permittee seeking to establish the occurrence of an upset has the burden of proof.

## Section C – Bypass/Upset Requirements

1. **Definitions.**
  - a. *Bypass*: the intentional diversion of waste streams from any portion of a treatment facility, except in the case of blending.
  - b. *Severe Property Damage*: substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
  - c. *Upset*: an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
2. **Bypass Requirements.**
  - a. Bypass not exceeding limitations. The permittee may allow any bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of paragraphs 2. b. and 2. c. of this section.

## Section D – Administrative Requirements

1. **Duty to Comply.** The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the Missouri Clean Water Law and Federal Clean Water Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application.
  - a. The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
  - b. The Federal Clean Water Act provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The Federal Clean Water Act provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement





STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

- imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the CWA, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions.
- c. Any person may be assessed an administrative penalty by the EPA Director for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000.
- d. It is unlawful for any person to cause or permit any discharge of water contaminants from any water contaminant or point source located in Missouri in violation of sections 644.006 to 644.141 of the Missouri Clean Water Law, or any standard, rule or regulation promulgated by the commission. In the event the commission or the director determines that any provision of sections 644.006 to 644.141 of the Missouri Clean Water Law or standard, rules, limitations or regulations promulgated pursuant thereto, or permits issued by, or any final abatement order, other order, or determination made by the commission or the director, or any filing requirement pursuant to sections 644.006 to 644.141 of the Missouri Clean Water Law or any other provision which this state is required to enforce pursuant to any federal water pollution control act, is being, was, or is in imminent danger of being violated, the commission or director may cause to have instituted a civil action in any court of competent jurisdiction for the injunctive relief to prevent any such violation or further violation or for the assessment of a penalty not to exceed \$10,000 per day for each day, or part thereof, the violation occurred and continues to occur, or both, as the court deems proper. Any person who willfully or negligently commits any violation in this paragraph shall, upon conviction, be punished by a fine of not less than \$2,500 nor more than \$25,000 per day of violation, or by imprisonment for not more than one year, or both. Second and successive convictions for violation of the same provision of this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.
2. **Duty to Reapply.**
- a. If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for and obtain a new permit.
- b. A permittee with a currently effective site-specific permit shall submit an application for renewal at least 180 days before the expiration date of the existing permit, unless permission for a later date has been granted by the Department. (The Department shall not grant permission for applications to be submitted later than the expiration date of the existing permit.)
- c. A permittee with currently effective general permit shall submit an application for renewal at least 30 days before the existing permit expires, unless the permittee has been notified by the Department that an earlier application must be made. The Department may grant permission for a later submission date. (The Department shall not grant permission for applications to be submitted later than the expiration date of the existing permit.)
3. **Need to Halt or Reduce Activity Not a Defense.** It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.
4. **Duty to Mitigate.** The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment.
5. **Proper Operation and Maintenance.** The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems which are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit.
6. **Permit Actions.**
- a. Subject to compliance with statutory requirements of the Law and Regulations and applicable Court Order, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to, the following:
- i. Violations of any terms or conditions of this permit or the law;
- ii. Having obtained this permit by misrepresentation or failure to disclose fully any relevant facts;
- iii. A change in any circumstances or conditions that requires either a temporary or permanent reduction or elimination of the authorized discharge; or
- iv. Any reason set forth in the Law or Regulations.
- b. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition.
7. **Permit Transfer.**
- a. Subject to 10 CSR 20-6.010, an operating permit may be transferred upon submission to the Department of an application to transfer signed by the existing owner and the new owner, unless prohibited by the terms of the permit. Until such time the permit is officially transferred, the original permittee remains responsible for complying with the terms and conditions of the existing permit.
- b. The Department may require modification or revocation and reissuance of the permit to change the name of the permittee and incorporate such other requirements as may be necessary under the Missouri Clean Water Law or the Federal Clean Water Act.
- c. The Department, within 30 days of receipt of the application, shall notify the new permittee of its intent to revoke or reissue or transfer the permit.
8. **Toxic Pollutants.** The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the Federal Clean Water Act within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
9. **Property Rights.** This permit does not convey any property rights of any sort, or any exclusive privilege.



STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

10. **Duty to Provide Information.** The permittee shall furnish to the Department, within a reasonable time, any information which the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit or to determine compliance with this permit. The permittee shall also furnish to the Department upon request, copies of records required to be kept by this permit.
11. **Inspection and Entry.** The permittee shall allow the Department, or an authorized representative (including an authorized contractor acting as a representative of the Department), upon presentation of credentials and other documents as may be required by law, to:
  - a. Enter upon the permittee's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of the permit;
  - b. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit;
  - c. Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this permit; and
  - d. Sample or monitor at reasonable times, for the purposes of assuring permit compliance or as otherwise authorized by the Federal Clean Water Act or Missouri Clean Water Law, any substances or parameters at any location.
12. **Closure of Treatment Facilities.**
  - a. Persons who cease operation or plan to cease operation of waste, wastewater, and sludge handling and treatment facilities shall close the facilities in accordance with a closure plan approved by the Department.
  - b. Operating Permits under 10 CSR 20-6.010 or under 10 CSR 20-6.015 are required until all waste, wastewater, and sludges have been disposed of in accordance with the closure plan approved by the Department and any disturbed areas have been properly stabilized. Disturbed areas will be considered stabilized when perennial vegetation, pavement, or structures using permanent materials cover all areas that have been disturbed. Vegetative cover, if used, shall be at least 70% plant density over 100% of the disturbed area.
13. **Signatory Requirement.**
  - a. All permit applications, reports required by the permit, or information requested by the Department shall be signed and certified. (See 40 CFR 122.22 and 10 CSR 20-6.010)
  - b. The Federal Clean Water Act provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or non-compliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six (6) months per violation, or by both.
  - c. The Missouri Clean Water Law provides that any person who knowingly makes any false statement, representation or certification in any application, record, report, plan, or other document filed or required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than ten thousand dollars, or by imprisonment for not more than six months, or by both.
14. **Severability.** The provisions of the permit are severable, and if any provision of the permit, or the application of any provision of the permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of the permit, shall not be affected thereby.



STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
MAY 1, 2013

PART II - SPECIAL CONDITIONS – PUBLICLY OWNED  
TREATMENT WORKS  
SECTION A – INDUSTRIAL USERS

**1. Definitions**

Definitions as set forth in the Missouri Clean Water Laws and approved by the Missouri Clean Water Commission shall apply to terms used herein.

Significant Industrial User (SIU). Except as provided in the *General Pretreatment Regulation* 10 CSR 20-6.100, the term Significant Industrial User means:

1. All Industrial Users subject to Categorical Pretreatment Standards; and
2. Any other Industrial User that: discharges an average of 25,000 gallons per day or more of process wastewater to the Publicly-Owned Treatment Works (POTW) (excluding sanitary, noncontact cooling and boiler blowdown wastewater); contributes a process wastestream which makes up 5 percent or more of the average dry weather hydraulic or organic capacity of the POTW treatment plant; or is designated as such by the Control Authority on the basis that the Industrial User has a reasonable potential for adversely affecting the POTW's or for violating any Pretreatment Standard or requirement.

Clean Water Act (CWA) is the the federal Clean Water Act of 1972, 33 U.S.C. § 1251 et seq. (2002).

**2. Identification of Industrial Discharges**

Pursuant to 40 CFR 122.44(j)(1), all POTWs shall identify, in terms of character and volume of pollutants, any Significant Industrial Users discharging to the POTW subject to Pretreatment Standards under section 307(b) of the CWA and 40 CFR 403.

**3. Application Information**

Applications for renewal or modification of this permit must contain the information about industrial discharges to the POTW pursuant to 40 CFR 122.21(j)(6)

**4. Notice to the Department**

Pursuant to 40 CFR 122.42(b), all POTWs must provide adequate notice of the following:

1. Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to section 301 or 306 of CWA if it were directly discharging these pollutants; and
2. Any substantial change into the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit.
3. For purposes of this paragraph, adequate notice shall include information on:
  - i. the quality and quantity of effluent introduced into the POTW, and
  - ii. any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

For POTWs without an approved pretreatment program, the notice of industrial discharges which was not included in the permit application shall be made as soon as practicable. For POTWs with an approved pretreatment program, notice is to be included in the annual pretreatment report required in the special conditions of this permit. Notice may be sent to:

Missouri Department of Natural Resources  
Water Protection Program  
Attn: Pretreatment Coordinator  
P.O. Box 176  
Jefferson City, MO 65102

**STANDARD CONDITIONS FOR NPDES PERMITS**  
**ISSUED BY**  
**THE MISSOURI DEPARTMENT OF NATURAL RESOURCES**  
**MISSOURI CLEAN WATER COMMISSION**  
**March 1, 2015**

**PART III – SLUDGE AND BIOSOLIDS FROM DOMESTIC AND INDUSTRIAL WASTEWATER  
TREATMENT FACILITIES**

**SECTION A – GENERAL REQUIREMENTS**

1. This permit pertains to sludge requirements under the Missouri Clean Water Law and regulation for domestic wastewater and industrial process wastewater. This permit also incorporates applicable federal sludge disposal requirements under 40 CFR 503 for domestic wastewater. The Environmental Protection Agency (EPA) has principal authority for permitting and enforcement of the federal sludge regulations under 40 CFR 503 for domestic wastewater. EPA has reviewed and accepted these standard sludge conditions. EPA may choose to issue a separate sludge addendum to this permit or a separate federal sludge permit at their discretion to further address the federal requirements.
2. These PART III Standard Conditions apply only to sludge and biosolids generated at domestic wastewater treatment facilities, including public owned treatment works (POTW), privately owned facilities and sludge or biosolids generated at industrial facilities.
3. Sludge and Biosolids Use and Disposal Practices:
  - a. The permittee is authorized to operate the sludge and biosolids treatment, storage, use, and disposal facilities listed in the facility description of this permit.
  - b. The permittee shall not exceed the design sludge volume listed in the facility description and shall not use sludge disposal methods that are not listed in the facility description, without prior approval of the permitting authority.
  - c. The permittee is authorized to operate the storage, treatment or generating sites listed in the Facility Description section of this permit.
4. Sludge Received from other Facilities:
  - a. Permittees may accept domestic wastewater sludge from other facilities including septic tank pumpings from residential sources as long as the design sludge volume is not exceeded and the treatment facility performance is not impaired.
  - b. The permittee shall obtain a signed statement from the sludge generator or hauler that certifies the type and source of the sludge
5. These permit requirements do not supersede nor remove liability for compliance with county and other local ordinances.
6. These permit requirements do not supersede nor remove liability for compliance with other environmental regulations such as odor emissions under the Missouri Air Pollution Control Law and regulations.
7. This permit may (after due process) be modified, or alternatively revoked and reissued, to comply with any applicable sludge disposal standard or limitation issued or approved under Section 405(d) of the Clean Water Act under Chapter 644 RSMo.
8. In addition to STANDARD CONDITIONS, the Department may include sludge limitations in the special conditions portion or other sections of a site specific permit.
9. Alternate Limits in the Site Specific Permit.

Where deemed appropriate, the Department may require an individual site specific permit in order to authorize alternate limitations:

  - a. A site specific permit must be obtained for each operating location, including application sites.
  - b. To request a site specific permit, an individual permit application, permit fee, and supporting documents shall be submitted for each operating location. This shall include a detailed sludge/biosolids management plan or engineering report.
10. Exceptions to these Standard Conditions may be authorized on a case-by-case basis by the Department, as follows:
  - a. The Department will prepare a permit modification and follow permit notice provisions as applicable under 10 CSR 20-6.020, 40 CFR 124.10, and 40 CFR 501.15(a)(2)(ix)(E). This includes notification of the owner of the property located adjacent to each land application site, where appropriate.
  - b. Exceptions cannot be granted where prohibited by the federal sludge regulations under 40 CFR 503.

## **SECTION B – DEFINITIONS**

1. Best Management Practices include agronomic loading rates, soil conservation practices and other site restrictions.
2. Biosolids means organic fertilizer or soil amendment produced by the treatment of domestic wastewater sludge.
3. Biosolids land application facility is a facility where biosolids are spread onto the land at agronomic rates for production of food or fiber. The facility includes any structures necessary to store the biosolids until soil, weather, and crop conditions are favorable for land application.
4. Class A biosolids means a material that has met the Class A pathogen reduction requirements or equivalent treatment by a Process to Further Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
5. Class B biosolids means a material that has met the Class B pathogen reduction requirements or equivalent treatment by a Process to Significantly Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
6. Domestic wastewater means wastewater originating from the sanitary conveniences of residences, commercial buildings, factories and institutions; or co-mingled sanitary and industrial wastewater processed by a (POTW) or a privately owned facility.
7. Industrial wastewater means any wastewater, also known as process water, not defined as domestic wastewater. Per 40 CFR Part 122, process water means any water which, during manufacturing or processing, comes into direct contact with or results from the production or use of any raw material, intermediate product, finished product, byproduct, or waste product.
8. Mechanical treatment plants are wastewater treatment facilities that use mechanical devices to treat wastewater, including septic tanks, sand filters, extended aeration, activated sludge, contact stabilization, trickling filters, rotating biological discs, and other similar facilities. It does not include wastewater treatment lagoons and constructed wetlands for wastewater treatment.
9. Operating location as defined in 10 CSR 20-2.010 is all contiguous lands owned, operated or controlled by one (1) person or by two (2) or more persons jointly or as tenants in common.
10. Plant Available Nitrogen (PAN) is the nitrogen that will be available to plants during the growing seasons after biosolids application.
11. Public contact site is land with a high potential for contact by the public. This includes, but is not limited to, public parks, ball fields, cemeteries, plant nurseries, turf farms, and golf courses.
12. Sludge is the solid, semisolid, or liquid residue removed during the treatment of wastewater. Sludge includes septage removed from septic tanks or equivalent facilities. Sludge does not include carbon coal byproducts (CCBs)
13. Sludge lagoon is part of a mechanical wastewater treatment facility. A sludge lagoon is an earthen basin that receives sludge that has been removed from a wastewater treatment facility. It does not include a wastewater treatment lagoon or sludge treatment units that are not a part of a mechanical wastewater treatment facility.
14. Septage is the material pumped from residential septic tanks and similar treatment works (with a design population of less than 150 people). The standard for biosolids from septage is different from other sludges.

## **SECTION C – MECHANICAL WASTEWATER TREATMENT FACILITIES**

1. Sludge shall be routinely removed from wastewater treatment facilities and handled according to the permit facility description and sludge conditions of this permit.
2. The permittee shall operate the facility so that there is no sludge discharged to waters of the state.
3. Mechanical treatment plants shall have separate sludge storage compartments in accordance with 10 CSR 20, Chapter 8. Failure to remove sludge from these storage compartments on the required design schedule is a violation of this permit.

## **SECTION D – SLUDGE DISPOSED AT OTHER TREATMENT FACILITY OR CONTRACT HAULER**

1. This section applies to permittees that haul sludge to another treatment facility for disposal or use contract haulers to remove and dispose of sludge.
2. Permittees that use contract haulers are responsible for compliance with all the terms of this permit including final disposal, unless the hauler has a separate permit for sludge or biosolids disposal issued by the Department; or the hauler transports the sludge to another permitted treatment facility.
3. Haulers who land apply septage must obtain a state permit.
4. Testing of sludge, other than total solids content, is not required if sludge is hauled to a municipal wastewater treatment facility or other permitted wastewater treatment facility, unless it is required by the accepting facility.

## **SECTION E – INCINERATION OF SLUDGE**

1. Sludge incineration facilities shall comply with the requirements of 40 CFR 503 Subpart E; air pollution control regulations under 10 CSR 10; and solid waste management regulations under 10 CSR 80.
2. Permittee may be authorized under the facility description of this permit to store incineration ash in lagoons or ash ponds. This permit does not authorize the disposal of incineration ash. Incineration ash shall be disposed in accordance with 10 CSR 80; or if the ash is determined to be hazardous with 10 CSR 25.
3. In addition to normal sludge monitoring, incineration facilities shall report the following as part of the annual report, quantity of sludge incinerated, quantity of ash generated, quantity of ash stored, and ash used or disposal method, quantity, and location. Permittee shall also provide the name of the disposal facility and the applicable permit number.

## **SECTION F – SURFACE DISPOSAL SITES AND SLUDGE LAGOONS**

1. Surface disposal sites of domestic facilities shall comply with the requirements in 40 CFR 503 Subpart C; air pollution control regulations under 10 CSR 10; and solid waste management regulations under 10 CSR 80.
2. Sludge storage lagoons are temporary facilities and are not required to obtain a permit as a solid waste management facility under 10 CSR 80. In order to maintain sludge storage lagoons as storage facilities, accumulated sludge must be removed routinely, but not less than once every two years unless an alternate schedule is approved in the permit. The amount of sludge removed will be dependent on sludge generation and accumulation in the facility. Enough sludge must be removed to maintain adequate storage capacity in the facility.
  - a. In order to avoid damage to the lagoon seal during cleaning, the permittee may leave a layer of sludge on the bottom of the lagoon, upon prior approval of the Department; or
  - b. Permittee shall close the lagoon in accordance with Section H.

## **SECTION G – LAND APPLICATION**

1. The permittee shall not land apply sludge or biosolids unless land application is authorized in the facility description or the special conditions of the issued NPDES permit.
2. Land application sites within a 20 miles radius of the wastewater treatment facility are authorized under this permit when biosolids are applied for beneficial use in accordance with these standard conditions unless otherwise specified in a site specific permit. If the permittee's land application site is greater than a 20 mile radius of the wastewater treatment facility, approval must be granted from the Department.
3. Land application shall not adversely affect a threatened or endangered species or its designated critical habitat.
4. Biosolids shall not be applied unless authorized in this permit or exempted under 10 CSR 20, Chapter 6.
  - a. This permit does not authorize the land application of domestic sludge except for when sludge meets the definition of biosolids.
  - b. This permit authorizes "Class A or B" biosolids derived from domestic wastewater and/or process water sludge to be land applied onto grass land, crop land, timber or other similar agricultural or silviculture lands at rates suitable for beneficial use as organic fertilizer and soil conditioner.
5. Public Contact Sites:

Permittees who wish to apply Class A biosolids to public contact sites must obtain approval from the Department after two years of proper operation with acceptable testing documentation that shows the biosolids meet Class A criteria. A shorter length of testing will be allowed with prior approval from the Department. Authorization for land applications must be provided in the special conditions section of this permit or in a separate site specific permit.

  - a. After Class B biosolids have been land applied, public access must be restricted for 12 months.
  - b. Class B biosolids are only land applied to root crops, home gardens or vegetable crops whose edible parts will not be for human consumption.
6. Agricultural and Silvicultural Sites:

Septage – Based on Water Quality guide 422 (WQ422) published by the University of Missouri

  - a. Haulers that land apply septage must obtain a state permit
  - b. Do not apply more than 30,000 gallons of septage per acre per year.
  - c. Septage tanks are designed to retain sludge for one to three years which will allow for a larger reduction in pathogens and vectors, as compared to other mechanical type treatment facilities.
  - d. To meet Class B sludge requirements, maintain septage at 12 pH for at least thirty (30) minutes before land application. 50 pounds of hydrated lime shall be added to each 1,000 gallons of septage in order to meet pathogen and vector stabilization for septage biosolids applied to crops, pastures or timberland.
  - e. Lime is to be added to the pump truck and not directly to the septic tanks, as lime would harm the beneficial bacteria of the septic tank.

Biosolids - Based on Water Quality guide 423, 424, and 425 (WQ423, WQ424, WQ425) published by the University of Missouri;

- a. Biosolids shall be monitored to determine the quality for regulated pollutants
- b. The number of samples taken is directly related to the amount of sludge produced by the facility (See Section I of these Standard Conditions). Report as dry weight unless otherwise specified in the site specific permit. Samples should be taken only during land application periods. When necessary, it is permissible to mix biosolids with lower concentrations of biosolids as well as other suitable Department approved material to reach the maximum concentration of pollutants allowed.
- c. Table 1 gives the maximum concentration allowable to protect water quality standards

**TABLE 1**

Biosolids ceiling concentration <sup>1</sup>	
Pollutant	Milligrams per kilogram dry weight
Arsenic	75
Cadmium	85
Copper	4,300
Lead	840
Mercury	57
Molybdenum	75
Nickel	420
Selenium	100
Zinc	7,500

<sup>1</sup> Land application is not allowed if the sludge concentration exceeds the maximum limits for any of these pollutants

- d. The low metal concentration biosolids has reduced requirements because of its higher quality and can safely be applied for 100 years or longer at typical agronomic loading rates. (See Table 2)

**TABLE 2**

Biosolids Low Metal Concentration <sup>1</sup>	
Pollutant	Milligrams per kilogram dry weight
Arsenic	41
Cadmium	39
Copper	1,500
Lead	300
Mercury	17
Nickel	420
Selenium	36
Zinc	2,800

<sup>1</sup> You may apply low metal biosolids without tracking cumulative metal limits, provided the cumulative application of biosolids does not exceed 500 dry tons per acre.

- e. Each pollutant in Table 3 has an annual and a total cumulative loading limit, based on the allowable pounds per acre for various soil categories.

**TABLE 3**

Pollutant	CEC 15+		CEC 5 to 15		CEC 0 to 5	
	Annual	Total <sup>1</sup>	Annual	Total <sup>1</sup>	Annual	Total <sup>1</sup>
Arsenic	1.8	36.0	1.8	36.0	1.8	36.0
Cadmium	1.7	35.0	0.9	9.0	0.4	4.5
Copper	66.0	1,335.0	25.0	250.0	12.0	125.0
Lead	13.0	267.0	13.0	267.0	13.0	133.0
Mercury	0.7	15.0	0.7	15.0	0.7	15.0
Nickel	19.0	347.0	19.0	250.0	12.0	125.0
Selenium	4.5	89.0	4.5	44.0	1.6	16.0
Zinc	124.0	2,492.0	50.0	500.0	25.0	250.0

<sup>1</sup> Total cumulative loading limits for soils with equal or greater than 6.0 pH (salt based test) or 6.5 pH (water based test)

**TABLE 4** - Guidelines for land application of other trace substances <sup>1</sup>

Cumulative Loading	
Pollutant	Pounds per acre
Aluminum	4,000 <sup>2</sup>
Beryllium	100
Cobalt	50
Fluoride	800
Manganese	500
Silver	200
Tin	1,000
Dioxin	(10 ppt in soil) <sup>3</sup>
Other	<sup>4</sup>

<sup>1</sup> Design of land treatment systems for Industrial Waste, 1979. Michael Ray Overcash, North Carolina State University and Land Treatment of Municipal Wastewater, EPA 1981.)

<sup>2</sup> This applies for a soil with a pH between 6.0 and 7.0 (salt based test) or a pH between 6.5 to 7.5 (water based test). Case-by-case review is required for higher pH soils.

<sup>3</sup> Total Dioxin Toxicity Equivalents (TEQ) in soils, based on a risk assessment under 40 CFR 744, May 1998.

<sup>4</sup> Case by case review. Concentrations in sludge should not exceed the 95<sup>th</sup> percentile of the National Sewage Sludge Survey, EPA, January 2009.

Best Management Practices – Based on Water Quality guide 426 (WQ426) published by the University of Missouri

- a. Use best management practices when applying biosolids.
- b. Biosolids cannot discharge from the land application site
- c. Biosolid application is subject to the Missouri Department of Agriculture State Milk Board concerning grazing restrictions of lactating dairy cattle.
- d. Biosolid application must be in accordance with section 4 of the Endangered Species Act.
- e. Do not apply more than the agronomic rate of nitrogen needed.
- f. The applicator must document the Plant Available Nitrogen (PAN) loadings, available nitrogen in the soil, and crop removal when either of the following occurs: 1) When biosolids are greater than 50,000 mg/kg TN; or 2) When biosolids are land applied at an application rate greater than two dry tons per acre per year.
  - i. PAN can be determined as follows and is in accordance with WQ426  
(Nitrate + nitrite nitrogen) + (organic nitrogen x 0.2) + (ammonia nitrogen x volatilization factor<sup>1</sup>).
- <sup>1</sup> Volatilization factor is 0.7 for surface application and 1 for subsurface application.
- g. Buffer zones are as follows:
  - i. 300 feet of a water supply well, sinkhole, lake, pond, water supply reservoir or water supply intake in a stream;
  - ii. 300 feet of a losing stream, no discharge stream, stream stretches designated for whole body contact recreation, wild and scenic rivers, Ozark National Scenic Riverways or outstanding state resource waters as listed in the Water Quality Standards, 10 CSR 20-7.031;
  - iii. 150 feet if dwellings;
  - iv. 100 feet of wetlands or permanent flowing streams;
  - v. 50 feet of a property line or other waters of the state, including intermittent flowing streams.
- h. Slope limitation for application sites are as follows;
  - i. A slope 0 to 6 percent has no rate limitation
  - ii. Applied to a slope 7 to 12 percent, the applicator may apply biosolids when soil conservation practices are used to meet the minimum erosion levels
  - iii. Slopes > 12 percent, apply biosolids only when grass is vegetated and maintained with at least 80 percent ground cover at a rate of two dry tons per acre per year or less.
- i. No biosolids may be land applied in an area that it is reasonably certain that pollutants will be transported into waters of the state.
- j. Do not apply biosolids to sites with soil that is snow covered, frozen or saturated with liquid without prior approval by the Department.
- k. Biosolids / sludge applicators must keep detailed records up to five years.



## SECTION H – CLOSURE REQUIREMENTS

1. This section applies to all wastewater facilities (mechanical, industrial, and lagoons) and sludge or biosolids storage and treatment facilities and incineration ash ponds. It does not apply to land application sites.
2. Permittees of a domestic wastewater facility who plan to cease operation must obtain Department approval of a closure plan which addresses proper removal and disposal of all residues, including sludge, biosolids. Mechanical plants, sludge lagoons, ash ponds and other storage structures must obtain approval of a closure plan from the Department. Permittee must maintain this permit until the facility is closed in accordance with the approved closure plan per 10 CSR 20 – 6. 010 and 10 CSR 20 – 6.015.
3. Residuals that are left in place during closure of a lagoon or earthen structure or ash pond shall not exceed the agricultural loading rates as follows:
  - a. Residuals shall meet the monitoring and land application limits for agricultural rates as referenced in Section H of these standard conditions.
  - b. If a wastewater treatment lagoon has been in operation for 15 years or more without sludge removal, the sludge in the lagoon qualifies as a Class B biosolids with respect to pathogens due to anaerobic digestion, and testing for fecal coliform is not required. For other lagoons, testing for fecal coliform is required to show compliance with Class B biosolids limitations. In order to reach Class B biosolids requirements, fecal coliform must be less than 2,000,000 colony forming units or 2,000,000 most probable number. All fecal samples must be presented as geometric mean per gram.
  - c. The allowable nitrogen loading that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. For a grass cover crop, the allowable PAN is 300 pounds/acre.
    - i. PAN can be determined as follows:
$$(\text{Nitrate} + \text{nitrite nitrogen}) + (\text{organic nitrogen} \times 0.2) + (\text{ammonia nitrogen} \times \text{volatilization factor}^1).$$

<sup>1</sup> Volatilization factor is 0.7 for surface application and 1 for subsurface application.
4. When closing a domestic wastewater treatment lagoon with a design treatment capacity equal or less than 150 persons, the residuals are considered “septage” under the similar treatment works definition. See Section B of these standard conditions. Under the septage category, residuals may be left in place as follows:
  - a. Testing for metals or fecal coliform is not required
  - b. If the wastewater treatment lagoon has been in use for less than 15 years, mix lime with the sludge at a rate of 50 pounds of hydrated lime per 1000 gallons (134 cubic feet) of sludge.
  - c. The amount of sludge that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. 100 dry tons/acre of sludge may be left in the basin without testing for nitrogen. If 100 dry tons/acre or more will be left in the lagoon, test for nitrogen and determine the PAN using the calculation above. Allowable PAN loading is 300 pounds/acre.
5. Residuals left within the domestic lagoon shall be mixed with soil on at least a 1 to 1 ratio, the lagoon berm shall be demolished, and the site shall be graded and contain  $\geq 70\%$  vegetative density over 100% of the site so as to avoid ponding of storm water and provide adequate surface water drainage without creating erosion.
6. Lagoons and/or earthen structure and/or ash pond closure activities shall obtain a storm water permit for land disturbance activities that equal or exceed one acre in accordance with 10 CSR 20-6.200
7. When closing a mechanical wastewater and/or industrial process wastewater plant; all sludge must be cleaned out and disposed of in accordance with the Department approved closure plan before the permit for the facility can be terminated.
  - a. Land must be stabilized which includes any grading, alternate use or fate upon approval by the Department, remediation, or other work that exposes sediment to stormwater per 10 CSR 20-6.200. The site shall be graded and contain  $\geq 70\%$  vegetative density over 100% of the site, so as to avoid ponding of storm water and provide adequate surface water drainage without creating erosion.
  - b. Per 10 CSR 20-6.015(4)(B)6, Hazardous Waste shall not be land applied or disposed during industrial and mechanical plant closures unless in accordance with Missouri Hazardous Waste Management Law and Regulations under 10 CSR 25.
  - c. After demolition of the mechanical plant / industrial plant, the site must only contain clean fill defined in RSMo 260.200 (5) as uncontaminated soil, rock, sand, gravel, concrete, asphaltic concrete, cinderblocks, brick, minimal amounts of wood and metal, and inert solids as approved by rule or policy of the Department for fill or other beneficial use. Other solid wastes must be removed.
8. If sludge from the domestic lagoon or mechanical treatment plant exceeds agricultural rates under Section G and/or H, a landfill permit or solid waste disposal permit must be obtained if the permittee chooses to seek authorization for on-site sludge disposal under the Missouri Solid Waste Management Law and regulations per 10 CSR 80, and the permittee must comply with the surface disposal requirements under 40 CFR 503, Subpart C.

## SECTION I – MONITORING FREQUENCY

- At a minimum, sludge or biosolids shall be tested for volume and percent total solids on a frequency that will accurately represent sludge quantities produced and disposed. Please see the table below.

**TABLE 5**

Design Sludge Production (dry tons per year)	Monitoring Frequency (See Notes 1, 2, and 3)			
	Metals, Pathogens and Vectors	Nitrogen TKN <sup>1</sup>	Nitrogen PAN <sup>2</sup>	Priority Pollutants and TCLP <sup>3</sup>
0 to 100	1 per year	1 per year	1 per month	1 per year
101 to 200	biannual	biannual	1 per month	1 per year
201 to 1,000	quarterly	quarterly	1 per month	1 per year
1,001 to 10,000	1 per month	1 per month	1 per week	-- <sup>4</sup>
10,001 +	1 per week	1 per week	1 per day	-- <sup>4</sup>

<sup>1</sup> Test total Kjeldahl nitrogen, if biosolids application is 2 dry tons per acre per year or less.

<sup>2</sup> Calculate plant available nitrogen (PAN) when either of the following occurs: 1) when biosolids are greater than 50,000 mg/kg TN; or 2) when biosolids are land applied at an application rate greater than two dry tons per acre per year.

<sup>3</sup> Priority pollutants (40 CFR 122.21, Appendix D, Tables II and III) and toxicity characteristic leaching procedure (40 CFR 261.24) is required only for permit holders that must have a pre-treatment program.

<sup>4</sup> One sample for each 1,000 dry tons of sludge.

Note 1: Total solids: A grab sample of sludge shall be tested one per day during land application periods for percent total solids.

This data shall be used to calculate the dry tons of sludge applied per acre.

Note 2: Total Phosphorus: Total phosphorus and total potassium shall be tested at the same monitoring frequency as metals.

Note 3: Table 5 is not applicable for incineration and permit holders that landfill their sludge.

- If you own a wastewater treatment lagoon or sludge lagoon that is cleaned out once a year or less, you may choose to sample only when the sludge is removed or the lagoon is closed. Test one composite sample for each 100 dry tons of sludge or biosolids removed from the lagoon during the year within the lagoon at closing. Composite sample must represent various areas at one-foot depth.
- Additional testing may be required in the special conditions or other sections of the permit. Permittees receiving industrial wastewater may be required to conduct additional testing upon request from the Department.
- At this time, the Department recommends monitoring requirements shall be performed in accordance with, "POTW Sludge Sampling and Analysis Guidance Document," United States Environmental Protection Agency, August 1989, and the subsequent revisions.

## SECTION J – RECORD KEEPING AND REPORTING REQUIREMENTS

- The permittee shall maintain records on file at the facility for at least five years for the items listed in these standard conditions and any additional items in the Special Conditions section of this permit. This shall include dates when the sludge facility is checked for proper operation, records of maintenance and repairs and other relevant information.
- Reporting period
  - By January 28<sup>th</sup> of each year, an annual report shall be submitted for the previous calendar year period for all mechanical wastewater treatment facilities, sludge lagoons, and sludge or biosolids disposal facilities.
  - Permittees with wastewater treatment lagoons shall submit the above annual report only when sludge or biosolids are removed from the lagoon during the report period or when the lagoon is closed.
- Report Forms. The annual report shall be submitted on report forms provided by the Department or equivalent forms approved by the Department.
- Reports shall be submitted as follows:

Major facilities (those serving 10,000 persons or 1 million gallons per day) shall report to both the Department and EPA. Other facilities need to report only to the Department. Reports shall be submitted to the addresses listed as follows:

DNR regional office listed in your permit  
(see cover letter of permit)  
ATTN: Sludge Coordinator

EPA Region VII  
Water Compliance Branch (WACM)  
Sludge Coordinator  
11201 Renner Blvd.  
Lenexa, KS 66219

5. Annual report contents. The annual report shall include the following:
- a. Sludge and biosolids testing performed. Include a copy or summary of all test results, even if not required by the permit.
  - b. Sludge or biosolids quantity shall be reported as dry tons for quantity generated by the wastewater treatment facility, the quantity stored on site at the end of the year, and the quantity used or disposed.
  - c. Gallons and % solids data used to calculate the dry ton amounts.
  - d. Description of any unusual operating conditions.
  - e. Final disposal method, dates, and location, and person responsible for hauling and disposal.
    - i. This must include the name, address for the hauler and sludge facility. If hauled to a municipal wastewater treatment facility, sanitary landfill, or other approved treatment facility, give the name of that facility.
    - ii. Include a description of the type of hauling equipment used and the capacity in tons, gallons, or cubic feet.
  - f. Contract Hauler Activities:

If contract hauler, provide a copy of a signed contract from the contractor. Permittee shall require the contractor to supply information required under this permit for which the contractor is responsible. The permittee shall submit a signed statement from the contractor that he has complied with the standards contained in this permit, unless the contract hauler has a separate sludge or biosolids use permit.
  - g. Land Application Sites:
    - i. Report the location of each application site, the annual and cumulative dry tons/acre for each site, and the landowners name and address. The location for each spreading site shall be given as a legal description for nearest ¼, ¼, Section, Township, Range, and county, or UTM coordinates. The facility shall report PAN when either of the following occurs: 1) When biosolids are greater than 50,000 mg/kg TN; or 2) when biosolids are land applied at an application rate greater than two dry tons per acre per year.
    - ii. If the "Low Metals" criteria are exceeded, report the annual and cumulative pollutant loading rates in pounds per acre for each applicable pollutant, and report the percent of cumulative pollutant loading which has been reached at each site.
    - iii. Report the method used for compliance with pathogen and vector attraction requirements.
    - iv. Report soil test results for pH, CEC, and phosphorus. If none was tested during the year, report the last date when tested and results.



MISSOURI DEPARTMENT OF NATURAL RESOURCES  
WATER PROTECTION PROGRAM, WATER POLLUTION CONTROL BRANCH

**FORM B2 – APPLICATION FOR OPERATING PERMIT FOR FACILITIES THAT RECEIVE  
PRIMARILY DOMESTIC WASTE AND HAVE A DESIGN FLOW MORE THAN 100,000 GALLONS  
PER DAY**

Water Protection Program

RECEIVED

JUL 25 2016

FACILITY NAME

MSD - Missouri River WWTP

PERMIT NO.

MO-0004391

COUNTY

St. Louis

**APPLICATION OVERVIEW**

Form B2 has been developed in a modular format and consists of Parts A, B and C and a Supplemental Application Information (Parts D, E, F and G) packet. All applicants must complete Parts A, B and C. Some applicants must also complete parts of the Supplemental Application Information packet. The following items explain which parts of Form B2 you must complete. Submittal of an incomplete application may result in the application being returned.

**BASIC APPLICATION INFORMATION**

- A. Basic Application Information for all Applicants. All applicants must complete Part A.
- B. Additional Application Information for all Applicants. All applicants must complete Part B.
- C. Certification. All applicants must complete Part C.

**SUPPLEMENTAL APPLICATION INFORMATION**


- D. Expanded Effluent Testing Data. A treatment works that discharges effluent to surface water of the United States and meets one or more of the following criteria must complete *Part D - Expanded Effluent Testing Data*:
  - 1. Has a design flow rate greater than or equal to 1 million gallons per day.
  - 2. Is required to have or currently has a pretreatment program.
  - 3. Is otherwise required by the permitting authority to provide the information.
- E. Toxicity Testing Data. A treatment works that meets one or more of the following criteria must complete *Part E - Toxicity Testing Data*:
  - 1. Has a design flow rate greater than or equal to 1 million gallons per day.
  - 2. Is required to have or currently has a pretreatment program.
  - 3. Is otherwise required by the permitting authority to provide the information.
- F. Industrial User Discharges and Resource Conservation and Recovery Act / Comprehensive Environmental Response, Compensation and Liability Act Wastes. A treatment works that accepts process wastewater from any significant industrial users, also known as SIUs, or receives a Resource Conservation and Recovery Act or CERCLA wastes must complete *Part F - Industrial User Discharges and Resource Conservation and Recovery Act / CERCLA Wastes*.  
SIUs are defined as:
  - 1. All Categorical Industrial Users, or CIUs, subject to Categorical Pretreatment Standards under 40 Code of Federal Regulations 403.6 and 40 Code of Federal Regulations 403.6 and 40 CFR Chapter 1, Subchapter N.
  - 2. Any other industrial user that meets one or more of the following:
    - i. Discharges an average of 25,000 gallons per day or more of process wastewater to the treatment works (with certain exclusions).
    - ii. Contributes a process waste stream that makes up five percent or more of the average dry weather hydraulic or organic capacity of the treatment plant.
    - iii. Is designated as an SIU by the control authority.
    - iv. Is otherwise required by the permitting authority to provide the information.
- G. Combined Sewer Systems. A treatment works that has a combined sewer system must complete *Part G - Combined Sewer Systems*.

**ALL APPLICANTS MUST COMPLETE PARTS A, B and C**



RECEIVED

JUL 25 2016

	<b>MISSOURI DEPARTMENT OF NATURAL RESOURCES</b> <b>WATER PROTECTION PROGRAM, WATER POLLUTION CONTROL BRANCH</b> <b>FORM B2 – APPLICATION FOR AN OPERATING PERMIT FOR</b> <b>FACILITIES THAT RECEIVE PRIMARILY DOMESTIC WASTE AND</b> <b>HAVE A DESIGN FLOW MORE THAN 100,000 GALLONS PER DAY</b>	<b>Water Protection Program</b> <b>FOR AGENCY USE ONLY</b> CHECK NUMBER _____ DATE RECEIVED <u>7/25/16</u> FEE SUBMITTED <u>ASB</u>
<b>PART A – BASIC APPLICATION INFORMATION</b>		
<b>1. THIS APPLICATION IS FOR:</b>		
<input type="checkbox"/> An operating permit for a new or unpermitted facility. Construction Permit # _____ (Include completed Antidegradation Review or request to conduct an Antidegradation Review, see instructions) <input checked="" type="checkbox"/> An operating permit renewal: Permit #MO- 0004391 Expiration Date <u>01/19/2017</u> <input type="checkbox"/> An operating permit modification: Permit #MO- _____ Reason: _____		
<b>1.1</b> Is the appropriate fee included with the application (see instructions for appropriate fee)? <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		
<b>2. FACILITY</b>		
NAME MSD - Missouri River WWTP		TELEPHONE NUMBER WITH AREA CODE (314) 646-2420
ADDRESS (PHYSICAL) 3455 Creve Coeur Mill Road	CITY St. Louis	STATE MO ZIP CODE 63146
<b>2.1</b> LEGAL DESCRIPTION (Facility Site): sw ¼, ¼, ¼, Sec. 7, T, R 5E		COUNTY St. Louis
<b>2.2</b> UTM Coordinates Easting (X): <u>718227.6</u> Northing (Y): <u>4290928.6</u> For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83)		
<b>2.3</b> Name of receiving stream: Missouri River (Outfall #005, Outfall #006, and Outfall #007)		
<b>2.4</b> Number of Outfalls: 2 wastewater outfalls, 1 stormwater outfalls, instream monitoring sites		
<b>3. OWNER</b>		
NAME Metropolitan St. Louis Sewer District		TELEPHONE NUMBER WITH AREA CODE (314) 768-6200
ADDRESS 2350 Market Street	CITY St. Louis	STATE MO ZIP CODE 63103
<b>3.1</b> Request review of draft permit prior to Public Notice? <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		
<b>3.2</b> Are you a Publically Owned Treatment Works (POTW)? <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO If yes, is the Financial Questionnaire attached? <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		
<b>3.3</b> Are you a Privately Owned Treatment Facility? <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		
<b>3.4</b> Are you a Privately Owned Treatment Facility regulated by the Public Service Commission (PSC)? <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		
<b>4. CONTINUING AUTHORITY: Permanent organization which will serve as the continuing authority for the operation, maintenance and modernization of the facility.</b>		
NAME Metropolitan St. Louis Sewer District		TELEPHONE NUMBER WITH AREA CODE (314) 768-6200
ADDRESS 2350 Market Street	CITY St. Louis	STATE MO ZIP CODE 63103
If the Continuing Authority is different than the Owner, include a copy of the contract agreement between the two parties and a description of the responsibilities of both parties within the agreement.		
<b>5. OPERATOR</b>		
NAME Kenneth M. Gambaro, PE		CERTIFICATE NUMBER (IF APPLICABLE) 3809
TITLE Operations Division Manager		TELEPHONE NUMBER WITH AREA CODE (314) 646-2421
EMAIL ADDRESS kmgamb@stlmsd.com		
<b>6. FACILITY CONTACT</b>		
NAME Kenneth M. Gambaro, P.E.		TITLE Operations Division Manager
EMAIL ADDRESS kmgamb@stlmsd.com		TELEPHONE NUMBER WITH AREA CODE (314) 646-2421
ADDRESS 3455 Creve Coeur Mill Road	CITY St. Louis	STATE MO ZIP CODE 63146



JUL 25 2016




MISSOURI DEPARTMENT OF NATURAL RESOURCES  
WATER PROTECTION PROGRAM  
**FINANCIAL QUESTIONNAIRE**

Water Protection Program

<b>NOTE ►</b>	<b>FINANCIAL INFORMATION THAT IS NOT PROVIDED THROUGH THIS FORM WILL BE OBTAINED BY THE DEPARTMENT FROM READILY AVAILABLE SOURCES.</b>	
<b>1. GENERAL INFORMATION</b>		
FACILITY NAME MSD - Missouri River WWTP	PERMIT NUMBER #MO- 0004391	
CITY St. Louis	COUNTY St. Louis	
<input checked="" type="checkbox"/> PERMIT RENEWAL/MODIFICATION <input type="checkbox"/> STATE REVOLVING FUND APPLICATION	SRF PROJECT NUMBER (IF APPLICABLE) C295	
<b>2. GENERAL FINANCIAL INFORMATION (ALL FACILITIES)</b>		
2.1 Number of connections to the facility: Total Connections: 51,998 Residential and Non-Residential		
2.2 Current sewer user rate: Based on a 5,000 gallon per month usage    \$ 39.73/Single Family Residence	The sewer user rate is (check one): <input type="checkbox"/> Rate Capacity (set rate) <input checked="" type="checkbox"/> Pay as You Go	
2.3 Current operating costs for the facility (excludes depreciation):	District Wide: \$177,879,000	
2.4 Bond Rating (if applicable):	Moody Aa1, Standard & Poor AAA, Fitch AA+	
2.5 Bonding Capacity: <i>General obligation bond capacity allowed by constitution: cities=up to 20% of taxable tangible property; sewer districts=up to 5% of taxable tangible property</i>	\$1,314,421,436	
2.6 Current outstanding debt relating to wastewater collection and treatment: <i>Debt information is typically available from your community's annual financial statements</i>	\$1,135,101,426	
2.7 Amount of current user rate per household per month used toward payments on wastewater debt:	\$8.80 of \$39.73 equating to 21%	
2.8 Net direct debt: <i>Net direct debt is the total amount of outstanding general obligation debt, including notes and short-term financing.</i>	\$0.00 (MSD has no outstanding GO debt)	
2.9 Overlapping debt: <i>Overlapping debt is the financial obligations of one political jurisdiction that also falls partly on a nearby jurisdiction.</i>	\$1,924,778,665	
2.10 Overall net debt: <i>Overall net debt is defined as debt repaid by property taxes within a utility/municipality's service area. It excludes debt that is repaid by special user fees (e.g. revenue bonds). Overall net debt = Net direct debt + Overlapping debt. Debt information is typically available from your community's annual financial statements</i>	\$1,924,778,665 (MSD's revenue bonds were excluded)	
2.11 Attach any relevant financial statements.	See attachment 2.11.1	
<b>3. FINANCIAL INFORMATION SPECIFIC TO MUNICIPALITIES</b>		
3.1 Municipality's Full Market Property Value (FMPV): <i>FMPV data is typically available through your community or state assessor's office</i>	\$26,288,428,702 (City, County & District Ext)	
3.2 Municipality's property tax revenues: <i>Property tax revenues are typically available from your community's annual financial statements</i>	\$24,764,324	
3.3 Municipality's property tax collection rate: <i>To determine the collection rate, you will need to divide property tax revenues by the property taxes levied. To calculate property taxes levied, multiply the assessed value of real property within your community/service area by the property tax rate. This information is typically available through your community or state assessor's office. Property tax revenues are typically available in your community's annual financial statements.</i>	96%	



## Attachment 3.2

<b>4. FINANCIAL INFORMATION SPECIFIC TO SEWER DISTRICTS</b>	
4.1 Total connections to the sewer district: Total District Connections: 385,135 Residential and Non- Residential	
4.2 When facilities require upgrades, how are the costs divided? Will the homes connected to the upgraded facility bear the costs? Will the costs be divided across the sewer district?	
Costs are divided district wide and implemented with rate commission proposals.	
<b>5. OTHER CONSIDERATIONS (ALL FACILITIES)</b>	
5.1 Provide a list of major infrastructure or other investments in environmental projects. Include project timing and costs and indicate any possible overlap or complications (attach sheets as necessary):	
MSD is executing a 23 year Consent Decree agreement with the EPA. A list of major infrastructure projects can be found in MSD's Sanitary Sewer Overflow Control Master Plan final revision dated 8/29/2014.	
5.2 Provide a list of any other relevant local community economic conditions that may impact the ability to afford new permit requirements or the proposed SRF project. (See Community Supplemental Survey on the following page):	
<b>6. CERTIFICATION</b>	
FINANCIAL CONTACT Marlon M. Gee	OFFICIAL TITLE Director of Finance
EMAIL ADDRESS mgee@stlmsd.com	TELEPHONE NUMBER WITH AREA CODE (314) 768-6299
I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attachments and that based on my inquiry of those individuals immediately responsible for obtaining this information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information including the possibility of fine or imprisonment.	
OWNER OR AUTHORIZED REPRESENTATIVE Marlon M. Gee	OFFICIAL TITLE Director of Finance
SIGNATURE 	DATE SIGNED 7-12-16
For additional guidance, see <a href="http://usmayors.org/urbanwater/media/2013/0529-report-WaterAffordability.pdf">http://usmayors.org/urbanwater/media/2013/0529-report-WaterAffordability.pdf</a> .	
For more information regarding your Missouri State Operating Permit, contact the department's Water Protection Program at 573-751-1300, to speak with a permit writer in the domestic wastewater unit.	
For more information regarding your State Revolving Fund Application, contact the department's Water Protection Program at 573-751-1300, to speak with a project coordinator in the Financial Assistance Center.	
This completed form and any attachments should be submitted to one of the following:	
For Submittal of Permit Renewal/Modification:  Department of Natural Resources Water Protection Program ATTN: NPDES Operating Permits Section P.O. Box 176 Jefferson City, MO 65102	For Submittal of SRF Applications:  Department of Natural Resources Water Protection Program ATTN: Financial Assistance Center P.O. Box 176 Jefferson City, MO 65102



## Attachment 3.2

### Attachment 2.11.1

Financial data presented in this questionnaire can be found in the following reports which can be accessed via MSD's website using the links provided:

Comprehensive Annual Financial Report for fiscal year 2015:

[http://www.stlmsd.com/sites/default/files/annual\\_report/The%20Metropolitan%20St%20%20Louis%20Sewer%20District%202015%20CAFR%20Final.pdf](http://www.stlmsd.com/sites/default/files/annual_report/The%20Metropolitan%20St%20%20Louis%20Sewer%20District%202015%20CAFR%20Final.pdf)

Popular Annual Financial Report for fiscal year 2015:

[http://www.stlmsd.com/sites/default/files/annual\\_report/MSD%202015%20PAFR.pdf](http://www.stlmsd.com/sites/default/files/annual_report/MSD%202015%20PAFR.pdf)

Budget

<http://www.stlmsd.com/our-organization/fiscal-investor-relations/budget>



JUL 25 2016



MISSOURI DEPARTMENT OF NATURAL RESOURCES  
WATER PROTECTION PROGRAM  
**Community Supplemental Survey**

Water Protection Program

**PLEASE ANSWER THE FOLLOWING APPLICABLE QUESTIONS. (ATTACH ADDITIONAL SHEETS AS NECESSARY)**

1. Are there any significant transportation corridors within 20 miles of your community?

If yes, please explain. (Example: major interstate, railroad center)

Yes, major city with multiple of the above examples present.

2. Are there any significant manufacturing or employment centers within 20 miles of your community?

If yes, please explain. (Example: commercial farming, manufacturing, government operation, big box store)

Yes, major city with many of the above examples present.

3. Where do the majority of children in your community receive their education?

(Please check appropriate box for each education level)

<b>Elementary</b>	<input checked="" type="checkbox"/> Within your community	<input type="checkbox"/> Within 20 miles	<input type="checkbox"/> Farther than 20 miles
<b>Middle School</b>	<input checked="" type="checkbox"/> Within your community	<input type="checkbox"/> Within 20 miles	<input type="checkbox"/> Farther than 20 miles
<b>High School</b>	<input checked="" type="checkbox"/> Within your community	<input type="checkbox"/> Within 20 miles	<input type="checkbox"/> Farther than 20 miles

4. Considering your community's tax base, debt level, ability to bond capital improvement projects, or repay loans, how likely is it that your community could afford to pay for the following:

4.1 An upgrade or replacements to your wastewater system costing \$50,000

4.2 An upgrade or replacements to your wastewater system costing \$250,000

4.3 An upgrade or replacements to your wastewater system costing \$1 million

Very Unlikely	Unlikely	Likely	Very Likely
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

5. Which of the following best describes anticipated population change for your community over the next ten years?

☐ Significant Decrease    ☒ Decrease    ☐ Remain the Same    ☐ Increase    ☐ Significant Increase

6. Check the appropriate boxes in the following statements as it relates to the population change you predicted in questions 5.

6.1 Over the past 20 years the population has:

☐ Significantly Decreased    ☒ Decreased    ☐ Remained the Same    ☐ Increased    ☐ Significantly Increased

6.2 The majority of the population in the community is retired or is near retirement.

☐ Definitely False    ☒ Probably False    ☐ Probably True    ☐ True    ☐ Unknown

6.3 The majority of young people leave the community in search of employment or education elsewhere.

☐ Definitely False    ☒ Probably False    ☐ Probably True    ☐ True    ☐ Unknown

6.4 In the foreseeable future, the employment opportunity in or around the community will:

☐ Significantly Decrease    ☐ Decrease    ☒ Remain the Same    ☐ Increase    ☐ Significantly Increase

6.5 In the foreseeable future the economic activity in or around the community will:

☐ Significantly Decrease    ☐ Decrease    ☒ Remain the Same    ☐ Increase    ☐ Significantly Increase

6.6 In the foreseeable future the tax base of the community will:

☐ Significantly Decrease    ☐ Decrease    ☒ Remain the Same    ☐ Increase    ☐ Significantly Increase

6.7 It is \_\_\_\_\_ for the community to meet its debt obligations.

☐ Difficult    ☐ Somewhat Difficult    ☐ Somewhat Easy    ☒ Easy    ☐ No Debt

7. What other issues or information should be considered when determining population stability or the financial ability for your community to pay for significant capital investments? Attach sheets as necessary.

(Example: Seasonal population changes, natural resources (lakes, rivers), age of infrastructure, significant employment changes, etc.)

MSD is executing a 23 year Consent Decree agreement with the EPA. A list of major infrastructure projects can be found in MSD's Sanitary Sewer Overflow Control Master Plan final revision dated 8/29/2014.

8. Should an existing or proposed regional wastewater district be willing to connect, own, or operate your current facility, how likely would you be to consider this as an option?

Very Unlikely	Unlikely	Likely	Very Likely
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>



FACILITY NAME <b>MSD - Missouri River WWTP</b>	PERMIT NO. <b>MO- 0004391</b>	OUTFALL NO. <b>005, 006, 007</b>
---------------------------------------------------	----------------------------------	-------------------------------------

## **PART A – BASIC APPLICATION INFORMATION**

### **7. FACILITY INFORMATION**

**7.1 Process Flow Diagram or Schematic.** Provide a diagram showing the processes of the treatment plant. Show all of the treatment units, including disinfection (e.g. – Chlorination and Dechlorination), influents, and outfalls. Specify where samples are taken. Indicate any treatment process changes in the routing of wastewater during dry weather and peak wet weather. Include a brief narrative description of the diagram.  
Attach sheets as necessary.

The MSD, Missouri River WWTP was rehabbed and modified from 2006 through 2014. These upgrades included new headworks, new secondary process, new dewatering systems, disinfection, and peak flow storage basins. The new design flow is 38 MGD.

Design population equivalent is 380,000.

Design flow is 38 million gallons per day (MGD).

Actual flow is 30.4 MGD.

Peak flow capacity is 190 MGD through Preliminary Treatment (screening and grit removal), and 80 MGD through the Secondary Treatment Process. Flows above 80 MGD are diverted to peak flow storage basins for full treatment after the peak flow conditions have passed.

Design sludge production is 8,030 dry tons per year.

Actual sludge production is 3,300 dry tons per year.

There are three outfall locations for the upgraded facility.

Outfall #005 - Emergency overflow from the influent structure.

Outfall #006 - Storm water.

Outfall #007 - POTW-SIC#4952

During the recent plant expansion, the existing trickling filter process was replaced with an activated sludge process and the addition of effluent disinfection. The upgraded facility has full secondary treatment consisting of one coarse screen for the Bonfils influent line, six fine screens, four grit chambers, four preaeration basins, four primary clarifiers, an intermediate low-lift pump station, six plug flow aeration basins, six secondary clarifiers, ultraviolet disinfection, and an effluent pump station for use during high river levels. During peak flows, the excess volume is stored in the wet weather peak flow storage basins and returned to the head of the plant for treatment.

Waste activated sludge (WAS) is thickened with four rotating drum thickeners. Thickened WAS and primary sludge are combined and fed to four primary anaerobic digesters and one secondary anaerobic digester. Digested sludge is dewatered by three centrifuges. Two sludge storage silos each with a sludge cake trailer loading system are provided. Sludge is disposed via hauling for land application, composting, incineration, or landfilling.


Three engine/generator units powered by digester gas are provided for supplementary power and digester heating.

Base Maps AG06 and AG07 show the expansion in detail and includes the following improvements:

- \* Low lift pump station;
- \* Aeration basins;
- \* Blower building;
- \* Sludge pumping station;
- \* Solids handling building and sludge storage;
- \* Additional anaerobic digester;
- \* UV disinfection;
- \* Replacement of final clarifiers and effluent pumps; and
- \* Demolition of existing trickling filters, final clarifiers, and solids handling building.

See Attachment 7.1 - Missouri River WWTP Unit Process Descriptions and Capacities and Schematic Diagram






THE PROFESSIONAL WHOSE SIGNATURE AND PERSONAL SEAL APPEAR HEREON, ASSUMES RESPONSIBILITY ONLY FOR WHAT APPEARS ON THIS PAGE, AND DISCLAIMS (PURSUANT TO SECTION 327.41 RSMo) ANY RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS, ESTIMATES, REPORTS, OR OTHER DOCUMENTS OR INSTRUMENTS NOT SEALED BY THE UNDERSIGNED PROFESSIONAL RELATING TO OR INTENDED TO BE USED FOR ANY PART OR PARTS OF THE PROJECT TO WHICH THIS PAGE REFERS.

Engineer Seed



ALAN ERNEST CHRISTANELL  
CIVIL ENGINEER  
LICENSE NO: E-27150



**BLACK & VEATCH**  
Building a world of difference

**Black & Veatch Corporation**  
15440 South Quaker Ferry Drive, Suite 200  
Chattanooga, Missouri 63017  
314.332.7940 Engineering License No. 16448

0 1/2 1

IF THIS BAR DOES NOT  
MEASURE 1" THEN DRAWING IS  
NOT TO FULL SCALE

B&amp;V PROJECT 145784



**BLACK**  
Building

**Black & Veatch**  
15450 South Ocean  
Chattahoochee  
638.332.7960 Fax

RECEIVED

JUL 25 2016

**Water Protection Program**







Attachment 7.1 - Missouri River WWTP Unit Process Descriptions and Capacities


Unit Process	Description	Status	Design Basis	Design Capacity
<b>Headworks</b>				
Fine Screens	Six mechanically- cleaned band screens with 1/4- inch perforations	Active	190 MGD with 5 units	190 MGD
Washer Compactors	Three washer, grinder, compactor units	Active	150 cf/hr	
Grit Removal	Four 20 feet diameter vortex grit chambers	Active	190 MGD	190 MGD
Ferrous Chloride Feed	Two 6,000 gallon bulk storage tanks and two metering pumps	Active		
<b>Peak Flow Storage</b>	Basin No. 1 - 4.2 Million Gallons Basin No. 2 - 4.8 Million Gallons Basin No. 3 - 10.8 Million Gallons Basin No. 4 - 10.4 Million Gallons	Active	Capture flows above 80 MGD; Overflow to existing south lagoon; return Pump Station capacity 7.5 MGD	
<b>Pre-Aeration</b>	Four parallel basins each 16 feet wide by 100 feet long by 14.87 feet water depth	Active	One basin idle	80 MGD
<b>Primary Settling</b>	Four 120-ft diameter clarifiers, 9-ft SWD, center fed, spiral scrapers	Active		80 MGD
<b>Equalization Tank</b>	182 ft-8 in by 312 ft-8 in by 11.2 ft SWD 6 cells; 6.65 Million Gallons	Active	Former aeration tanks	
<b>Low Lift Pump Station</b>	Vertical diffusion vane pumps - two 11,000 gpm @ 25 ft TDH; three 16,800 gpm @ 25 ft TDH	Active	Largest pump idle	80 MGD
<b>Aeration</b>	Tanks have 20 ft side water depth and total volume of 5.5 Million Gallons (Note 4)	Active		38 MGD average flow, 80 MGD peak hourly flow
<b>Secondary Clarifiers</b>	Six circular 125 feet diameter by 15 feet SWD, center fed	Active		80 MGD
<b>Disinfection</b>	UV disinfection, low pressure high output, Trojan UV3000Plus, three open channels	Active		80 MGD
<b>Effluent Pump Station</b>	Four single-stage vertical turbine pumps, 250 hp, 19,444 gpm at 33.5 ft TDH	Active	One pump idle	80 MGD
<b>Outfall</b>	66-inch diameter RCP gravity outfall to Missouri River	Active		83 MGD
<b>Solids Handling</b>				
Grit	Grit classifier - washed and dewatered to dumpster	Active		
Screenings	Screenings Washer/Compactors	Active		
Primary Sludge Pumps	Two 15-hp recessed impeller variable speed driven pumps	Active	30 gpm @ 23 ft TDH 200 gpm @ 77 ft TDH	

Attachment 7.1 - Missouri River WWTP Unit Process Descriptions and Capacities

Unit Process	Description	Status	Design Basis	Design Capacity
Thickener Feed Pumps	Four 20-hp horizontal end suction centrifugal	Active	400 gpm @ 70 ft TDH	
Rotary Drum Thickeners	Four rotary drum thickeners - 3 duty, one spare; Parkson Hycor RDT 400	Active	400 gpm each of 0.3% solids feed; 585 lb/hr dry	
Anaerobic Digester Nos. 1 -4 (existing)	Three primary digesters, one secondary digester, 70 ft diameter, 27 ft side wall depth	Active	Liquid volume 115,500 cf each; 3.456 Million Gallons total - 4 tanks	
Anaerobic Digester No. 5	96 ft diameter, 28 ft side wall depth	Active	Liquid volume 1.552 Million Gallons	
Centrifuges	Three centrifuges - two operating, one standby	Active	16 hrs/day, 5 days/week; 245 gpm @ 2.7%	



Attachment 7.1 – Missouri River WWTP Schematic Diagram

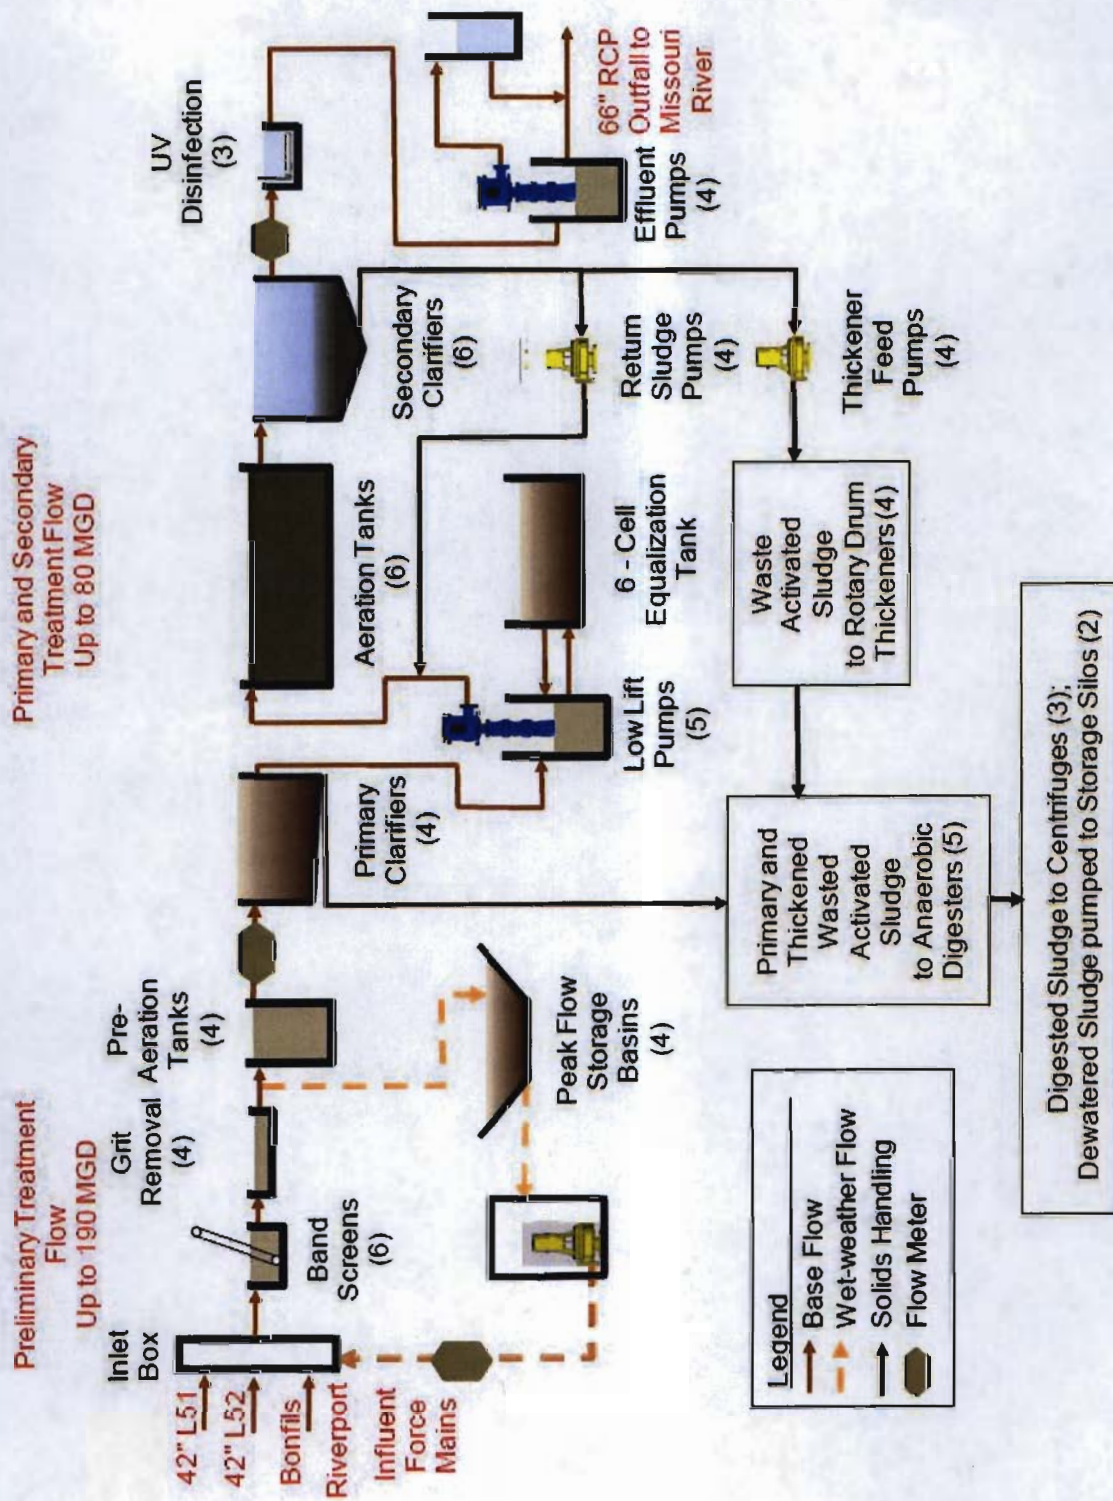




FACILITY NAME MSD - Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 005, 006, 007
<b>PART A – BASIC APPLICATION INFORMATION</b>		
<b>7. FACILITY INFORMATION (continued)</b>		
<p><b>7.2 Topographic Map.</b> Attach to this application a topographic map of the area extending at least one mile beyond facility property boundaries. This map must show the outline of the facility and the following information.</p> <ul style="list-style-type: none"> <li>a. The area surrounding the treatment plant, including all unit processes.</li> <li>b. The location of the downstream landowner(s). (See Item 10.)</li> <li>c. The major pipes or other structures through which wastewater enters the treatment works and the pipes or other structures through which treated wastewater is discharged from the treatment plant. Include outfalls from bypass piping, if applicable.</li> <li>d. The actual point of discharge.</li> <li>e. Wells, springs, other surface water bodies and drinking water wells that are: 1) within ¼ mile of the property boundaries of the treatment works, and 2) listed in public record or otherwise known to the applicant.</li> <li>f. Any areas where the sewage sludge produced by the treatment works is stored, treated, or disposed.</li> <li>g. If the treatment works receives waste that is classified as hazardous under the Resource Conservation and Recovery Act (RCRA) by truck, rail, or special pipe, show on the map where that hazardous waste enters the treatment works and where it is treated, stored, or disposed.</li> </ul>		
7.3 Facility SIC Code: <u>4952</u>	Discharge SIC Code: <u>4952</u>	
7.4 Number of people presently connected or population equivalent (P.E.): <u>304,000</u> Design P.E. <u>380,000</u>		
<p>7.5 Connections to the facility:</p> <p style="padding-left: 40px;">Number of units presently connected:</p> <p style="text-align: center; padding-left: 40px;">51,998 connections total</p>		
7.6 Design Flow 005-emergency overflow; 006-stormwater; 007-38MGD	Actual Flow #007 - 30.4 MGD	
<p>7.7 Will discharge be continuous through the year?      Yes <input checked="" type="checkbox"/>      No <input type="checkbox"/></p> <p>Discharge will occur during the following months:      How many days of the week will discharge occur?</p> <p style="text-align: center;">January - December; Seven days per week</p>		
<p>7.8 Is industrial wastewater discharged to the facility?      Yes <input checked="" type="checkbox"/>      No <input type="checkbox"/></p> <p>If yes, describe the number and types of industries that discharge to your facility. Attach sheets as necessary</p> <p>See Part F.</p> <p style="text-align: center; padding-top: 20px;">Refer to the APPLICATION OVERVIEW to determine whether additional information is needed for Part F.</p>		
7.9 Does the facility accept or process leachate from landfills?:      Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>		
7.10 Is wastewater land applied?      Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
If yes, is Form I attached?      Yes <input type="checkbox"/> No <input type="checkbox"/>		
7.11 Does the facility discharge to a losing stream or sinkhole?      Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
7.12 Has a wasteload allocation study been completed for this facility?      Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
<b>8. LABORATORY CONTROL INFORMATION</b>		
<b>LABORATORY WORK CONDUCTED BY PLANT PERSONNEL</b>		
Lab work conducted outside of plant.	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>
Push-button or visual methods for simple test such as pH, settleable solids.	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>
Additional procedures such as Dissolved Oxygen, Chemical Oxygen Demand, Biological Oxygen Demand, titrations, solids, volatile content.	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
More advanced determinations such as BOD seeding procedures, fecal coliform, nutrients, total oils, phenols, etc.	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
Highly sophisticated instrumentation, such as atomic absorption and gas chromatograph.	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>



# Attachment 7.2 Missouri River WWTP Topo Map

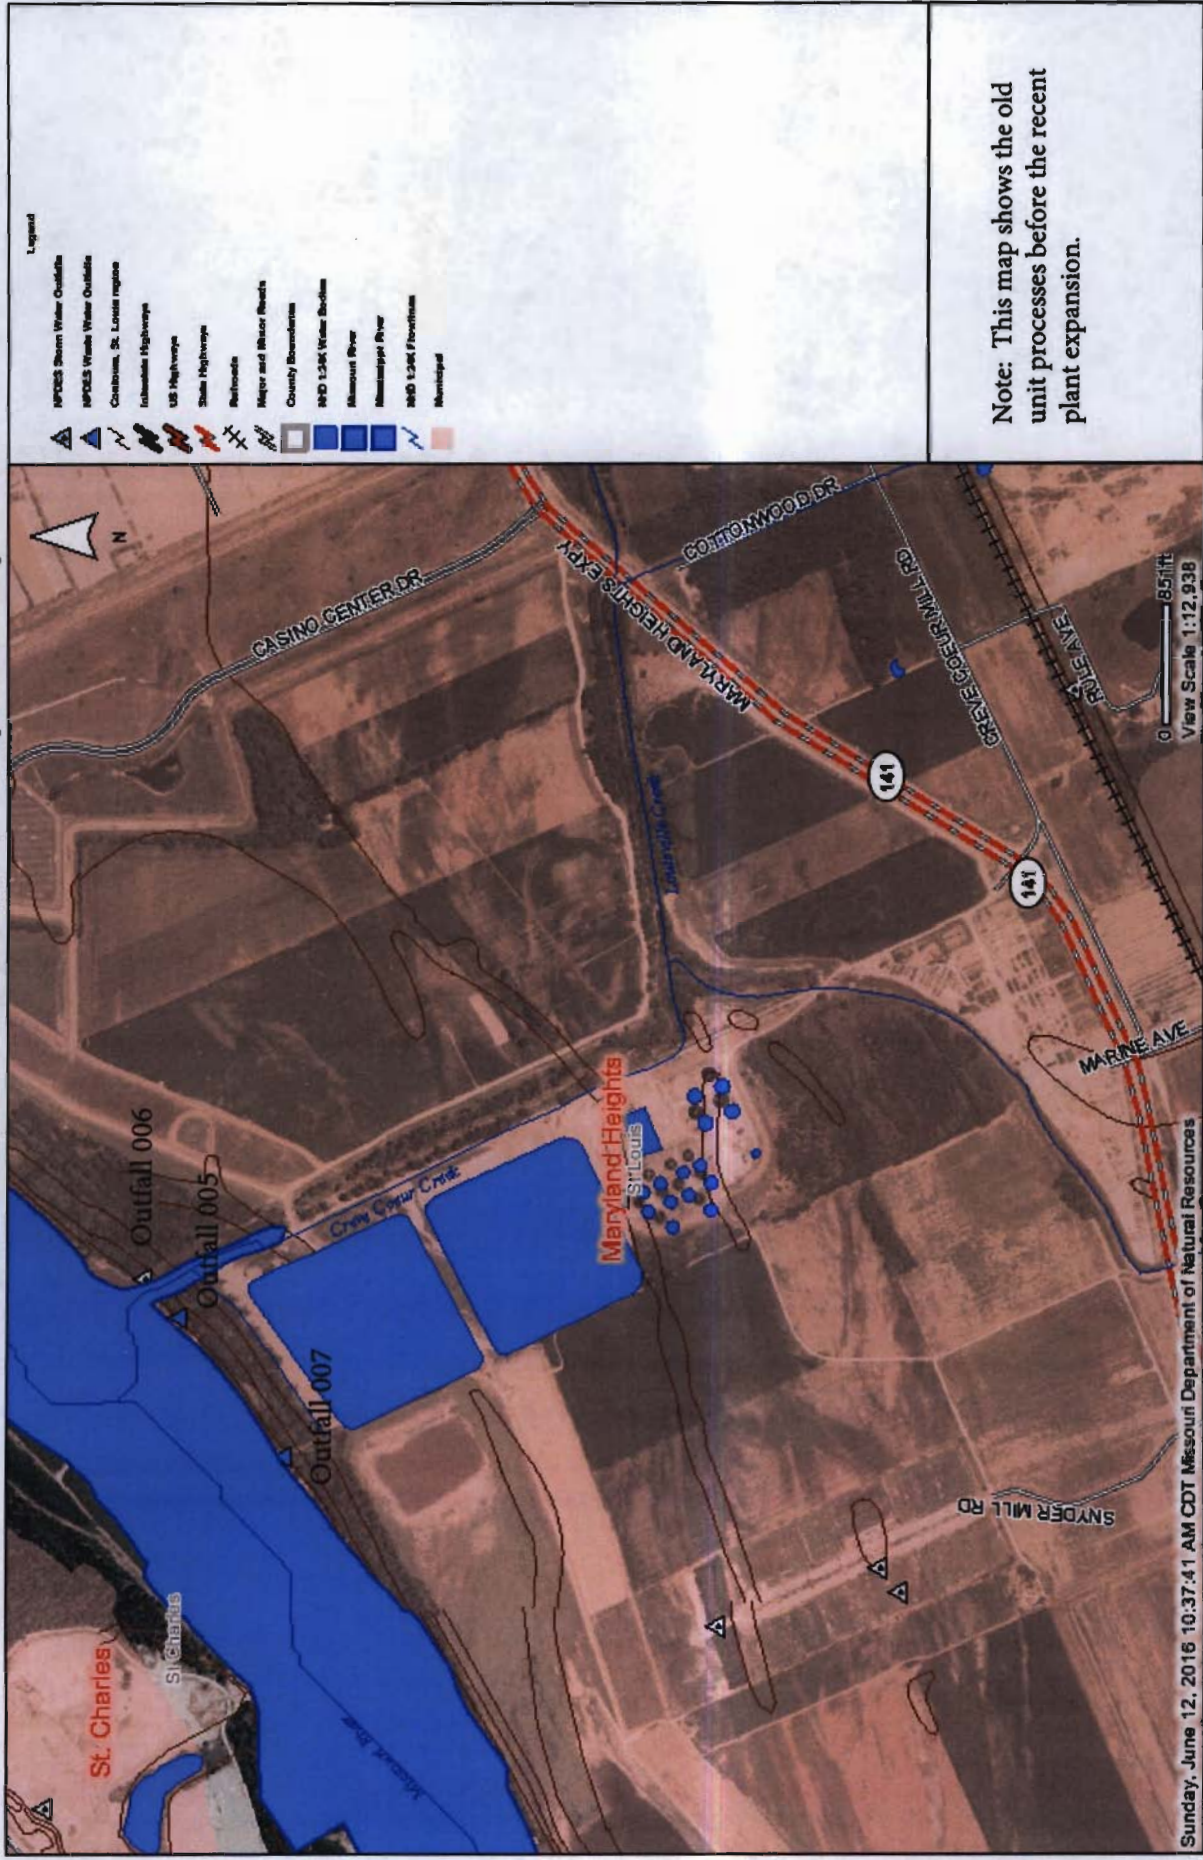

Sunday, June 12, 2016 10:37:41 AM CDT Missouri Department of Natural Resources

This timestamp indicates the date and time the map was generated. Data layers in the map are updated at a variety of intervals and may not reflect current conditions. Disclaimer: Although this map has been compiled by the Missouri Department of Natural Resources, no warranty, expressed or implied, is made by the department as to the accuracy of the data and related materials. The act of distribution shall not constitute any such warranty, and no responsibility is assumed by the department in the use of these data or related materials.



FACILITY NAME <b>MSD, Missouri River WWTP</b>	PERMIT NO. <b>MO- 0004391</b>	OUTFALL NO. <b>005, 006, 007</b>
<b>PART A – BASIC APPLICATION INFORMATION</b>		
<b>9. SLUDGE HANDLING, USE AND DISPOSAL</b>		
<b>9.1</b> Is the sludge a hazardous waste as defined by 10 CSR 25?      Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
<b>9.2</b> Sludge production (Including sludge received from others): Design Dry Tons/Year 8,030    Actual Dry Tons/Year 3,300		
<b>9.3</b> Sludge storage provided: <u>24,840</u> Cubic feet; _____ Days of storage; <u>22%</u> Average percent solids of sludge; <input type="checkbox"/> No sludge storage is provided. <input type="checkbox"/> Sludge is stored in lagoon.    920 cubic yards (24,840 cubic feet) of sludge storage provided		
<b>9.4</b> Type of storage: <input checked="" type="checkbox"/> Holding Tank <input type="checkbox"/> Building <input type="checkbox"/> Basin <input type="checkbox"/> Lagoon <input type="checkbox"/> Concrete Pad <input type="checkbox"/> Other (Describe) _____		
<b>9.5</b> Sludge Treatment: <input checked="" type="checkbox"/> Anaerobic Digester <input type="checkbox"/> Storage Tank <input type="checkbox"/> Lime Stabilization <input type="checkbox"/> Lagoon <input type="checkbox"/> Aerobic Digester <input type="checkbox"/> Air or Heat Drying <input type="checkbox"/> Composting <input checked="" type="checkbox"/> Other Thickening		
<b>9.6</b> Sludge use or disposal: <input checked="" type="checkbox"/> Land Application <input checked="" type="checkbox"/> Contract Hauler <input checked="" type="checkbox"/> Hauled to Another Treatment Facility <input checked="" type="checkbox"/> Solid Waste Landfill <input type="checkbox"/> Surface Disposal (Sludge Disposal Lagoon, Sludge Held For More Than Two Years) <input checked="" type="checkbox"/> Incineration <input checked="" type="checkbox"/> Other (Attach Explanation Sheet) <u>Composting</u>		
<b>9.7</b> Person responsible for hauling sludge to disposal facility: <input type="checkbox"/> By Applicant <input checked="" type="checkbox"/> By Others (complete below)		
NAME <b>Metropolitan St. Louis Sewer District</b>		EMAIL ADDRESS <b>theller@stlmsd.com</b>
ADDRESS <b>1000 Grand Glaize Parkway</b>	CITY <b>Valley Park</b>	STATE    ZIP CODE <b>MO    63088</b>
CONTACT PERSON <b>Todd Heller</b>	TELEPHONE NUMBER WITH AREA CODE <b>(636) 861-6701</b>	PERMIT NO. <b>MO- 0101362</b>
<b>9.8</b> Sludge use or disposal facility: <input type="checkbox"/> By Applicant <input checked="" type="checkbox"/> By Others (Complete below)		
NAME <b>See Attachment 9.8</b>		EMAIL ADDRESS
ADDRESS	CITY	STATE    ZIP CODE
CONTACT PERSON	TELEPHONE NUMBER WITH AREA CODE	PERMIT NO. <b>MO-</b>
<b>9.9</b> Does the sludge or biosolids disposal comply with Federal Sludge Regulation 40 CFR 503? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No    (Explain)		
<b>END OF PART A</b>		

#### 9.8 Sludge Use or Disposal Facility

ISEI MO Champ Landfill  
2280 Maryland Heights Expressway  
Maryland Heights, MO 63043  
Mitch Stepro  
(636) 321-2100  
Permit No. 0118917

MSD, Bissell Point WWTF  
10 East Grand Avenue  
St. Louis, MO 63147  
Mike Townley  
(314) 436-8733  
MO-0025178



FACILITY NAME MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 005, 006, 007
<b>PART B – ADDITIONAL APPLICATION INFORMATION</b>		
<b>10. COLLECTION SYSTEM</b>		
10.1 Length of sanitary sewer collection system in miles 947.07 miles		
10.2 Does significant infiltration occur in the collection system? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If yes, briefly explain any steps underway or planned to minimize inflow and infiltration:		
<b>11. BYPASSING</b>		
Does any bypassing occur anywhere in the collection system or at the treatment facility? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> If yes, explain:		
Periodic Sanitary Sewer Overflows in collection system.		
<b>12. OPERATION AND MAINTENANCE PERFORMED BY CONTRACTOR(S)</b>		
Are any operational or maintenance aspects (related to wastewater treatment and effluent quality) of the treatment works the responsibility of the contractor? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> If Yes, list the name, address, telephone number and status of each contractor and describe the contractor's responsibilities. (Attach additional pages if necessary.)		
NAME		
MAILING ADDRESS		
TELEPHONE NUMBER WITH AREA CODE	EMAIL ADDRESS	
RESPONSIBILITIES OF CONTRACTOR		
<b>13. SCHEDULED IMPROVEMENTS AND SCHEDULES OF IMPLEMENTATION</b>		
Provide information about any uncompleted implementation schedule or uncompleted plans for improvements that will affect the wastewater treatment, effluent quality, or design capacity of the treatment works. If the treatment works has several different implementation schedules or is planning several improvements, submit separate responses for each.		
Not applicable.		




FACILITY NAME MSD, Missouri River WWTP		PERMIT NO. MO- 0004391		OUTFALL NO. 007			
<b>PART B – ADDITIONAL APPLICATION INFORMATION</b>							
<b>14. EFFLUENT TESTING DATA</b>							
Applicants must provide effluent testing data for the following parameters. Provide the indicated effluent data <b>for each outfall through which effluent is discharged</b> . Do not include information of combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. At a minimum, effluent testing data must be based on at least <b>three samples</b> and must be no more than four and one-half years apart.							
Outfall Number							
PARAMETER	MAXIMUM DAILY VALUE		AVERAGE DAILY VALUE				
	Value	Units	Value	Units	Number of Samples		
pH (Minimum)	6.6	S.U.	7.1	S.U.	761		
pH (Maximum)	8.1	S.U.	--	S.U.			
Flow Rate	97.0	MGD	25.85	MGD	761		
*For pH report a minimum and a maximum daily value							
POLLUTANT	MAXIMUM DAILY DISCHARGE		AVERAGE DAILY DISCHARGE			ANALYTICAL METHOD	ML/MDL
	Conc.	Units	Conc.	Units	Number of Samples		
Conventional and Nonconventional Compounds							
BIOCHEMICAL OXYGEN DEMAND (Report One)	BOD <sub>5</sub>		mg/L		mg/L		
	CBOD <sub>5</sub>	45	mg/L	4.20	mg/L	545	SM 5210B 2 mg/L
E. COLI	6,100	#/100 mL	11.26	#/100 mL	69	SM9223B 10/100 mL	
TOTAL SUSPENDED SOLIDS (TSS)	120	mg/L	5.52	mg/L	545	SM2540D 2 mg/L	
AMMONIA (as N)	29.1	mg/L	7.74	mg/L	82	SM 4500C 2 mg/L	
CHLORINE* (TOTAL RESIDUAL, TRC)		mg/L		mg/L			
DISSOLVED OXYGEN		mg/L		mg/L			
OIL and GREASE	<4	mg/L	<4	mg/L	25	EPA 1664A 4 mg/L	
OTHER		mg/L		mg/L		See Attachment 14	
*Report only if facility chlorinates							
<b>END OF PART B</b>							

## Attachment 14: Other Effluent Testing Data

Pollutant	Maximum Daily Discharge		Average Daily Discharge			Analytical Method	Reporting Limit (RL)
	Conc.	Units	Conc.	Units	No. of Samples		
Total Phosphorus as P	2.57	ug/L	1.60	ug/L	11	Std. Methods 4500-P	0.02 mg/L
Nitrate & Nitrite	17.90	ug/L	8.31	ug/L	12	Std. Methods 4500-NO3 E	0.2 mg/L
Total Nitrogen as N	30.46	ug/L	16.39	ug/L	11	Calculated	3.2 mg/L



FACILITY NAME MSD, Missouri River WWTF	PERMIT NO. MO- 0004391	OUTFALL NO. 005, 006, 007
<b>PART C – CERTIFICATION</b>		
<b>15. CERTIFICATION</b>		
<p>All applicants must complete the Certification Section. This certification must be signed by an officer of the company or city official. All applicants must complete all applicable sections as explained in the Application Overview. By signing this certification statement, applicants confirm that they have reviewed the entire form and have completed all sections that apply to the facility for which this application is submitted.</p>		
<b>ALL APPLICANTS MUST COMPLETE THE FOLLOWING CERTIFICATION.</b>		
<p>I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.</p>		
PRINTED NAME Kenneth M. Gambaro, P. E.	OFFICIAL TITLE (MUST BE AN OFFICER OF THE COMPANY OR CITY OFFICIAL) Operations Division Manager	
SIGNATURE 		
TELEPHONE NUMBER WITH AREA CODE (314) 646-2421		
DATE SIGNED 7/15/16		
<p>Upon request of the permitting authority, you must submit any other information necessary to assess wastewater treatment practices at the treatment works or identify appropriate permitting requirements.</p>		
<p>Send Completed Form to:</p> <p style="text-align: center;">Department of Natural Resources Water Protection Program ATTN: NPDES Permits and Engineering Section P.O. Box 176 Jefferson City, MO 65102</p>		
<b>END OF PART C</b>		
<b>REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH PARTS OF FORM B2 YOU MUST COMPLETE.</b>		
<p>Do not complete the remainder of this application, unless at least one of the following statements applies to your facility:</p> <ol style="list-style-type: none"> <li>1. Your facility design flow is equal to or greater than 1,000,000 gallons per day.</li> <li>2. Your facility is a pretreatment treatment works.</li> <li>3. Your facility is a combined sewer system.</li> </ol>		
<p>Submittal of an incomplete application may result in the application being returned. Permit fees for returned applications shall be forfeited. Permit fees for applications being processed by the department that are withdrawn by the applicant shall be forfeited.</p>		



**MAKE ADDITIONAL COPIES OF THIS FORM FOR EACH OUTFALL**

FACILITY NAME MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 007
-------------------------------------------	---------------------------	--------------------

**PART D – EXPANDED EFFLUENT TESTING DATA****16. EXPANDED EFFLUENT TESTING DATA**

Refer to the APPLICATION OVERVIEW to determine whether Part D applies to the treatment works.

If the treatment works has a design flow greater than or equal to 1 million gallons per day or it has (or is required to have) a pretreatment program, or is otherwise required by the permitting authority to provide the data, then provide effluent testing data for the following pollutants. Provide the indicated effluent testing information **for each outfall through which effluent is discharged**. Do not include information of combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. Indicate in the blank rows provided below any data you may have on pollutants not specifically listed in this form. At a minimum, effluent testing data must be based on at least **three pollutant scans** and must be no more than four and one-half years apart.

Outfall Number (Complete Once for Each Outfall Discharging Effluent to Waters of the State.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	No. of Samples		

**METALS (TOTAL RECOVERABLE), CYANIDE, PHENOLS AND HARDNESS**

ALUMINUM											
ANTIMONY											
ARSENIC											
BERYLLIUM											
CADMIUM											
CHROMIUM III											
CHROMIUM VI											
COPPER											
IRON											
LEAD											
MERCURY											
NICKEL											
SELENIUM											
SILVER											
THALLIUM											
ZINC											
CYANIDE											
TOTAL PHENOLIC COMPOUNDS											
HARDNESS (as CaCO <sub>3</sub> )											

See attachment 16.1

**VOLATILE ORGANIC COMPOUNDS**

ACROLEIN											
ACRYLONITRILE											
BENZENE											
BROMOFORM											
CARBON TETRACHLORIDE											

See Attachment 16.2



FACILITY NAME		MSD, Missouri River WWTP			PERMIT NO.		MO- 0004391			OUTFALL NO.		007	
<b>PART D – EXPANDED EFFLUENT TESTING DATA</b>													
<b>16. EXPANDED EFFLUENT TESTING DATA</b>													
Complete Once for Each Outfall Discharging Effluent to Waters of the State													
POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/MDL		
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	No. of Samples				
CHLOROBENZENE													
CHLORODIBROMO-METHANE													
CHLOROETHANE													
2-CHLORO-ETHYL VINYL ETHER													
CHLOROFORM													
DICHLOROBROMO-METHANE													
1,1-DICHLORO-ETHANE													
1,2-DICHLORO-ETHANE													
TRANS-1,2-DICHLOROETHYLENE													
1,1-DICHLORO-ETHYLENE													
1,2-DICHLORO-PROPANE													
1,3-DICHLORO-PROPYLENE													
ETHYLBENZENE													
METHYL BROMIDE													
METHYL CHLORIDE													
METHYLENE CHLORIDE													
1,1,2,2-TETRA-CHLOROETHANE													
TETRACHLORO-ETHANE													
TOLUENE													
1,1,1-TRICHLORO-ETHANE													
1,1,2-TRICHLORO-ETHANE													
TRICHLORETHYLENE													
VINYL CHLORIDE													
<b>ACID-EXTRACTABLE COMPOUNDS</b>													
P-CHLORO-M-CRESOL													
2-CHLOROPHENOL													
2,4-DICHLOROPHENOL													
2,4-DIMETHYLPHENOL													
4,6-DINITRO-O-CRESOL													
2,4-DINITROPHENOL													
2-NITROPHENOL													
4-NITROPHENOL													

See Attachment 16.2

See Attachment 16.2



FACILITY NAME	MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 007
---------------	--------------------------	---------------------------	--------------------

**PART D – EXPANDED EFFLUENT TESTING DATA**
**16. EXPANDED EFFLUENT TESTING DATA**

Complete Once for Each Outfall Discharging Effluent to Waters of the State.

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	No. of Samples		
PENTACHLOROPHENOL											
PHENOL											
2,4,6-TRICHLOROPHENOL											
<b>BASE-NEUTRAL COMPOUNDS</b>											
ACENAPHTHENE											
ACENAPHTHYLENE											
ANTHRACENE											
BENZIDINE											
BENZO(A)ANTHRACENE											
BENZO(A)PYRENE											
3,4-BENZO- FLUORANTHENE											
BENZO(GH) PHERYLENE											
BENZO(K) FLUORANTHENE											
BIS (2-CHLOROTHOXY) METHANE											
BIS (2-CHLOROETHYL) – ETHER											
BIS (2-CHLOROISO- PROPYL) ETHER											
BIS (2-ETHYLHEXYL) PHTHALATE											
4-BROMOPHENYL PHENYL ETHER											
BUTYL BENZYL PHTHALATE											
2-CHLORONAPH- THALENE											
4-CHLORPHENYL PHENYL ETHER											
CHRYSENE											
DI-N-BUTYL PHTHALATE											
DI-N-OCTYL PHTHALATE											
DIBENZO (A,H) ANTHRACENE											
1,2-DICHLORO-BENZENE											
1,3-DICHLORO-BENZENE											
1,4-DICHLORO-BENZENE											
3,3-DICHLORO- BENZIDINE											
DIETHYL PHTHALATE											
DIMETHYL PHTHALATE											

See Attachment 16.2



FACILITY NAME MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 007
-------------------------------------------	---------------------------	--------------------

## PART D – EXPANDED EFFLUENT TESTING DATA

## 16. EXPANDED EFFLUENT TESTING DATA

Complete Once for Each Outfall Discharging Effluent to Waters of the State.

[illegible]

Use this space (or a separate sheet) to provide information on other pollutants not specifically listed in this form.

[illegible]

**END OF PART D**

**REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM B2 YOU MUST COMPLETE.**

## Attachment 16.1: Part D Metals, Cyanide, Phenols and Hardness

Pollutant	Maximum Daily Discharge		Average Daily Discharge			Analytical Method	Reporting Limit (RL)
	Conc.	Units	Conc.	Units	No. of Samples		
Aluminum	-	-	-	-	-	-	-
Antimony	-	-	-	-	-	-	-
Arsenic	-	-	-	-	-	-	-
Beryllium	-	-	-	-	-	-	-
Cadmium	<0.8	ug/L	0.23	ug/L	9	Std. Methods 3125B	0.8 ug/L
Chromium III	10	ug/L	6	ug/L	9	Std. Methods 3500	10 ug/L
Chromium VI (Dissolved)	10	ug/L	6	ug/L	9	Std. Methods 3500	10 ug/L
Copper	-	-	-	-	-	-	-
Iron	-	-	-	-	-	-	-
Lead	<20	ug/L	6	ug/L	9	Std. Methods 3125B	20 ug/L
Mercury	-	-	-	-	-	-	-
Nickel	-	-	-	-	-	-	-
Selenium	-	-	-	-	-	-	-
Silver	-	-	-	-	-	-	-
Thallium	-	-	-	-	-	-	-
Zinc	-	-	-	-	-	-	-
Cyanide (Amenable to Chlorine)	-	-	-	-	-	-	-
Total Phenolic Compounds	-	-	-	-	-	-	-
Hardness (as CaCO3)	300	mg/L	266	mg/L	9	Std. Methods 2340	10 mg/L



Test Date:		3/28/2016			No. of Samples	Analytical Method	Reporting Limit
Pollutant		Conc.	Units.				
VOLATILE ORGANIC COMPOUNDS	ACROLEIN	<	0.01	mg/L	1	EPA 603	0.01
	ACRYLONITRILE	<	0.01	mg/L	1	EPA 603	0.01
	BENZENE	<	0.01	mg/L	1	EPA 624	0.01
	BROMOFORM	<	0.01	mg/L	1	EPA 624	0.01
	CARBON TETRACHLORIDE	<	0.01	mg/L	1	EPA 624	0.01
	CHLOROBENZENE	<	0.01	mg/L	1	EPA 624	0.01
	CHLORODIBROMOMETHANE	<	0.01	mg/L	1	EPA 624	0.01
	CHLOROETHANE	<	0.01	mg/L	1	EPA 624	0.01
	2-CHLOROETHYL VINYL ETHER	<	0.01	mg/L	1	EPA 624	0.01
	CHLOROFORM	<	0.01	mg/L	1	EPA 624	0.01
	DICHLOROBROMOMETHANE	<	0.01	mg/L	1	EPA 624	0.01
	1,1-DICHLOROETHANE	<	0.01	mg/L	1	EPA 624	0.01
	1,2-DICHLOROETHANE	<	0.01	mg/L	1	EPA 624	0.01
	TRANS-1,2-DICHLOROETHYLENE	<	0.01	mg/L	1	EPA 624	0.01
	1,1-DICHLOROETHYLENE	<	0.01	mg/L	1	EPA 624	0.01
	1,2-DICHLOROPROPANE	<	0.01	mg/L	1	EPA 624	0.01
	1,3-DICHLOROPROPYLENE	<	0.01	mg/L	1	EPA 624	0.01
	ETHYLBENZENE	<	0.01	mg/L	1	EPA 624	0.01
	METHYL BROMIDE	<	0.00	mg/L	1	EPA 624	0.01
	METHYL CHLORIDE	<	0.01	mg/L	1	EPA 624	0.01
	METHYLENE CHLORIDE	<	0.01	mg/L	1	EPA 624	0.01
	1,1,2,2-TETRACHLOROETHANE*	<	0.01	mg/L	1	EPA 624	0.01
	TETRACHLOROETHANE*		-	mg/L		EPA 624	0.01
	TOLUENE	<	0.01	mg/L	1	EPA 624	0.01
	1,1,1-TRICHLOROETHANE	<	0.01	mg/L	1	EPA 624	0.01
	1,1,2-TRICHLOROETHANE	<	0.01	mg/L	1	EPA 624	0.01
	TRICHLORETHYLENE	<	0.01	mg/L	1	EPA 624	0.01
	VINYL CHLORIDE	<	0.006	mg/L	1	EPA 624	0.01
ACID-EXTRACTABLE COMPOUNDS	P-CHLORO-M-CRESOL	<	0.01	mg/L	1	EPA 625	0.01
	2-CHLOROPHENOL	<	0.01	mg/L	1	EPA 625	0.01
	2,4-DICHLOROPHENOL	<	0.01	mg/L	1	EPA 625	0.01
	2,4-DIMETHYLPHENOL	<	0.01	mg/L	1	EPA 625	0.01
	4,6-DINITRO-O-CRESOL	<	0.078	mg/L	1	EPA 625	0.1
	2,4-DINITROPHENOL	<	0.2	mg/L	1	EPA 625	0.2
	2-NITROPHENOL	<	0.01	mg/L	1	EPA 625	0.01
	4-NITROPHENOL	<	0.025	mg/L	1	EPA 625	0.025
	PENTACHLOROPHENOL	<	0.025	mg/L	1	EPA 625	0.025
	PHENOL	<	0.01	mg/L	1	EPA 625	0.01
	2,4,6-TRICHLOROPHENOL	<	0.01	mg/L	1	EPA 625	0.01



	Test Date:	3/28/2016		No. of Samples	Analytical Method	Reporting Limit
	Pollutant	Conc.	Units.			
BASE-NEUTRAL COMPOUNDS	ACENAPHTHENE	< 0.01	mg/L	1	EPA 625	0.01
	ACENAPHTHYLENE	< 0.01	mg/L	1	EPA 625	0.01
	ANTHRACENE	< 0.01	mg/L	1	EPA 625	0.01
	BENZIDINE	< 0.08	mg/L	1	EPA 625	0.08
	BENZO(A)ANTHRACENE*	< 0.01	mg/L	1	EPA 625	0.01
	BENZO(A)PYRENE	< 0.01	mg/L	1	EPA 625	0.01
	3,4-BENZOFLUORANTHENE	< 0.01	mg/L	1	EPA 625	0.01
	BENZO(GH) PHERYLENE*	-	mg/L		EPA 625	0.01
	BENZO(K) FLUORANTHENE*	< 0.01	mg/L	1	EPA 625	0.01
	BIS (2-CHLOROTHIOXY) METHANE*	-	mg/L		EPA 625	0.01
	BIS (2-CHLOROETHYL) ETHER	< 0.01	mg/L	1	EPA 625	0.01
	BIS (2-CHLOROISOPROPYL) ETHER	< 0.01	mg/L	1	EPA 625	0.01
	BIS (2-ETHYLHEXYL) PHTHALATE	< 0.01	mg/L	1	EPA 625	0.01
	4-BROMOPHENYL PHENYL ETHER	< 0.01	mg/L	1	EPA 625	0.01
	BUTYL BENZYL PHTHALATE	< 0.01	mg/L	1	EPA 625	0.01
	2-CHLORONAPHTHALENE	< 0.01	mg/L	1	EPA 625	0.01
	4-CHLOROPHENYL PHENYL ETHER	< 0.01	mg/L	1	EPA 625	0.01
	CHRYSENE	< 0.01	mg/L	1	EPA 625	0.01
	DI-N-BUTYL PHTHALATE	< 0.01	mg/L	1	EPA 625	0.01
	DI-N-OCTYL PHTHALATE	< 0.01	mg/L	1	EPA 625	0.01
	DIBENZO (A,H) ANTHRACENE*	< 0.01	mg/L	1	EPA 625	0.01
	1,2-DICHLOROBENZENE	< 0.01	mg/L	1	EPA 625	0.01
	1,3-DICHLOROBENZENE	< 0.01	mg/L	1	EPA 625	0.01
	1,4-DICHLOROBENZENE	< 0.01	mg/L	1	EPA 624	0.01
	3,3-DICHLOROBENZIDINE	< 0.01	mg/L	1	EPA 625	0.01
	DIETHYL PHTHALATE	< 0.01	mg/L	1	EPA 625	0.01
	DIMETHYL PHTHALATE	< 0.01	mg/L	1	EPA 625	0.01
	2,4-DINITROTOLUENE	< 0.01	mg/L	1	EPA 625	0.01
	2,6-DINITROTOLUENE	< 0.01	mg/L	1	EPA 625	0.01
	1,2-DIPHENYLHYDRAZINE	< 0.01	mg/L	1	EPA 625	0.01
	FLUORANTHENE	< 0.01	mg/L	1	EPA 625	0.01
	FLUORENE	< 0.01	mg/L	1	EPA 625	0.01
	HEXACHLOROBENZENE	< 0.01	mg/L	1	EPA 625	0.01
	HEXACHLOROBUTADIENE	< 0.002	mg/L	1	EPA 625	0.002
	HEXACHLOROCYCLOPENTADIENE	< 0.00	mg/L	1	EPA 625	0.01
	HEXACHLOROETHANE	< 0.01	mg/L	1	EPA 625	0.01
	INDENO (1,2,3-CD) PYRENE	< 0.01	mg/L	1	EPA 625	0.01
	ISOPHORONE	< 0.01	mg/L	1	EPA 625	0.01
	NAPHTHALENE	< 0.01	mg/L	1	EPA 625	0.01
	NITROBENZENE	< 0.01	mg/L	1	EPA 625	0.01
	N-NITROSODIPROPYLAMINE	< 0.01	mg/L	1	EPA 625	0.01
	N-NITROSODIMETHYLAMINE	< 0.01	mg/L	1	EPA 625	0.01
	N-NITROSODIPHENYLAMINE	< 0.01	mg/L	1	EPA 625	0.01
	PHENANTHRENE	< 0.01	mg/L	1	EPA 625	0.01
	PYRENE	< 0.01	mg/L	1	EPA 625	0.01
	1,2,4-TRICHLOROBENZENE	< 0.01	mg/L	1	EPA 625	0.01



	Test Date:	3/28/2016		No. of Samples	Analytical Method	Reporting Limit
	Pollutant	Conc.	Units.			
OTHERS	1,12-BENZOPERYLENE*	< 0.01	mg/L	1	EPA 625	0.01
	1,2,5,6-DIBENZANTHRACENE*	-	mg/L		EPA 625	0.01
	1,2-BENZANTHRACENE*	-	mg/L		EPA 625	0.01
	1,3-DICHLOROPROPANE	< 0.01	mg/L	1	EPA 624	0.01
	11,12-BENZOFLUORANTHENE*	-	mg/L		EPA 625	0.01
	4,4-DDD	< 0.001	mg/L	1	EPA 608	0.001
	4,4-DDE	< 0.001	mg/L	1	EPA 608	0.001
	4,4-DDT	< 0.001	mg/L	1	EPA 608	0.001
	ALDRIN	< 0.0005	mg/L	1	EPA 608	0.00005
	ALPHA-BHC	< 0.0005	mg/L	1	EPA 608	0.00005
	ALPHA-endosulfan	< 0.0005	mg/L	1	EPA 608	0.00005
	BETA-BHC	< 0.0005	mg/L	1	EPA 608	0.00005
	BETA-endosulfan	< 0.001	mg/L	1	EPA 608	0.001
	BIS (2-CHLOROETHOXY) METHANE*	< 0.01	mg/L	1	EPA 625	0.01
	CHLORDANE	< 0.005	mg/L	1	EPA 608	0.005
	DELTA-BHC	< 0.0005	mg/L	1	EPA 608	0.0005
	DIELDRIN	< 0.001	mg/L	1	EPA 608	0.001
	ENDOSULFAN SULFATE	< 0.001	mg/L	1	EPA 608	0.001
	ENDRIN	< 0.001	mg/L	1	EPA 608	0.001
	ENDRIN ALDEHYDE	< 0.001	mg/L	1	EPA 608	0.001
	GAMMA-BHC	< 0.0005	mg/L	1	EPA 608	0.00005
	HEPTACHLOR	< 0.0005	mg/L	1	EPA 608	0.00005
	HEPTACHLOR EPOXIDE	< 0.0005	mg/L	1	EPA 608	0.00005
	PCB-1016	< 0.005	mg/L	1	EPA 608	0.005
	PCB-1221	< 0.01	mg/L	1	EPA 608	0.001
	PCB-1232	< 0.005	mg/L	1	EPA 608	0.0005
	PCB-1242	< 0.005	mg/L	1	EPA 608	0.0005
	PCB-1248	< 0.005	mg/L	1	EPA 608	0.0005
	PCB-1254	< 0.01	mg/L	1	EPA 608	0.01
	PCB-1260	< 0.01	mg/L	1	EPA 608	0.01
	TOXAPHENE	< 0.005	mg/L	1	EPA 608	0.005

\* These chemicals are listed separately, but are the same:

1,2-BENZANTHRACENE same as BENZO(A)ANTHRACENE

TETRACHLOROETHANE same as 1,1,2,2-TETRACHLOROETHANE

1,2,5,6-DIBENZANTHRACENE same as DIBENZO(A,H) ANTHRACENE

11,12-BENZOFLUORANTHENE same as BENZO(K)FLUORANTHENE

BENZO(GH) PERYLENE is the same as BENZO(GHI)PERYLENE which is the same as 1,12-BENZOPERYLENE

BIS (2-CHLOROTHIOXY) METHANE is the same as BIS (2-CHLOROETHOXY) METHANE



**MAKE ADDITIONAL COPIES OF THIS FORM FOR EACH OUTFALL**

FACILITY NAME MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 007
-------------------------------------------	---------------------------	--------------------

**PART E – TOXICITY TESTING DATA**
**17. TOXICITY TESTING DATA**

Refer to the APPLICATION OVERVIEW to determine whether Part E applies to the treatment works.

Publicly owned treatment works, or POTWs, meeting one or more of the following criteria must provide the results of whole effluent toxicity tests for acute or chronic toxicity for each of the facility's discharge points.

- A. POTWs with a design flow rate greater than or equal to 1 million gallons per day
- B. POTWs with a pretreatment program (or those that are required to have one under 40 CFR Part 403)
- C. POTWs required by the permitting authority to submit data for these parameters
  - At a minimum, these results must include quarterly testing for a 12-month period within the past one year using multiple species (minimum of two species), or the results from four tests performed at least annually in the four and one-half years prior to the application, provided the results show no appreciable toxicity, and testing for acute or chronic toxicity, depending on the range of receiving water dilution. Do not include information about combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136.
  - If EPA methods were not used, report the reason for using alternative methods. If test summaries are available that contain all of the information requested below, they may be submitted in place of Part E. If no biomonitoring data is required, do not complete Part E. Refer to the application overview for directions on which other sections of the form to complete.

Indicate the number of whole effluent toxicity tests conducted in the past four and one-half years: \_\_\_\_\_ chronic 9 acute

Complete the following chart for the last three whole effluent toxicity tests. Allow one column per test. Copy this page if more than three tests are being reported.

	Most Recent	2 <sup>ND</sup> Most Recent	3 <sup>RD</sup> Most Recent
<b>A. Test Information</b>			
Test Method Number	P.Promelas/C. Dubia	P.Promelas/C. Dubia	P.Promelas/C. Dubia
Final Report Number	MO-1912103	MO-1900309	MO-1805723
Outfall Number	# 007	# 007	# 007
Dates Sample Collected	1/25/2016 - 1/26/2016	7/6/2015 - 7/7/2015	1/12/2015 - 1/13/2015
Date Test Started	1/27/2016	7/8/2015	1/14/2015
Duration	48 hrs	48 hrs	48 hrs
<b>B. Toxicity Test Methods Followed</b>			
Manual Title	USEPA. 2002. Methods for measuring the acute toxicity of effluents and receiving waters to fresh waters and marine organisms, 5th Ed. EPA-821-R-02-012		
Edition Number and Year of Publication			
Page Number(s)			
<b>C. Sample collection method(s) used. For multiple grab samples, indicate the number of grab samples used</b>			
24-Hour Composite	x	x	x
Grab			
<b>D. Indicate where the sample was taken in relation to disinfection (Check all that apply for each)</b>			
Before Disinfection	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
After Disinfection	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
After Dechlorination	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>E. Describe the point in the treatment process at which the sample was collected</b>			
Sample Was Collected:	Missouri River/Effluent	Missouri River/ Effluent	Missouri River/ Effluent
<b>F. Indicate whether the test was intended to assess chronic toxicity, acute toxicity, or both</b>			
Chronic Toxicity	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Acute Toxicity	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
<b>G. Provide the type of test performed</b>			
Static	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Static-renewal	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Flow-through	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>H. Source of dilution water. If laboratory water, specify type; if receiving water, specify source</b>			
Laboratory Water	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Receiving Water	<input checked="" type="checkbox"/> Upstream	<input checked="" type="checkbox"/> Upstream	<input checked="" type="checkbox"/> Upstream



FACILITY NAME MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 007
-------------------------------------------	---------------------------	--------------------

**PART E – TOXICITY TESTING DATA**

**17. TOXICITY TESTING DATA (continued)**

	Most Recent	2nd Most Recent	3rd Most Recent
<b>I. Type of dilution water. If salt water, specify "natural" or type of artificial sea salts or brine used.</b>			
Fresh Water	x	x	x
Salt Water			
<b>J. Percentage of effluent used for all concentrations in the test series</b>			
	40, 20	40, 20	40, 20
	10, 5.0	10, 5.0	10, 5.0
	2.5	2.5	2.5
<b>K. Parameters measured during the test (State whether parameter meets test method specifications)</b>			
pH	7.00 S.U.	7.15 S.U.	7.10 S.U.
Salinity- Conductivity	1300 Umhos/cm	840 Umhos/cm	440 Umhos/cm
Temperature	12.9 Degree Celcius	21.1 Degrees Celcius	8.10 Degree Celcius
Ammonia	<0.50 mg/L	<0.50 mg/L	1.3 mg/L
Dissolved Oxygen	9.0 mg/L	7.8 mg/L	5.8 mg/L
<b>L. Test Results</b>			
<b>Acute:</b>			
Percent Survival in 100% Effluent			
LC <sub>50</sub>	100/100	100/100	100/100
95% C.I.			
Control Percent Survival	100/100	100/100	100/100
Other (Describe) 10% Effluent (AEC)	100/100	100/100	100/100
<b>Chronic:</b>			
NOEC			
IC <sub>25</sub>			
Control Percent Survival			
Other (Describe)			
<b>M. Quality Control/ Quality Assurance</b>			
Is reference toxicant data available?	Yes/Yes	Yes/Yes	Yes/Yes
Was reference toxicant test within acceptable bounds?	Yes/Yes	Yes/Yes	Yes/Yes
What date was reference toxicant test run (MM/DD/YYYY)?	1/6/16	7/8/15	1/7/15
Other (Describe)			
Is the treatment works involved in a toxicity reduction evaluation? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			
If yes, describe:			
If you have submitted biomonitoring test information, or information regarding the cause of toxicity, within the past four and one-half years, provide the dates the information was submitted to the permitting authority and a summary of the results.			
Date Submitted (MM/DD/YYYY)			
Summary of Results (See Instructions)			

**END OF PART E**

**REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM B2 YOU MUST COMPLETE.**



**MAKE ADDITIONAL COPIES OF THIS FORM FOR EACH OUTFALL**

FACILITY NAME MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 007
-------------------------------------------	---------------------------	--------------------

**PART E – TOXICITY TESTING DATA****17. TOXICITY TESTING DATA**

Refer to the APPLICATION OVERVIEW to determine whether Part E applies to the treatment works.

Publicly owned treatment works, or POTWs, meeting one or more of the following criteria must provide the results of whole effluent toxicity tests for acute or chronic toxicity for each of the facility's discharge points.

- A. POTWs with a design flow rate greater than or equal to 1 million gallons per day
- B. POTWs with a pretreatment program (or those that are required to have one under 40 CFR Part 403)
- C. POTWs required by the permitting authority to submit data for these parameters
  - At a minimum, these results must include quarterly testing for a 12-month period within the past one year using multiple species (minimum of two species), or the results from four tests performed at least annually in the four and one-half years prior to the application, provided the results show no appreciable toxicity, and testing for acute or chronic toxicity, depending on the range of receiving water dilution. Do not include information about combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136.
  - If EPA methods were not used, report the reason for using alternative methods. If test summaries are available that contain all of the information requested below, they may be submitted in place of Part E. If no biomonitoring data is required, do not complete Part E. Refer to the application overview for directions on which other sections of the form to complete.

Indicate the number of whole effluent toxicity tests conducted in the past four and one-half years: \_\_\_\_\_ chronic 9 acute

Complete the following chart for the last three whole effluent toxicity tests. Allow one column per test. Copy this page if more than three tests are being reported.

	4th Most Recent		
<b>A. Test Information</b>			
Test Method Number	P. Promelas/C.Dubia		
Final Report Number	MO-1710928		
Outfall Number	# 007		
Dates Sample Collected	7/7/2014 - 7/8/2014		
Date Test Started	7/9/2014		
Duration	48 hrs		
<b>B. Toxicity Test Methods Followed</b>			
Manual Title	USEPA. 2002. Methods for measuring the acute toxicity of effluents and receiving waters to fresh waters and marine organisms, 5th Ed. EPA-821-R-02-012		
Edition Number and Year of Publication			
Page Number(s)			
<b>C. Sample collection method(s) used. For multiple grab samples, indicate the number of grab samples used</b>			
24-Hour Composite	x		
Grab			
<b>D. Indicate where the sample was taken in relation to disinfection (Check all that apply for each)</b>			
Before Disinfection	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
After Disinfection	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
After Dechlorination	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>E. Describe the point in the treatment process at which the sample was collected</b>			
Sample Was Collected:	Missouri River/ Effluent		
<b>F. Indicate whether the test was intended to assess chronic toxicity, acute toxicity, or both</b>			
Chronic Toxicity	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Acute Toxicity	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>G. Provide the type of test performed</b>			
Static	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Static-renewal	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Flow-through	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>H. Source of dilution water. If laboratory water, specify type; if receiving water, specify source</b>			
Laboratory Water	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Receiving Water	<input checked="" type="checkbox"/> Upstream	<input type="checkbox"/>	<input type="checkbox"/>



FACILITY NAME MSD, Missouri River WWTP	PERMIT NO. MO- 0004391	OUTFALL NO. 007
-------------------------------------------	---------------------------	--------------------

**PART E – TOXICITY TESTING DATA**
**17. TOXICITY TESTING DATA (continued)**

	4th Most Recent		
I. Type of dilution water. If salt water, specify "natural" or type of artificial sea salts or brine used.			
Fresh Water	x		
Salt Water			
J. Percentage of effluent used for all concentrations in the test series			
	40, 20		
	10, 5.0		
	2.5		
K. Parameters measured during the test (State whether parameter meets test method specifications)			
pH	7.28 S.U.		
Salinity Conductivity	910 Umhos/cm		
Temperature	23.1 Degree Celcius		
Ammonia	15 mg/L		
Dissolved Oxygen	5.4 mg/L		
L. Test Results			
Acute:			
Percent Survival in 100% Effluent			
LC <sub>50</sub>	100/100		
95% C.I.			
Control Percent Survival	100/100		
Other (Describe) 10% Effluent (AEC)	100/100		
Chronic:			
NOEC			
IC <sub>25</sub>			
Control Percent Survival			
Other (Describe)			
M. Quality Control/ Quality Assurance			
Is reference toxicant data available?	Yes/Yes		
Was reference toxicant test within acceptable bounds?	Yes/Yes		
What date was reference toxicant test run (MM/DD/YYYY)?	7/9/14		
Other (Describe)			
Is the treatment works involved in a toxicity reduction evaluation? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			
If yes, describe:			
If you have submitted biomonitoring test information, or information regarding the cause of toxicity, within the past four and one-half years, provide the dates the information was submitted to the permitting authority and a summary of the results.			
Date Submitted (MM/DD/YYYY)			
Summary of Results (See Instructions)			

**END OF PART E**
**REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM B2 YOU MUST COMPLETE.**



**MAKE ADDITIONAL COPIES OF THIS FORM FOR EACH OUTFALL**

FACILITY NAME

MSD, Missouri River WWTP

PERMIT NO.

MO- 0004391

OUTFALL NO.

005, 006, 007

**PART F – INDUSTRIAL USER DISCHARGES AND RCRA/CERCLA WASTES**

Refer to the APPLICATION OVERVIEW to determine whether Part F applies to the treatment works.

**18. GENERAL INFORMATION****18.1** Does the treatment works have, or is it subject to, an approved pretreatment program?☒ Yes☐ No**18.2** Number of Significant Industrial Users (SIUs) and Categorical Industrial Users (CIUs). Provide the number of each of the following types of industrial users that discharge to the treatment works:Number of non-categorical SIUs 28Number of CIUs 17**19. INDUSTRIES CONTRIBUTING MORE THAN 5 PERCENT OF THE ACTUAL FLOW TO THE FACILITY OR OTHER SIGNIFICANT INDUSTRIAL USERS INFORMATION**

Supply the following information for each SIU. If more than one SIU discharges to the treatment works, provide the information requested for each. Submit additional pages as necessary.

NAME

See Attachment 19

MAILING ADDRESS

CITY

STATE

ZIP CODE

**19.1** Describe all of the industrial processes that affect or contribute to the SIU's discharge

See attached

**19.2** Describe all of the principle processes and raw materials that affect or contribute to the SIU's discharge.

Principal Product(s): See Attachment 19

Raw Material(s): See Attachment 19

**19.3** Flow Rate See Attachment 19**a. PROCESS WASTEWATER FLOW RATE.** Indicate the average daily volume of process wastewater discharged into the collection system in gallons per day, or gpd, and whether the discharge is continuous or intermittent.  
gpd ☐ Continuous ☐ Intermittent**b. NON-PROCESS WASTEWATER FLOW RATE.** Indicate the average daily volume of non-process wastewater discharged into the collection system in gallons per day, or gpd, and whether the discharge is continuous or intermittent.  
gpd ☐ Continuous ☐ Intermittent**19.4** Pretreatment Standards. Indicate whether the SIU is subject to the following:**a. Local Limits** ☐ Yes ☐ No**b. Categorical Pretreatment Standards** ☐ Yes ☐ No

If subject to categorical pretreatment standards, which category and subcategory?

See Attachment 19

**19.5** Problems at the treatment works attributed to waste discharged by the SIU. Has the SIU caused or contributed to any problems (e.g., upsets, interference) at the treatment works in the past three years?☒ Yes☐ No

If Yes, describe each episode

Bridgeton Landfill discharged unusually high strength landfill leachate, due to an ongoing "thermal event" at the landfill, to the Metropolitan St. Louis Sewer District's (MSD's) system. This discharge caused MSD's Missouri River treatment plant to exceed its discharge limit under MSD's Missouri State Operating Permit. MSD issued a Cease and Desist order to Bridgeton Landfill on January 10, 2013. Bridgeton Landfill is currently limited by a BOD mass limit for its leachate discharge to MSD, and is required to install a pretreatment system to reduce the strength of its leachate discharge to levels that MSD can properly treat.



## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

ACCOUNT NO	INDUSTRY NAME	MAILING ADDRESS	CITY	STATE	ZIP	BUSINESS DESC	CATEGORIES
------------	---------------	-----------------	------	-------	-----	---------------	------------

## Missouri River

1007473401	A SQUARE SYSTEMS	11923 Borman Drive	St. Louis	MO	63146	Job shop precious metal electroplater	SIU CIU
------------	------------------	--------------------	-----------	----	-------	---------------------------------------	---------

## Raw Materials:

Plating chemicals  
Silver  
Copper  
Nickel  
Tin  
Gold Salts

## Product/Service:

Job shop electroplating-precious & non metals

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
002	Categorical	From 902	BATCH	DILUTE	6,535	Gallons per Day	
902	Categorical	413 Sub A & B JS L10K PSES	BATCH	REGULATED	6,535	Gallons per Day	
002	Sanitary		CONT	DILUTE	600	Gallons per Day	

## 1007538700

## AIR PRODUCTS PRISM MEMBRANES

## Raw Materials:

Polysulfone  
Gamma Butyrolactone  
Propionic Acid  
N Methyl Pyrrolidone Formliperidine

## Product/Service:

Hollow fiber membrane separators

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
003	Boiler Blowdown		BATCH	DILUTE	100	Gallons per Day	
003	Non Contact Cooling Water		BATCH	DILUTE	2,500	Gallons per Day	
003	Plant & Equipment Washdown		BATCH	DILUTE	200	Gallons per Day	
003	Process Waste	Fiber curing/cooling	BATCH	DILUTE	110,000	Gallons per Day	
003	Sanitary		CONT	DILUTE	4,400	Gallons per Day	



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

ACCOUNT NO	INDUSTRY NAME	MAILING ADDRESS	CITY	STATE	ZIP	BUSINESS DESC	CATEGORIES
------------	---------------	-----------------	------	-------	-----	---------------	------------

1007623600	BARNES-JEWISH WEST COUNTY HOSPITAL	12634 Olive Boulevard	St Louis	MO	63141	Surgical Hospital & Rehabilitation Center	SIU
------------	------------------------------------	-----------------------	----------	----	-------	-------------------------------------------	-----

Raw Materials:

Product/Service:

Hospital care &amp; surgery

Discharge

Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
002	Boiler Blowdown		BATCH	DILUTE	50	Gallons per Day	
002	Non Contact Cooling Water	includes cooling tower blowdown	BATCH	DILUTE	5,626	Gallons per Day	
002	Plant & Equipment Washdown		BATCH	DILUTE	6,094	Gallons per Day	
002	Sanitary		CONT	DILUTE	21,096	Gallons per Day	
002	Hospital Waste	including kitchen, laundry, and labs	BATCH	DILUTE	11,720	Gallons per Day	

1044826000

BELTSERVICE CORP

4143 Rider Trail North

Earth City

MO 63045

Manufacturer of rubber conveyor belts

Raw Materials:

Product/Service:

Conveyor belts

Rubber stock

Adhesives

Cotton

Polyurethral polymers

Discharge

Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Boiler Blowdown		BATCH	DILUTE	20	Gallons per Day	
001	Categorical		BATCH	REGULATED	3,900	Gallons per Day	
001	Non-Categorical Process Waste	428 Sub F PSNS (Pb NA) (CWF-yes)	BATCH	DILUTE	495	Gallons per Day	
001	Non Contact Cooling Water	Waterjet	BATCH	DILUTE	1,000	Gallons per Day	
001	Sanitary		CONT	DILUTE	5,750	Gallons per Day	
001	Regeneration/Reject Water		BATCH	DILUTE	40	Gallons per Day	

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 2 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

## CATEGORIES

ACCOUNT NO INDUSTRY NAME

MAILING ADDRESS

CITY STATE ZIP

BUSINESS DESC

1041854800 BFI WASTE SYSTEMS OF NORTH 1700 Holzer Dr. Arnold MO 63010 Closed landfill SIU  
AMERICA INC

Raw Materials:

Product/Service:

Closed Landfill

Discharge

Component Info:

PROCESS DESCRIPTIONDISCHARGE COMPONENTDISCHARGE ISSTREAM ISAVG FLOWUNITDESC

004 Sanitary  
001 Landfill Leachate  
001 Condensate  
Methane burnoff condensate  
BRIDGETON LANDFILL LLC 13570 St. Charles Rock Road Bridgeton MO 63044 Inactive municipal solid waste landfill SIU

Raw Materials:

Product/Service:

Closed landfill

Discharge

Component Info:

PROCESS DESCRIPTIONDISCHARGE COMPONENTDISCHARGE ISSTREAM ISAVG FLOWUNITDESC

014 Plant & Equipment Washdown Transfer station & jetter trucks  
013 Plant & Equipment Washdown Transfer station & jetter trucks  
010 Storm Water Stormwater runoff  
011 Storm Water Stormwater runoff  
009 Storm Water Stormwater runoff/retention basin  
004 Storm Water Stormwater runoff/retention basin  
012 Storm Water Stormwater runoff  
013 Storm Water Contaminated from leachate spills  
014 Landfill Leachate Incl. underground thermal event & gas condensate  
013 Landfill Leachate Incl. underground thermal event & gas condensate  
013 Cooling Tower Blowdown

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 3 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

## CATEGORIES

## ACCOUNT NO INDUSTRY NAME

## MAILING ADDRESS

## CITY STATE ZIP

## BUSINESS DESC

## SIU CIU

1007615200 CHEMIA CORP

11558 Rock Island Court

Maryland H. MO 63043

Manufacturer of detergents,  
cleaners, fragrances

Raw Materials:

Surfactants  
Alcohols  
Oils  
Water  
Aroma chemicals

## Product/Service:

Shampoo  
Lotions  
Toiletries  
Blended fragrances

## Discharge

## Component Info:

## PROCESS DESCRIPTION

## DISCHARGE COMPONENT

## DISCHARGE IS

## STREAM IS

## AVG FLOW

## UNIT

## DESC

SP	002	Boiler Blowdown	BATCH	DILUTE	5	Gallons per Day
002	Categorical	417 Sub P PSNS	BATCH	REGULATED	200	Gallons per Day
002	Non Contact Cooling Water	Jacketed blending vessel	BATCH	DILUTE	100	Gallons per Day
002	Sanitary		CONT	DILUTE	800	Gallons per Day

1037797501

COOPER BUSSMANN LLC

P. O. Box 14460

St. Louis

MO 63178 Fuse and circuit protection  
devices manufacturer

SIU CIU

## Raw Materials:

## Product/Service:

Circuit protection devices

Brass  
Copper  
Zinc  
Steel  
Silver  
Tin

## Discharge

## Component Info:

## PROCESS DESCRIPTION

## DISCHARGE COMPONENT

## DISCHARGE IS

## STREAM IS

## AVG FLOW

## UNIT

## DESC

SP	902	Categorical	CONT	REGULATED	25,598	Gallons per Day
904	Categorical	433 A PSES (incl flow from SP 904)	CONT	DILUTE	3,000	Gallons per Day
002	Categorical	433 Sub A PSES (CN only)	BATCH	DILUTE	25,598	Gallons per Day
002	Plant & Equipment Washdown	from SPs 902 and 904	BATCH	DILUTE	500	Gallons per Day
002	Process Waste	Fuse assembly/Cu stamping	BATCH	DILUTE	2,000	Gallons per Day
002	Sanitary		CONT	DILUTE	6,000	Gallons per Day

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 4 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

## CATEGORIES

ACCOUNT NO INDUSTRY NAME MAILING ADDRESS CITY STATE ZIP BUSINESS DESC

SIU

1007622400 COTT BEVERAGES USA 2525 Schuetz Road Maryland H. MO 63043 Soft drink bottling

## Raw Materials:

Product/Service: Soft drinks

Water  
 Sugar  
 High fructose corn syrup  
 Flavors  
 Aspartame  
 Sodium benzoate  
 Caffeine

Discharge  
Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Boiler Blowdown		BATCH	DILUTE	5,700	Gallons per Day	
002	Contact Cooling Water	Cools vacuum chamber	CONT	DILUTE	25,000	Gallons per Day	
002	Non Contact Cooling Water	Cools ammonia compressors	CONT	DILUTE	2,000	Gallons per Day	
001	Plant & Equipment Washdown	Floors, tanks, lines, etc.	BATCH	DILUTE	30,000	Gallons per Day	
002	Plant & Equipment Washdown		BATCH	DILUTE	10,000	Gallons per Day	
001	Process Waste	CIP system for tanks, & lines	BATCH	DILUTE	69,000	Gallons per Day	
004	Sanitary	One toilet in warehouse	CONT	DILUTE	1	Gallons per Day	
002	Sanitary		CONT	DILUTE	3,999	Gallons per Day	
001	Regeneration/Reject Water	Water softener regeneration waste	BATCH	DILUTE	500	Gallons per Day	

## 1003808800

ENVIROPAK CORPORATION

4203 Shoreline Ct.

Earth City

MO 63045

Manufacturer of molded paper

SIU CIU

## Raw Materials:

Product/Service:

Molded paper pulp packaging

Recycled newsprint

Discharge  
Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Categorical	430 Sub J PSNS (No biocides)	BATCH	REGULATED	6,102	Gallons per Day	
001	Sanitary		CONT	DILUTE	1,060	Gallons per Day	
001	Cooling Tower Blowdown		BATCH	DILUTE	5	Gallons per Day	

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 5 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

ACCOUNT NO	INDUSTRY NAME	MAILING ADDRESS	CITY	STATE	ZIP	BUSINESS DESC	CATEGORIES
------------	---------------	-----------------	------	-------	-----	---------------	------------

1003798900	HUSSMANN CORP	12999 St. Charles Rock Rd. Bridgeton	MO	63044	Manufacturer of refrigerator cases	SIU CIU
------------	---------------	--------------------------------------	----	-------	------------------------------------	---------

Raw Materials:	Sheet metal	Product/Service:	Refrigerator display cases
----------------	-------------	------------------	----------------------------

Aluminum tubing
Copper tubing
Powder Coatings

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
902	Categorical	433 Sub A PSNS	BATCH	DILUTE	2,331	Gallons per Day	
003	Categorical	From SP902	BATCH	DILUTE	2,331	Gallons per Day	
001	Non-Categorical Process Waste	Vehicle/Equipment wash	BATCH	DILUTE	500	Gallons per Day	
005	Sanitary		CONT	DILUTE	265	Gallons per Day	
001	Sanitary		CONT	DILUTE	5,050	Gallons per Day	
004	Sanitary		CONT	DILUTE	423	Gallons per Day	
003	Sanitary		CONT	DILUTE	2,765	Gallons per Day	
001	Kitchen Waste	Serving Cafe	BATCH	DILUTE	175	Gallons per Day	
001	Cooling Tower Blowdown		BATCH	DILUTE	60	Gallons per Day	
001	Condensate		BATCH	DILUTE	44	Gallons per Day	

## 1007548100

HY-C COMPANY INC

10950 Linpage Pl.

St. Louis

MO

SIU CIU

## Raw Materials:

Stainless steel
Aluminum
Powder paint
Carbon steel

## Product/Service:

Chimney covers
Log racks

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
901	Categorical	433 Sub A PSNS	BATCH	REGULATED	4,549	Gallons per Day	
001	Categorical	From SP 901	BATCH	DILUTE	4,549	Gallons per Day	
001	Non Contact Cooling Water	Cool welding machine heads	CONT	DILUTE	1,890	Gallons per Day	
001	Sanitary		CONT	DILUTE	900	Gallons per Day	

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 6 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

## CATEGORIES

ACCOUNT NO INDUSTRY NAME

MAILING ADDRESS

CITY STATE ZIP

BUSINESS DESC

SIU

TX 76177 Limestone quarry and landfill

2301 Eagle Parkway, Suite Fort Worth  
200

IESI MO CHAMP LANDFILL

1038179200

Raw Materials:

Quarry gravel  
Household refuse

Product/Service:

Sanitary landfill  
Construction grade limestone

Discharge

Component Info:

SP

DISCHARGE COMPONENT

PROCESS DESCRIPTION

DISCHARGE IS

STREAM IS

AVG FLOW

UNIT

DESC

001

Process Waste

Methane-extract. returned gas condensate  
Ameren

DILUTE

984

Gallons per Day

004

Sanitary

Septic tank for Old Stone Office Bldg

DILUTE

100

Gallons per Day

003

Sanitary

From Truck Scale House building

DILUTE

361

Gallons per Day

002

Sanitary

From Truck Scale House building

DILUTE

32

Gallons per Day

001

Landfill Leachate

DILUTE

34,631

Gallons per Day

LAIRD TECHNOLOGIES

1045110500

3481 Rider Trail South Earth City

MO 63045 EMI shielding materials  
manufacturer

SIU

CIU

Raw Materials:

Fabric  
Metal salts  
Metallized materials  
Urethane foams

Product/Service:

Electron (TM) Metallized Fabric & Films  
EMI shielding

Discharge

Component Info:

SP

DISCHARGE COMPONENT

PROCESS DESCRIPTION

DISCHARGE IS

STREAM IS

AVG FLOW

UNIT

DESC

002

Boiler Blowdown

433 Sub A PSNS (including lab waste)  
from SP 901

DILUTE

100

Gallons per Day

901

Categorical

REGULATED

1,100

Gallons per Day

002

Categorical

DILUTE

1,100

Gallons per Day

001

Sanitary

DILUTE

2,500

Gallons per Day

002

Regeneration/Reject Water

Softening and RO

DILUTE

600

Gallons per Day

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 7 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



1007564900

LEE BIOSOLUTIONS INC

10850 Metro Ct

Maryland H. MO

63043

Purification of enzymes and proteins

SIU

CIU

Raw Materials:

Animal and human source material

Product/Service:

Enzymes and protein for diagnostic uses

Discharge Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Categorical	439 Sub B&D PSES (CWF-yes)	BATCH	REGULATED	1,250	Gallons per Day	
001	Plant & Equipment Washdown		BATCH	UNREG	760	Gallons per Day	
001	Sanitary		CONT	DILUTE	625	Gallons per Day	
001	Laboratory Waste		BATCH	UNREG	350	Gallons per Day	
001	Regeneration/Reject Water		BATCH	DILUTE	100	Gallons per Day	

1007641600

MALLINCKRODT LLC

2703 Wagner Place

Maryland H. MO 63043

Nuclear medicine manufacturer

SIU

Raw Materials:

Radioactive Iodine

Thallium

Molybdenum

Technetium

Thorium

Product/Service:

Radioactive pharmaceuticals

Discharge Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
006	Boiler Blowdown		BATCH	DILUTE	9,155	Gallons per Day	
002	Boiler Blowdown		BATCH	DILUTE	3,022	Gallons per Day	
006	Non-Categorical Process Waste	Radioactive diagnostic operations	BATCH	DILUTE	23,765	Gallons per Day	
006	Non Contact Cooling Water	Cooling tower, Chiller	BATCH	DILUTE	5,033	Gallons per Day	
001	Plant & Equipment Washdown	Disinfect process tanks & lines	BATCH	DILUTE	500	Gallons per Day	
007	Plant & Equipment Washdown		BATCH	DILUTE	500	Gallons per Day	
002	Plant & Equipment Washdown	Disinfect process tanks & lines	BATCH	DILUTE	500	Gallons per Day	
006	Plant & Equipment Washdown		BATCH	DILUTE	3,954	Gallons per Day	
003	Plant & Equipment Washdown	Disinfect process tanks & lines	BATCH	DILUTE	500	Gallons per Day	
006	Process Waste	Radioactive Material Processing	BATCH	DILUTE	3,000	Gallons per Day	
002	Sanitary		CONT	DILUTE	2,500	Gallons per Day	
001	Sanitary		CONT	DILUTE	500	Gallons per Day	
006	Sanitary		CONT	DILUTE	4,500	Gallons per Day	
007	Sanitary		CONT	DILUTE	500	Gallons per Day	
002	Laboratory Waste	QC for radioactive diagnostic operations	BATCH	DILUTE	500	Gallons per Day	
001	Laboratory Waste	QC Lab	BATCH	DILUTE	250	Gallons per Day	
003	Laboratory Waste	QC for radioactive diagnostic operations	BATCH	DILUTE	750	Gallons per Day	
006	Laboratory Waste		BATCH	DILUTE	150	Gallons per Day	
006	Regeneration/Reject Water		BATCH	DILUTE	9,359	Gallons per Day	



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

## CATEGORIES

ACCOUNT NO INDUSTRY NAME

MAILING ADDRESS CITY STATE ZIP BUSINESS DESC

1040996400 MARK ANDY INC 18081 Chesterfield Airport Chesterfield MO 63005 Manufacturer of flexographic printing presses SIU CIU  
Road

Raw Materials: Aluminum  
Steel  
Paint

Product/Service:

Flexographic printing presses

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
902	Categorical	433 Sub A PSES	CONT	REGULATED	6,575	Gallons per Day	
001	Categorical	from SP902	CONT	DILUTE	6,575	Gallons per Day	
001	Non-Categorical Process Waste	Ultrasonic parts clean+ink roll machine	BATCH	DILUTE	40	Gallons per Day	
001	Plant & Equipment Washdown		BATCH	DILUTE	20	Gallons per Day	
001	Sanitary		CONT	DILUTE	8,010	Gallons per Day	

1037538200

MONSANTO COMPANY

800 N. Lindbergh Blvd. St. Louis

MO 63167 Plant research laboratory

SIU

Raw Materials:

Laboratory chemicals

Product/Service:

Plant research

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Boiler Blowdown		BATCH	DILUTE	10,385	Gallons per Day	
001	Process Waste	40 CFR 439 Sub E NA (No Std's)	BATCH	DILUTE	308,088	Gallons per Day	
002	Sanitary		CONT	DILUTE	23,250	Gallons per Day	
001	Kitchen Waste	Dishwasher & pot washer	BATCH	DILUTE	1,687	Gallons per Day	
001	Regeneration/Reject Water	RO water systems	BATCH	DILUTE	6,946	Gallons per Day	
001	Cooling Tower Blowdown		BATCH	DILUTE	66,753	Gallons per Day	

Report No. PIMS074A

6/1/2016

10:33:55AM

Data Date &amp; Time

6/1/2016

10:33:51AM



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

## CATEGORIES

ACCOUNT NO INDUSTRY NAME MAILING ADDRESS CITY STATE ZIP BUSINESS DESC

1007620300 NESHER PHARMACEUTICALS 13910 St. Charles Rock Rd. Bridgeton MO 63044 Pharmaceutical manufacturing SIU CIU  
(USA) LLC

Raw Materials: Active pharmaceutical ingredients and excipients Product/Service: Prescription pharmaceuticals

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
002	Boiler Blowdown		BATCH	DILUTE	100	Gallons per Day	
002	Categorical	439 Sub D PSNS (CWF-yes)	BATCH	REGULATED	2,562	Gallons per Day	
002	Non Contact Cooling Water		BATCH	DILUTE	1,083	Gallons per Day	
001	Sanitary		CONT	DILUTE	1,140	Gallons per Day	
002	Regeneration/Reject Water	From USP water system	BATCH	DILUTE	1,478	Gallons per Day	

1007540400 ORIGINAL CAST LIGHTING INC 11902 Lackland Rd. St. Louis MO 63146 Manufacture of ornamental lighting SIU CIU

## Raw Materials:

Aluminum  
Brass  
Steel  
Electrical components  
Ornamental light fixture manufacture & sales

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
901	Categorical	433 Sub A PSNS	BATCH	REGULATED	1,440	Gallons per Day	
002	Categorical	From SP901	BATCH	DILUTE	288	Gallons per Day	
001	Non-Categorical Process Waste	Wet spray test	BATCH	DILUTE	800	Gallons per Day	
001	Plant & Equipment Washdown	Mobile floor scrubber	BATCH	DILUTE	25	Gallons per Day	
002	Sanitary		CONT	DILUTE	60	Gallons per Day	
001	Sanitary		CONT	DILUTE	660	Gallons per Day	
002	Wastewater From Other Tenants		CONT	DILUTE	800	Gallons per Day	
002	Condensate		BATCH	DILUTE	1	Gallons per Day	



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

ACCOUNT NO	INDUSTRY NAME	MAILING ADDRESS	CITY	STATE	ZIP	BUSINESS DESC	CATEGORIES
------------	---------------	-----------------	------	-------	-----	---------------	------------

1003798000	PM RESOURCES INC	13001 St. Charles Rock Road	Bridgeton	MO	63044	Pharmaceutical manufacturer	SIU CIU
------------	------------------	-----------------------------	-----------	----	-------	-----------------------------	---------

Raw Materials:	Pharmaceuticals	Product/Service:	Pharmaceuticals
	Solvents		
	Surfactants		

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Boiler Blowdown		BATCH	DILUTE	600	Gallons per Day	
001	Categorical	from SP-913	BATCH	DILUTE	6,200	Gallons per Day	
913	Categorical	439 Sub D PSES+PSNS	BATCH	REGULATED	6,200	Gallons per Day	
001	Non Contact Cooling Water		BATCH	DILUTE	1,000	Gallons per Day	
001	Plant & Equipment Washdown	from non-cat processes	BATCH	DILUTE	2,900	Gallons per Day	
001	Sanitary		CONT	DILUTE	6,000	Gallons per Day	
001	Laboratory Waste	QC lab, R&D lab	BATCH	DILUTE	500	Gallons per Day	
001	Regeneration/Reject Water		BATCH	DILUTE	2,100	Gallons per Day	

## 1007526300

## RHEIN PRECISION

2269 Grissom Drive	St. Louis	MO 63146	Manufacturer of surgical instruments	SIU CIU
--------------------	-----------	----------	--------------------------------------	---------

## Raw Materials:

Titanium alloy	Surgical instruments
Stainless steel	
Sand	
Aluminum	

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
903	Categorical	433 Sub A PSNS	BATCH	REGULATED	3	Gallons per Day	
001	Categorical	flow from SP 903	BATCH	DILUTE	3	Gallons per Day	
001	Plant & Equipment Washdown	includes janitorial cleaning	BATCH	DILUTE	3	Gallons per Day	
001	Process Waste	EDM cutter, milling, waterjet cutter	BATCH	DILUTE	290	Gallons per Day	
001	Sanitary		CONT	DILUTE	600	Gallons per Day	
001	Regeneration/Reject Water		BATCH	DILUTE	3	Gallons per Day	



PIMS

DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

CATEGORIES

ACCOUNT NO INDUSTRY NAME

MAILING ADDRESS CITY STATE ZIP BUSINESS DESC

1044787300

SENSORY EFFECTS FLAVOR SYSTEMS

231 Rock Industrial Park D Bridgeton

MO 63044 Food flavoring manufacturer

SIU

Raw Materials:

Cocoa  
Whey  
Whey protein  
Fruit  
Fruit juice  
Eggs  
Milk  
Flavor  
Sweetener  
Water

Product/Service:

Chocolate dairy powder  
Fruit juice concentrates  
Eggnog base  
Coffee creamer

Discharge

Component Info:

PROCESS DESCRIPTION

DISCHARGE COMPONENT

SP

DISCHARGE IS STREAM IS AVG FLOW UNIT DESC

008 Boiler Blowdown  
008 Non Contact Cooling Water  
008 Plant & Equipment Washdown  
008 Process Waste  
008 Sanitary  
006 Sanitary  
007 Sanitary  
008 Condensate  
includes the Labs  
steam condensate

BATCH DILUTE 374 Gallons per Day  
BATCH DILUTE 1,000 Gallons per Day  
BATCH DILUTE 53,868 Gallons per Day  
BATCH DILUTE 1,704 Gallons per Day  
CONT DILUTE 2,100 Gallons per Day  
CONT DILUTE 1,100 Gallons per Day  
CONT DILUTE 2,800 Gallons per Day  
BATCH DILUTE 7,329 Gallons per Day

Report No. PIMS074A

6/1/2016

10:33:55AM

Data Date & Time

6/1/2016

10:33:51AM

Page 13 of 16



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

ACCOUNT NO	INDUSTRY NAME	MAILING ADDRESS	CITY	STATE	ZIP	BUSINESS DESC	CATEGORIES
------------	---------------	-----------------	------	-------	-----	---------------	------------

1007562400	SENTIO BIOSCIENCES LLC	218 B Millwell Dr.	Maryland H.	MO	63043	Manufacturer of pharmaceuticals	SIU CIU
------------	------------------------	--------------------	-------------	----	-------	---------------------------------	---------

Raw Materials:	Sulfuric acid, Hydrochloric acid	Product/Service:	Pentosan Polysulfate Sodium
	Polysulfate sodium		Melarsomine

Dimethylformamide

Methanol, Ethanol

Pyridine, Xylan

Sodium Hydroxide, Ammonium Hydroxide

Bleach

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
901	Categorical	439 Sub B&C PSNS	BATCH	DILUTE	620	Gallons per Day	
002	Process Waste	From SP901	BATCH	DILUTE	620	Gallons per Day	
002	Sanitary		CONT	DILUTE	500	Gallons per Day	
002	Wastewater From Other Tenants	Amer Dream & Simutronics (sanitary only)	CONT	DILUTE	800	Gallons per Day	
002	Regeneration/Reject Water		CONT	DILUTE	900	Gallons per Day	

1003783600

SSM HEALTH DEPAUL  
HOSPITAL-ST LOUIS

12303 De Paul Dr

Bridgeton

MO 63044 Full patient care hospital

SIU

## Raw Materials:

Medicines  
Bandages

Product/Service:

Hospital services

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Boiler Blowdown		BATCH	DILUTE	1,000	Gallons per Day	
001	Plant & Equipment Washdown		BATCH	DILUTE	250	Gallons per Day	
001	Sanitary		CONT	DILUTE	249	Gallons per Day	
002	Sanitary		CONT	DILUTE	89,976	Gallons per Day	
001	Hospital Waste		BATCH	DILUTE	4,521	Gallons per Day	
002	Hospital Waste		CONT	DILUTE	49,613	Gallons per Day	
001	Kitchen Waste		BATCH	DILUTE	3,000	Gallons per Day	
002	Wastewater From Other Tenants	San from Sansone & Lily Bridge Co.	BATCH	DILUTE	1,800	Gallons per Day	
001	Cooling Tower Blowdown		BATCH	DILUTE	5,665	Gallons per Day	

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 14 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

## CATEGORIES

ACCOUNT NO INDUSTRY NAME MAILING ADDRESS CITY STATE ZIP BUSINESS DESC

1007649800 ST LUKE'S HOSPITAL 232 S. Woods Mill Rd. Chesterfield MO 63017 Hospital services SIU

Raw Materials:

Product/Service: Hospital

Discharge

Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
001	Boiler Blowdown		BATCH	DILUTE	6,000	Gallons per Day	
002	Boiler Blowdown		BATCH	DILUTE	800	Gallons per Day	
002	Plant & Equipment Washdown		BATCH	DILUTE	5,400	Gallons per Day	
001	Plant & Equipment Washdown		BATCH	DILUTE	6,000	Gallons per Day	
001	Sanitary		CONT	DILUTE	130,609	Gallons per Day	
002	Sanitary		CONT	DILUTE	6,000	Gallons per Day	
002	Hospital Waste		CONT	DILUTE	3,700	Gallons per Day	
001	Hospital Waste		CONT	DILUTE	48,950	Gallons per Day	
001	Kitchen Waste		CONT	DILUTE	16,000	Gallons per Day	
002	Kitchen Waste		BATCH	DILUTE	100	Gallons per Day	
001	Cooling Tower Blowdown		BATCH	DILUTE	34,188	Gallons per Day	
002	Cooling Tower Blowdown		BATCH	DILUTE	4,200	Gallons per Day	

1007646100 STANGE COMPANY

2324 Weldon Parkway St. Louis MO 63146

Jewelry manufacturer

SIU CIU

Raw Materials:

Product/Service:

Fraternal jewelry, emblems, rings  
Service and recognition awards

Discharge

Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
002	Categorical	433 Sub A PSNS	BATCH	REGULATED	340	Gallons per Day	
003	Plant & Equipment Washdown		BATCH	DILUTE	10	Gallons per Day	
003	Sanitary		CONT	DILUTE	348	Gallons per Day	
003	Regeneration/Reject Water		BATCH	DILUTE	10	Gallons per Day	

Report No. PIMS074A

6/1/2016 10:33:55AM

Data Date &amp; Time

6/1/2016 10:33:51AM

Page 15 of 16



## PIMS

## DATA FOR NPDES APPLICATIONS PART F (INDUSTRIAL USER DISCHARGES)

ACCOUNT NO	INDUSTRY NAME	MAILING ADDRESS	CITY	STATE	ZIP	BUSINESS DESC	CATEGORIES
------------	---------------	-----------------	------	-------	-----	---------------	------------

1043601500	YOUNG DENTAL MANUFACTURING CO	13705 Shoreline Ct East	Earth City	MO	63045	Dental appliance manufacturer	SIU CIU
------------	----------------------------------	-------------------------	------------	----	-------	-------------------------------	---------

Raw Materials:	Stainless steel	Product/Service:	Attachments for dental equipment
	Mild steel		Corrosion control 'surgical milk'
	Rubber		Disclosing solution
	Polycarbonate		Toothpaste and gels
	Aluminum		Disposable prophyl angles
	Plastic resins		Cleaning solutions for dental equipment

## Discharge

## Component Info:

SP	DISCHARGE COMPONENT	PROCESS DESCRIPTION	DISCHARGE IS	STREAM IS	AVG FLOW	UNIT	DESC
902	Categorical	439 Sub D PSES	BATCH	REGULATED	125	Gallons per Day	
901	Categorical	433 Sub A PSNS	BATCH	REGULATED	50	Gallons per Day	
001	Categorical	50 gpd from 901, 125 gpd from 902	BATCH	DILUTE	175	Gallons per Day	
001	Non-Categorical Process Waste	Tumbler rinse	BATCH	DILUTE	15	Gallons per Day	
001	Non-Categorical Process Waste	417 Sub H NA (Gen Stds Only)	BATCH	DILUTE	100	Gallons per Day	
001	Plant & Equipment Washdown		BATCH	DILUTE	100	Gallons per Day	
003	Process Waste	Prophy angle wash	BATCH	DILUTE	2,200	Gallons per Day	
003	Sanitary		CONT	DILUTE	300	Gallons per Day	
001	Sanitary		CONT	DILUTE	2,245	Gallons per Day	
001	Regeneration/Reject Water		BATCH	DILUTE	200	Gallons per Day	

Total Records Selected

28

28

17

Report No. PIMS074A

6/1/2016

10:33:55AM

Page 16 of 16

Data Date &amp; Time

6/1/2016

10:33:51AM



**MAKE ADDITIONAL COPIES OF THIS FORM FOR EACH OUTFALL**

FACILITY NAME

MSD, Missouri River WWTP

PERMIT NO.

MO- 0004391

OUTFALL NO.

005, 006, 007

**PART F – INDUSTRIAL USER DISCHARGES AND RCRA/CERCLA WASTES****20. RCRA HAZARDOUS WASTE RECEIVED BY TRUCK, RAIL, OR DEDICATED PIPELINE**

**20.1** Does the treatment works receive or has it in the past three years received RCRA hazardous waste by truck, rail or dedicated pipe?  
☐ Yes ☒ No

**20.2** Method by which RCRA waste is received. (Check all that apply)  
☐ Truck ☐ Rail ☐ Dedicated Pipe

**20.3 Waste Description**

EPA Hazardous Waste Number	Amount (volume or mass)	Units

**21. CERCLA (SUPERFUND) WASTEWATER, RCRA REMEDIATION/CORRECTIVE ACTION WASTEWATER, AND OTHER REMEDIAL ACTIVITY WASTEWATER**

**21.1** Does the treatment works currently (or has it been notified that it will) receive waste from remedial activities?  
☐ Yes ☒ No

Provide a list of sites and the requested information for each current and future site.

**21.2** Waste Origin. Describe the site and type of facility at which the CERCLA/RCRA/or other remedial waste originates (or is expected to originate in the next five years).

**21.3** List the hazardous constituents that are received (or are expected to be received). Included data on volume and concentration, if known. (Attach additional sheets if necessary)

**21.4 Waste Treatment**

a. Is this waste treated (or will it be treated) prior to entering the treatment works?  
☐ Yes ☐ No

If Yes, describe the treatment (provide information about the removal efficiency):

b. Is the discharge (or will the discharge be) continuous or intermittent?  
☐ Continuous ☐ Intermittent

If intermittent, describe the discharge schedule:

**END OF PART F****REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM B2 YOU MUST COMPLETE.**