

STATE OF MISSOURI  
**DEPARTMENT OF NATURAL RESOURCES**  
**MISSOURI CLEAN WATER COMMISSION**



**MISSOURI STATE OPERATING PERMIT**

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92<sup>nd</sup> Congress) as amended,

Permit No.	MO-0089117
Owner:	The College of the Ozarks
Address:	P.O. Box 17, Point Lookout, MO 65726
Continuing Authority:	same as above
Address:	same as above
Facility Name:	College of the Ozarks
Facility Address:	174 Industrial Place, Point Lookout, MO 65726
Legal Description:	see pages two & three, Taney County
UTM Coordinates:	see pages two & three
Receiving Stream:	Tributary to Lake Taneycomo
First Classified Stream and ID:	Lake Taneycomo (L2) WBID# 7314
USGS Basin & Sub-watershed No.:	Fall Creek-Lake Taneycomo (11010003-0101)

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

**FACILITY DESCRIPTION**


Teaching college, see pages 2 and 3

This permit authorizes only wastewater and stormwater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Sections 640.013, 621.250, and 644.051.6 of the Law.

October 1, 2019  
Effective Date

  
Edward B. Galbraith, Director, Division of Environmental Quality

September 30, 2024  
Expiration Date

  
Chris Wieberg, Director, Water Protection Program

## **FACILITY DESCRIPTION (CONTINUED)**

### OUTFALL #001 – SIC # 8221, 4961

Mill Pond outfall receives excess cooling water which cannot be accepted by the drinking water treatment plant (MOG640013); continuous discharge.

UTM	X = 466548 Y = 4119704
Design flow:	1.46 MGD
Average flow:	0.85 MGD

### OUTFALL #002 – SIC #8221, 7999

Pool servicing drainage only; filter backwash to WWTF--connected to City of Hollister wastewater treatment facility fall 2011. Formerly swimming pool filter backwash and drainage.

UTM X = 478401 Y = 4052860

Design flow:	0.3 MGD
Average flow:	0 MGD (outfall expected to be used approximately once every three years or less)

### OUTFALL #003

Eliminated during a previous permit cycle, unknown year: former settling basin for power plant; the facility no longer burns coal. Discharge from this outfall is not authorized.

### OUTFALL #004

Eliminated; connected to City of Hollister wastewater treatment facility fall 2011; formerly swimming pool drainage and filter backwash. Discharge from this outfall is not authorized.

UTM	X = 478625, Y = 4051978
-----	-------------------------

### OUTFALL #005 – SIC # 8221, 4961

Cooling water discharge from the Rose Garden; no flow in winter.

UTM	X = 478757, Y = 4052577
Design flow:	0.4 MGD
Average flow:	0.2 MGD

### OUTFALL #006 – SIC # 8221, 4961

Cooling water discharge from the museum; no flow in winter.

UTM	X = 478358, Y = 4052650
Design flow:	0.5 MGD
Average flow:	0.25 MGD

### OUTFALL #007 – SIC # 8221, 4961

Cooling water discharge from Foster dormitory; no flow in winter.

UTM	X = 478353 Y = 4052531
Design flow:	0.5 MGD
Average flow:	0.25 MGD

### OUTFALL #008 – SIC # 8221

Cooling water discharge from the field house and ground source heat pump vault overflow; continuous discharge.

UTM	X = 478399, Y = 4052864
Design flow:	0.75 MGD
Average flow:	0.4 MGD

### OUTFALL #009 – SIC # 8221, 1422

Batch concrete plant and stormwater.

UTM	X = 473885, Y = 4052675
Drainage basin:	4.69 acres; 95 % runoff coefficient
10 Year 24 Hour Max Event:	0.66 MGD

## **FACILITY DESCRIPTION (CONTINUED)**

### OUTFALL #010 – SIC # 8221

Cooling water discharge from Barrett Dorm ground source vault, continuous discharge.

UTM X = 47885, Y = 4052675

Design flow: 0.75 MGD

Average Flow: 0.4 MGD

### PERMITTED FEATURE #011 – SIC # 8221

Intake structure, Lake Taneycomo.

UTM X = 478291, Y = 4052447

Intake design flow: 3.8 MGD

Intake average flow: 2.5 MGD

### PERMITTED FEATURE #012 – SIC # 8221

Aeration basin for dairy barn holding tank, no other waste streams permissible for this basin. Discharge from this outfall is not authorized.

UTM X = 479037, Y = 4052502

Design flow: 0 (land applied, productive agricultural use)

Average flow: 0 (land applied, productive agricultural use)

### A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

<b>OUTFALL #001</b> <i>single pass cooling water</i>	<b>TABLE A-1</b> <b>FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS</b>					
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>October 1, 2019</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited, and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
<b>LIMIT SET: M</b>						
PHYSICAL						
Flow	MGD	*		*	once/month	24 hr. total
CONVENTIONAL						
Oil & Grease	mg/L	15		10	once/month	grab
pH †	SU	6.5 to 9.0		6.5 to 9.0	once/month	grab
Total Suspended Solids	mg/L	30		20	once/month	grab
NUTRIENTS						
Phosphorus, Total (TP)	mg/L	*	*	once/month	grab	
MONITORING REPORTS SHALL BE SUBMITTED MONTHLY; THE FIRST REPORT IS DUE NOVEMBER 28, 2019. THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						

OUTFALLS #005 AND #010 <i>single pass cooling water</i>		TABLE A-2 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS				
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>October 1, 2019</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited, and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
LIMIT SET: M						
PHYSICAL						
Flow	MGD	*		*	once/month	24 hr. total
Temperature	°F	90		90	once/month	measured
Temperature Change	°F	*		*	once/month	measured
CONVENTIONAL						
Oil & Grease	mg/L	15		10	once/month	grab
pH †	SU	6.5 to 9.0		6.5 to 9.0	once/month	grab
Total Suspended Solids	mg/L	30	20	once/month	grab	
NUTRIENTS						
Phosphorus, Total (TP)	mg/L	*	*	once/month	grab	
MONITORING REPORTS SHALL BE SUBMITTED <u>MONTHLY</u> ; THE FIRST REPORT IS DUE <u>NOVEMBER 28, 2019</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						

### A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (CONTINUED)

OUTFALLS #006, #007, AND #008 <i>single pass cooling water</i>		TABLE A-2 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS				
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>October 1, 2019</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited, and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
LIMIT SET: M						
PHYSICAL						
Flow	MGD	*		*	once/month	24 hr. total
Temperature	°F	68		68	once/month	measured
Temperature Change	°F	*		*	once/month	measured
CONVENTIONAL						
Oil & Grease	mg/L	15		10	once/month	grab
pH †	SU	6.5 to 9.0		6.5 to 9.0	once/month	grab
Total Suspended Solids	mg/L	30	20	once/month	grab	
NUTRIENTS						
Phosphorus, Total (TP)	mg/L	*	*	once/month	grab	
MONITORING REPORTS SHALL BE SUBMITTED <u>MONTHLY</u> ; THE FIRST REPORT IS DUE <u>NOVEMBER 28, 2019</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						

OUTFALL #002 <i>pool drainage</i>	TABLE A-3 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS					
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>October 1, 2019</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited, and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
<b>LIMIT SET: U</b>						
PHYSICAL						
Flow	MGD	*		*	once/discharge ‡	24 hr. total
CONVENTIONAL						
Chlorine, Total Residual †	µg/L	19		9.5	once/discharge ‡	grab
Dissolved Oxygen – Minimum :	mg/L	6.0 min		6.0	once/discharge ‡	grab
pH †	SU	6.5 to 9.0		6.5 to 9.0	once/discharge ‡	grab
Settleable Solids	mL/L/hr	1.5		1.0	once/discharge ‡	grab
Nutrients						
Phosphorus, Total (TP)	mg/L	0.5		0.5	once/discharge ‡	grab
MONITORING REPORTS SHALL BE SUBMITTED ON THE 28 <sup>TH</sup> DAY OF THE MONTH FOLLOWING DISCHARGE						

## A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (CONTINUED)

OUTFALL #009 concrete plant	TABLE A-4 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS					
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>October 1, 2019</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited, and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
LIMIT SET: Q						
PHYSICAL						
Flow	MGD	*		*	once/quarter ◇	24 hr. total
Precipitation	inches	*		-	once/quarter ◇	measured
CONVENTIONAL						
Oil & Grease	mg/L	15		10	once/quarter ◇	grab
pH †	SU	6.5 to 9.0		6.5 to 9.0	once/quarter ◇	grab
Settleable Solids	mL/L/hr	1.5		1.0	once/quarter ◇	grab
Total Suspended Solids	mg/L	70	70	once/quarter ◇	grab	
NUTRIENTS						
Phosphorus, Total (TP)	mg/L	0.5	0.5	once/quarter ◇	grab	
MONITORING REPORTS SHALL BE SUBMITTED <u>QUARTERLY</u> ; THE FIRST REPORT IS DUE <u>JANUARY 28, 2020</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						

<b>PERMITTED FEATURE #011</b> <i>intake</i>	<b>TABLE A-5</b> <b>FINAL MONITORING REQUIREMENTS</b>					
The permittee is required to monitor the intake. The final requirements shall become effective on <b>October 1, 2019</b> and remain in effect until expiration of the permit. The intake shall be controlled, limited, and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
<b>LIMIT SET: M</b>						
PHYSICAL						
Intake Flow	foot/second	0.5	*	*	once/day	calculated
MONITORING REPORTS SHALL BE SUBMITTED <u>MONTHLY</u> ; THE FIRST REPORT IS DUE <u>NOVEMBER 28, 2019</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						
<b>LIMIT SET: A</b>						
REPORT						
Report Due	report	yes			report	report
MONITORING REPORTS SHALL BE SUBMITTED <u>ANNUALLY</u> ; THE FIRST REPORT IS DUE <u>FEBRUARY 28, 2020</u> .						

**A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (CONTINUED)**

PERMITTED FEATURES #12N AND #12S <i>AFO tank</i>		TABLE A-6 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS				
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on <b>October 1, 2019</b> and remain in effect until expiration of the permit. Such discharges shall be controlled, limited, and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MINIMUM	DAILY MAXIMUM	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
LIMIT SET: M						
PHYSICAL						
Freeboard in Tank	feet	1	-	*	once/month	measured
Volume Pumped	gallons	-	*	*	once/month	measured
MONITORING REPORTS SHALL BE SUBMITTED MONTHLY; THE FIRST REPORT IS DUE NOVEMBER 28, 2020.						

\* Monitoring and reporting requirement only

† Chlorine, Total Residual. This permit contains a Total Residual Chlorine (TRC) limit. This effluent limit is below the minimum quantification level (ML) of the most sensitive EPA approved CLTRC methods. The Department has determined the current acceptable ML for total residual chlorine to be 130 µg/L when using the DPD Colorimetric Method #4500 – CL G. from Standard Methods for the Examination of Waters and Wastewater. The permittee will conduct analyses in accordance with this method, or equivalent, and report actual analytical values. Measured values greater than or equal to the minimum quantification level of 130 µg/L will be considered violations of the permit and values less than the minimum quantification level of 130 µg/L will be considered to be in compliance with the permit limitation. The minimum quantification level does not authorize the discharge of chlorine in excess of the effluent limits stated in the permit.

‡ pH: the facility will report the minimum and maximum values; pH is not to be averaged

∴ Dissolved Oxygen: is a minimum value. The facility will report the minimum value for the daily report.

‡ Once/discharge means the facility will sample the effluent each time the pool is drained. The facility will report by the 28<sup>th</sup> day of the month following discharge.

◇ Quarterly sampling

MINIMUM QUARTERLY SAMPLING REQUIREMENTS			
QUARTER	MONTHS	QUARTERLY EFFLUENT PARAMETERS	REPORT IS DUE
First	January, February, March	Sample at least once during any month of the quarter	April 28 <sup>th</sup>
Second	April, May, June	Sample at least once during any month of the quarter	July 28 <sup>th</sup>
Third	July, August, September	Sample at least once during any month of the quarter	October 28 <sup>th</sup>
Fourth	October, November, December	Sample at least once during any month of the quarter	January 28 <sup>th</sup>

**B. STANDARD CONDITIONS**

In addition to specified conditions stated herein, this permit is subject to the attached Part I and Part III standard conditions dated August 1, 2014 and March 1, 2015, respectively, and hereby incorporated as though fully set forth herein.

### C. SPILLS, OVERFLOWS, AND OTHER UNAUTHORIZED DISCHARGES

1. Any spill, overflow, or other discharge(s) not specifically authorized above are unauthorized discharges. Should an unauthorized discharge cause or permit any contaminants to discharge or enter waters of the state, the unauthorized discharge must be reported to the regional office as soon as practicable but no more than 24 hours after the discovery of the discharge. If the spill or overflow occurred after hours or on the weekend, the facility must call the Department's 24 hour spill line at 573-634-2436.
2. If the unauthorized discharge was from an overflow from a no-discharge wastewater basin, the report must include all records confirming operation and maintenance records documenting proper maintenance in accordance with condition C.3. below.
3. Permittee shall adhere to the following minimum Best Management Practices (BMPs) for No-Discharge wastewater holding structures:
  - (a) To prevent unauthorized discharges, the no-discharge wastewater basin must be properly operated and maintained to contain all wastewater plus run-in and direct precipitation. During normal weather conditions, the liquid level in the storage structure shall be maintained below the upper operating level, so that adequate storage capacity is available for use during adverse weather periods. The liquid level in the storage structure should be lowered on a routine schedule based on the design storage period. Typically this should be accomplished prior to expected seasonal wet and winter climate periods. The upper operating level for uncovered storage structures is one foot below the emergency overflow level. Maintain liquid level in the no-discharge wastewater structure at least two feet from the top of the basin.
  - (b) Weekly inspection of no-discharge wastewater basins shall occur. Inspection notes will be kept at the facility and made available to the Department upon request.
  - (c) The inspection will note any issues with the no-discharge structure and will record the level of liquid as indicated by the depth marker.

### D. SPECIAL CONDITIONS

1. 316(b) Cooling Water Intake Structure
  - (a) Intakes shall be operated in a manner that minimizes impingement and entrainment by assuring the actual velocity through the intake is equal to or less than 0.5 foot per second.
  - (b) The facility shall submit annual status reports by February 28 each year, detailing any take during the previous calendar year.
  - (c) Six months prior to permit expiration, the applicant shall submit the renewal materials including and not limited to
    - (i.) detailed results of the studies below; and
      - a. Source Water Physical Data Report : 40 CFR 122.21(r)(2)
      - b. Cooling Water Intake Structure Data Report: 40 CFR 122.21(r)(3)
      - c. Cooling Water System Data Report: 40 CFR 122.21(r)(5)
      - d. Chosen Method of Compliance with Impingement Mortality Standard: 40 CFR 122.21(r)(6)
      - e. Operational Status: 40 CFR 122.21(r)(8)
    - (ii.) the selected path forward for implementing impingement modifications at the intake structure (if required); and
    - (iii.) sufficient information provided to the department to determine the best technology available and feasible for entrainment control at this facility.
  - (d) Should the facility ever withdraw greater than 125 MGD (actual intake), the facility will need to also complete the full entrainment studies.
  - (e) This permit may be reopened and modified, or alternatively revoked and reissued to: incorporate new or modified requirements applicable to existing cooling water intake structures under Section 316(b) of the Clean Water Act. In the event it is necessary for this permit to be reopened and modified, or alternatively revoked and reissued, permittee shall comply with any such new or modified requirements or standards applicable to existing cooling water intake structures under 316(b) of the Clean Water Act.
2. Water released from basins and holding tanks must be released in a controlled manner so as to prevent stream washout, channelization, or erosion.
3. The facility shall maintain a Nutrient Management Plan for the site.



#### D. SPECIAL CONDITIONS (CONTINUED)

4. Electronic Discharge Monitoring Report (eDMR) Submission System
  - (a) Discharge Monitoring Reporting Requirements. The permittee must electronically submit compliance monitoring data via the eDMR system. Standard Conditions Part I, Section B, #7 indicates the eDMR system is currently the only Department approved reporting method for this permit. Programmatic Reporting Requirements. The following reports (if required by this permit) must be electronically submitted as an attachment to the eDMR system until such a time when the current or a new system is available to allow direct input of the data: Any additional report required by the permit excluding bypass reporting. After such a system has been made available by the Department, required data shall be directly input into the system by the next report due date.
  - (b) The following shall be submitted electronically after such a system has been made available by the Department:
    - (1) General Permit Applications/Notices of Intent to discharge (NOIs);
    - (2) Notices of Termination (NOTs);
    - (3) No Exposure Certifications (NOEs);
    - (4) Low Erosivity Waivers, and Other Waivers from Stormwater Controls (LEWs); and
    - (5) Bypass reporting.
  - (c) Electronic Submission: access the eDMR system via: <https://edmr.dnr.mo.gov/edmr/E2/Shared/Pages/Main/Login.aspx>
  - (d) Electronic Reporting Waivers. The permittee must electronically submit compliance monitoring data and reports unless a waiver is granted by the Department in compliance with 40 CFR Part 127. The permittee may obtain an electronic reporting waiver by first submitting an eDMR Waiver Request Form: <http://dnr.mo.gov/forms/780-2692-f.pdf>. The Department will either approve or deny this electronic reporting waiver request within 120 calendar days. Only permittees with an approved waiver request may submit monitoring data and reports on paper to the Department for the period the approved electronic reporting waiver is effective.
5. The facility's SIC code or description is found in 40 CFR 122.26(b)(14) and/or 10 CSR 20-6.200(2) and hence the facility shall implement a Stormwater Pollution Prevention Plan (SWPPP) which must be prepared and implemented upon permit effective date. The SWPPP must be kept on-site and should not be sent to the Department unless specifically requested. The SWPPP must be reviewed and updated annually or if site conditions affecting stormwater change. The permittee shall select, install, use, operate, and maintain the Best Management Practices prescribed in the SWPPP in accordance with the concepts and methods described in: *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (EPA 833-B-09-002) published by the EPA in 2015 [https://www.epa.gov/sites/production/files/2015-11/documents/swppp\\_guide\\_industrial\\_2015.pdf](https://www.epa.gov/sites/production/files/2015-11/documents/swppp_guide_industrial_2015.pdf). The purpose of the SWPPP and the Best Management Practices (BMPs) listed herein is the prevention of pollution of waters of the state. A deficiency of a BMP means it was not effective at preventing pollution [10 CSR 20-2.010(56)] to waters of the state. Corrective action describes the steps the facility took to eliminate the deficiency.  
The SWPPP must include:
  - (a) A listing of specific contaminants and their control measures (or BMPs) and a narrative explaining how BMPs are implemented to control and minimize the amount of contaminants potentially entering stormwater.
  - (b) A map with all outfalls and structural BMPs marked.
  - (c) A schedule for at least once per month site inspections and brief written reports. The inspection report must include precipitation information for the entire period since last inspection, as well as observations and evaluations of BMP effectiveness. Throughout coverage under this permit, the facility must perform ongoing SWPPP review and revision to incorporate any site condition changes.
    - i. Operational deficiencies must be corrected within seven (7) calendar days.
    - ii. Minor structural deficiencies must be corrected within fourteen (14) calendar days.
    - iii. Major structural deficiencies (deficiencies projected to take longer than 14 days to correct) must be reported as an uploaded attachment through the eDMR system with the DMRs. The initial report shall consist of the deficiency noted, the proposed remedies, the interim or temporary remedies (including proposed timing of the placement of the interim measures), and an estimate of the timeframe needed to wholly complete the repairs or construction. If required by the Department, the permittee shall work with the regional office to determine the best course of action. The permittee should consider temporary structures to control stormwater runoff. The facility shall correct the major structural deficiency as soon as reasonably achievable.
    - iv. All actions taken to correct the deficiencies shall be included with the written report, including photographs, and kept with the SWPPP. Additionally, corrective action of major structural deficiencies shall be reported as an uploaded attachment through the eDMR system with the DMRs.
    - v. BMP failure causing discharge through an unregistered outfall is considered an illicit discharge and must be reported in accordance with Standard Conditions Part I.
    - vi. Inspection reports must be kept on site with the SWPPP and maintained for a period of five (5) years. These must be made available to Department personnel upon request. Electronic versions of the documents and photographs are acceptable.

D. SPECIAL CONDITIONS (CONTINUED)

- (d) A provision for designating an individual to be responsible for environmental matters and a provision for providing training to all personnel involved in housekeeping, material handling (including but not limited to loading and unloading), storage, and staging of all operational, maintenance, storage, and cleaning areas. Proof of training shall be submitted upon request by the Department.
6. Permittee shall adhere to the following minimum Best Management Practices (BMPs):
- (a) Prevent the spillage or loss of fluids, oil, grease, fuel, etc. from vehicle maintenance, equipment cleaning, warehouse activities, and other areas and thereby prevent the contamination of stormwater from these substances.
  - (b) Provide collection facilities and arrange for proper disposal of waste products including but not limited to petroleum waste products, and solvents.
  - (c) Store all paint, solvents, petroleum products and petroleum waste products (except fuels), and storage containers (such as drums, cans, or cartons) so these materials are not exposed to stormwater or provide other prescribed BMPs such as plastic lids and/or portable spill pans to prevent the commingling of stormwater with container contents. Commingled water may not be discharged under this permit. Provide spill prevention control, and/or management sufficient to prevent any spills of these pollutants from entering waters of the state. Any containment system used to implement this requirement shall be constructed of materials compatible with the substances contained and shall also prevent the contamination of groundwater. Spill records should be retained on-site.
  - (d) Provide good housekeeping practices on the site to keep trash from entry into waters of the state.
  - (e) Provide sediment and erosion control sufficient to prevent or control sediment loss off of the property
  - (f) Ensure adequate provisions are provided to prevent and to protect embankments from erosion.
7. Before releasing water accumulated in petroleum secondary containment areas, it must be examined for hydrocarbon odor and presence of sheen to protect the general criteria found at 10 CSR 20-7.031(4). If odor or sheen is found, the water shall not be discharged without treatment and shall be disposed of in accordance with legally approved methods, such as being sent to a wastewater treatment facility.
- If the facility wishes to discharge the accumulated stormwater with hydrocarbon odor or presence of sheen, the water shall be treated using an appropriate method. Following treatment and before release, the water shall be tested for oil and grease, benzene, toluene, ethylbenzene, and xylene using 40 CFR part 136 methods. All pollutant levels must be below the most protective, applicable standards for the receiving stream, found in 10 CSR 20-7.031 Table A before discharge is authorized. Records of all testing and treatment of water accumulated in secondary containment shall be stored in the SWPPP and be available on demand to the Department.
8. The full implementation of this operating permit, which includes implementation of any applicable schedules of compliance, shall constitute compliance with all applicable federal and state statutes and regulations in accordance with §644.051.16, RSMo, and the CWA section 402(k); however, this permit may be reopened and modified, or alternatively revoked and reissued to comply with any applicable effluent standard or limitation issued or approved under Clean Water Act Sections 301(b)(2)(C) and (D), §304(b)(2), and §307(a) (2), if the effluent standard or limitation so issued or approved contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or controls any pollutant not limited in the permit. This permit may be modified, revoked and reissued, or terminated for cause. The filing of a request by the permittee for a permit modification, termination, notice of planned changes, or anticipated non-compliance does not stay any permit condition.
9. All outfalls and permitted features must be clearly marked in the field. Report no discharge when a discharge does not occur during the report period. It is a violation of this permit to report no-discharge when a discharge has occurred. Unauthorized discharges, including discharges through an unregistered or unpermitted feature, must be reported in accordance with Standard Conditions Part I.

D. SPECIAL CONDITIONS (CONTINUED)

10. Changes in Discharges of Toxic Pollutant

In addition to the reporting requirements under §122.41(1), all existing manufacturing, commercial, mining, and silvicultural dischargers must notify the Director as soon as they know or have reason to believe:

- (a) That an activity has occurred or will occur which would result in the discharge, on a routine or frequent basis, of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following notification levels:
  - (1) One hundred micrograms per liter (100 µg/L);
  - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile;
  - (3) Five hundred micrograms per liter (500 µg/L) for 2,4-dinitrophenol and for 2-methyl-4, 6-dinitrophenol;
  - (4) One milligram per liter (1 mg/L) for antimony;
  - (5) Five (5) times the maximum concentration value reported for the pollutant in the permit application in accordance with 40 CFR 122.21(g)(7); or
  - (6) The notification level established by the Department in accordance with 40 CFR 122.44(f).
- (b) That any activity has occurred or will occur which would result in any discharge, on a non-routine or infrequent basis, of a toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following “notification levels”:
  - (1) Five hundred micrograms per liter (500 µg/L);
  - (2) One milligram per liter (1 mg/L) for antimony;
  - (3) Ten (10) times the maximum concentration value reported for that pollutant in the permit application in accordance with §122.21(g)(7).
  - (4) The level established by the Director in accordance with §122.44(f).

11. Reporting of Non-Detects

- (a) An analysis conducted by the permittee or their contracted laboratory shall be conducted in such a way the precision and accuracy of the analyzed result can be enumerated.
- (b) The permittee shall not report a sample result as “non-detect” without also reporting the detection limit of the test or the reporting limit of the laboratory. Reporting as “non-detect” without also including the detection/reporting limit will be considered failure to report, which is a violation of this permit.
- (c) The permittee shall report the non-detect result using the less than “<” symbol and the laboratory’s detection/reporting limit (e.g. <6).
- (d) See Standard Conditions Part I, Section A, #4 regarding proper detection limits used for sample analysis.
- (e) When calculating monthly averages, one-half of the minimum detection limit (MDL) should be used instead of a zero. Where all data are below the MDL, the “<MDL” shall be reported as indicated in item (C).

12. Failure to pay fees associated with this permit is a violation of the Missouri Clean Water Law (644.055 RSMo).

13. This permit does not cover land disturbance activities.

14. This permit does not authorize the placement of fill materials in flood plains, placement of solid materials into any waterway, the obstruction of stream flow, or changing the channel of a defined drainage course. The facility must contact the U.S. Army Corps of Engineers (Corps) to obtain a CWA §404 Department of Army permit.

**MISSOURI DEPARTMENT OF NATURAL RESOURCES**  
**FACT SHEET**  
**FOR THE PURPOSE OF RENEWAL**  
**OF**  
**MO-0089117**  
**COLLEGE OF THE OZARKS**

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollutant Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of stormwater from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified for less.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)(A)2.] a factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (MSOP or operating permit) listed below. A factsheet is not an enforceable part of an operating permit.

**PART I. FACILITY INFORMATION**

Facility Type: Industrial; >1 MGD  
SIC Code(s): 8221, 4961, 1422, 7999, 4941  
NAICS Code(s): 611310, 221330, 212312, 611699, 221310  
Application Date: 03/04/2019  
Expiration Date: 09/30/2019  
Last Inspection: 03/04/2013

**FACILITY DESCRIPTION:**

College of the Ozarks is a four year institution of higher learning. The facility has hands on teaching of agricultural practices. A natural gas fired power plant on-site supplies the campus with steam, heating, and cooling for buildings. No changes have occurred at this facility or in the receiving water body affecting effluent limit derivations.

The dairy barn has approximately 65 head of milking cows maximum throughout the year. The waste storage basin is included in this permit. The school applies liquid wastes about every two to three months, and solids about three to four times per year. This operation is not subject to permitting if it was a stand-alone operation. However, because of the other concomitant industrial activities at the site, the basin will receive operational monitoring requirements (already being performed by the permittee) and general animal feeding operation (AFO) permit conditions. A discussion with the permittee's farm general manager, the operation is already adhering to standard agricultural practices and applicable best management practices.

The charter number for the continuing authority for this facility is N00034894; this number was verified by the permit writer to be associated with the facility and precisely matches the continuing authority reported by the facility.

**PERMITTED FEATURES TABLE:**

OUTFALL	DESIGN FLOW	TREATMENT LEVEL	EFFLUENT TYPE
#001	1.46 MGD	none	building cooling water, continuous
#002	intermittent	none	swimming pool drainage water, expected once every three years
#003	none	n/a	outfall removed, no discharge
#004	none	n/a	outfall removed, connected to Hollister WWTF
#005	0.4 MGD	none	building cooling water, seasonal
#006	0.5 MGD	none	building cooling water, seasonal
#007	0.5 MGD	none	building cooling water, seasonal
#008	0.75 MGD	none	building cooling water, continuous




OUTFALL	DESIGN FLOW	TREATMENT LEVEL	EFFLUENT TYPE
#009	intermittent	settling	stormwater, truck wash water, and concrete batch plant process water
#010	0.75	none	building cooling water, continuous
#011	2,700 gpm	intake	intake
#012	0	aeration	no-discharge; waste from animals in the dairy barn

#### FACILITY PERFORMANCE HISTORY & COMMENTS:

The electronic discharge monitoring reports were reviewed since the last permit renewal. No exceedances were noted.

#### FACILITY MAP:

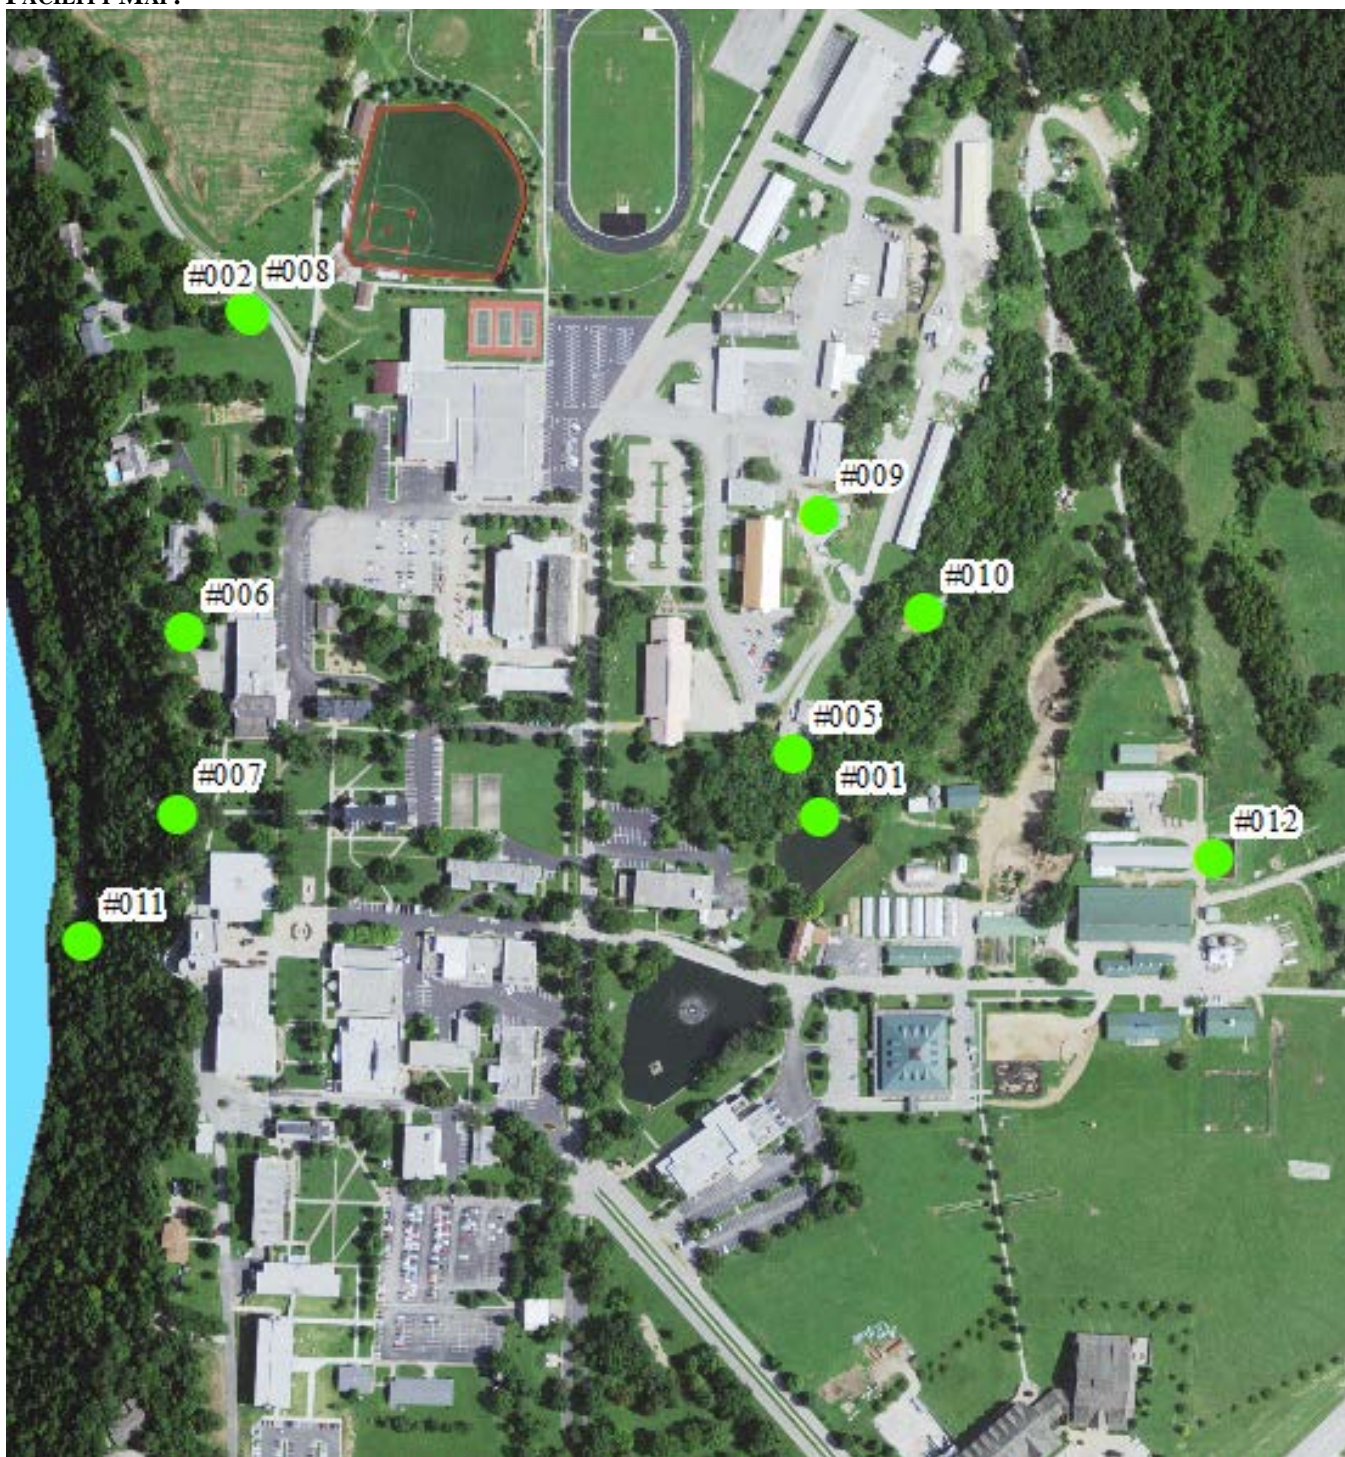

**PART II. RECEIVING WATERBODY INFORMATION****RECEIVING WATERBODY'S WATER QUALITY:**

Lake Taneycomo is a highly used waterbody of Missouri. This lake exhibits properties of both a lake and a stream as it is supplied by releases from Table Rock Dam. The TMDL associated with this watershed is concerned with low dissolved oxygen (DO). The report details the low DO levels are caused by the water released from the hypolimnion (bottom portion) of the dam which is, by nature, low in dissolved oxygen. Uses to be maintained for this lake are irrigation, livestock watering, aquatic life, cold water fishery, whole body contact class A, secondary contact recreation, and drinking water. It is a class L2 Lake. The waterbody ID for Lake Taneycomo is 7314.

**303(d) LIST:**

Section 303(d) of the federal Clean Water Act requires each state identify waters not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock, and wildlife. The 303(d) list helps state and federal agencies keep track of impaired waters not addressed by normal water pollution control programs. <http://dnr.mo.gov/env/wpp/waterquality/303d/303d.htm>

✓ Not applicable; this facility does not discharge to an impaired segment of a 303(d) listed stream.

**TOTAL MAXIMUM DAILY LOAD (TMDL):**

A TMDL is a calculation of the maximum amount of a given pollutant a water body can absorb before its water quality is affected; hence, the purpose of a TMDL is to determine the pollutant loading a specific waterbody can assimilate without exceeding water quality standards. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan or TMDL may be developed. The TMDL shall include the WLA calculation. <http://dnr.mo.gov/env/wpp/tmdl/>

✓ Applicable. Lake Taneycomo is associated with the 2010 EPA Approved TMDL for reduced dissolved oxygen. This facility is not considered to be a source of the above listed pollutant or considered to contribute to the impairment of Lake Taneycomo. Deep water discharges from Table Rock Lake for the purpose of generating electrical power provides discharge of water cool enough to maintain a cold-water fishery in Lake Taneycomo, the tailwater of Table Rock Dam. However, due to thermal stratification in the lake during summer through early winter, cold water in the lower layers of the lake does not mix with the warmer surface water and becomes depleted of dissolved oxygen (DO), resulting in lower concentrations of DO entering Lake Taneycomo.

**APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:**

Per Missouri's Effluent Regulations [10 CSR 20-7.015(1)(B)], waters of the state are divided into seven categories. Each category lists effluent limitations for specific parameters, which are presented in each outfall's effluent limitation table and further discussed in Part IV: Effluents Limits Determinations

- ✓ Lake or Reservoir
- ✓ All Other Waters

**RECEIVING WATER TABLE:**

OUTFALL	WATERBODY NAME	CLASS	WBID	DESIGNATED USES	DISTANCE TO CLASSIFIED SEGMENT	12-DIGIT HUC
#001	Tributary to Lake Taneycomo	n/a	n/a	GEN	1.3 mi	Fall Creek – Lake Taneycomo 11010003-0101
#002	Tributary to Lake Taneycomo	n/a	n/a	GEN	0.10 mi	
#005	Tributary to Lake Taneycomo	n/a	n/a	GEN	1.0 mi	
#006	Tributary to Lake Taneycomo	n/a	n/a	GEN	0.06 mi	
#007	Tributary to Lake Taneycomo	n/a	n/a	GEN	0.07 mi	
#008	Tributary to Lake Taneycomo	n/a	n/a	GEN	0.11 mi	
#009	Tributary to Lake Taneycomo	n/a	n/a	GEN	0.35 mi	
#010	Tributary to Lake Taneycomo	n/a	n/a	GEN	1.0 mi	
#012	Tributary to Lake Taneycomo	n/a	n/a	GEN	0.20 mi	
All Outfalls	Lake Taneycomo	L2	7314	LWP, WWH, CDH, WBC-A, SCR, DWS	see above	

n/a not applicable

Classes are hydrologic classes as defined in 10 CSR 20-7.031(1)(F). L1: Lakes with drinking water supply - wastewater discharges are not permitted to occur to L1 watersheds per 10 CSR 20-7.015(3)(C); L2: major reservoirs; L3: all other public and private lakes; P: permanent streams; C: streams which may cease flow in

dry periods but maintain pools supporting aquatic life; E: streams which do not maintain surface flow; and W: wetland. Losing streams are defined in 10 CSR 20-7.031(1)(O) and are designated on the Losing Stream dataset or determined by the Department to lose 30% or more of flow to the subsurface.

WBID = Waterbody Identification: Missouri Use Designation Dataset per 10 CSR 20-7.031(1)(Q) and (S) as 8-20-13 MUDD V1.0 or newer; data can be found as an ArcGIS shapefile on MSDIS at [http://msdis.missouri.edu/pub/Inland\\_Water\\_Resources/MO\\_2014\\_WQS\\_Stream\\_Classifications\\_and\\_Use\\_shp.zip](http://msdis.missouri.edu/pub/Inland_Water_Resources/MO_2014_WQS_Stream_Classifications_and_Use_shp.zip); New C streams described on the dataset per 10 CSR 20-7.031(2)(A)3. as 100K Extent Remaining Streams.

Per 10 CSR 20-7.031, the Department defines the Clean Water Commission's water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and 1<sup>st</sup> classified receiving stream's beneficial water uses are to be maintained in the receiving streams in accordance with [10 CSR 20-7.031(1)(C)]. Uses which may be found in the receiving streams table, above:

10 CSR 20-7.031(1)(C)1.: **ALP** = Aquatic Life Protection (formerly AQL; current uses are defined to ensure the protection and propagation of fish shellfish and wildlife, further subcategorized as: WWH = Warm Water Habitat; CLH = Cool Water Habitat; CDH = Cold Water Habitat; EAH = Ephemeral Aquatic Habitat; MAH = Modified Aquatic Habitat; LAH = Limited Aquatic Habitat. This permit uses ALP effluent limitations in 10 CSR 20-7.031 Table A1-A2 for all habitat designations unless otherwise specified.

10 CSR 20-7.031(1)(C)2.: Recreation in and on the water

WBC = Whole Body Contact recreation where the entire body is capable of being submerged;

**WBC-A** = whole body contact recreation supporting swimming uses and has public access;

**WBC-B** = whole body contact recreation not supported in WBC-A;

**SCR** = Secondary Contact Recreation (like fishing, wading, and boating)

10 CSR 20-7.031(1)(C)3. to 7.:

**HHP** (formerly HHF) = Human Health Protection as it relates to the consumption of fish and drinking of water;

**IRR** = irrigation for use on crops utilized for human or livestock consumption

**LWW** = Livestock and Wildlife Watering (current narrative use is defined as LWP = Livestock and Wildlife Protection);

**DWS** = Drinking Water Supply

**IND** = industrial water supply

10 CSR 20-7.031(1)(C)8-11.: Wetlands (10 CSR 20-7.031 Tables A1-B3 currently does not have corresponding habitat use criteria for these defined uses): WSA = storm- and flood-water storage and attenuation; WHP = habitat for resident and migratory wildlife species; WRC = recreational, cultural, educational, scientific, and natural aesthetic values and uses; WHC = hydrologic cycle maintenance.

10 CSR 20-7.031(6): **GRW** = Groundwater

#### **MIXING CONSIDERATIONS:**

For all outfalls, mixing zone and zone of initial dilution are allowed per 10 CSR 20-7.031(3)(A). See part IV for derivation discussion.

#### **RECEIVING WATERBODY MONITORING REQUIREMENTS:**

No receiving water monitoring requirements are recommended at this time.

### **PART III. RATIONALE AND DERIVATION OF EFFLUENT LIMITATIONS & PERMIT CONDITIONS**

#### **ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:**

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

- ✓ Not applicable; the facility does not discharge to a losing stream as defined by [10 CSR 20-2.010(36)] & [10 CSR 20-7.031(1)(N)], or is an existing facility.

#### **ANTIBACKSLIDING:**

Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(l)] require a reissued permit to be as stringent as the previous permit with some exceptions. Backsliding (a less stringent permit limitation) is only allowed under certain conditions.

- ✓ Limitations in this operating permit for the reissuance conform to the anti-backsliding provisions of Section 402(o) of the Clean Water Act, and 40 CFR Part 122.44.
  - ✓ Material and substantial alterations or additions to the permitted facility occurred after permit issuance justify the application of a less stringent effluent limitation.
    - Outfall #001 was determined to have a retention time in Lake Honor and the interconnected Mill Pond of 39.4 hours after discharge from the cooling system; the permit writer has determined the retention time is sufficient to negate any thermal impacts from the cooling water discharge at maximum flow. The permit writer removed the temperature monitoring requirement at the outfall as the temperature is no longer from the cooling system, but from environmental conditions created in the shallow (four foot, and three foot, respectively) lakes. The permit writer has also noted the outfall is greater than ¼ mile from the lake, at 1.3 miles, therefore thermal discharges once entering the lake will also be more closely based on the local temperature, not the cooling water discharges.
  - ✓ The Department determined technical mistakes or mistaken interpretations of law were made in issuing the permit under section 402(a)(1)(b).
    - The previous permit special conditions contained a specific set of prohibitions related to general criteria (GC) found in 10 CSR 20-7.031(4); however, there was no determination as to whether the discharges have reasonable potential to cause or contribute to excursion of those general water quality criteria in the previous permit. This permit assesses each general criteria as listed in the previous permit's special conditions. Federal regulations 40 CFR 122.44(d)(1)(iii)

requires instances where reasonable potential (RP) to cause or contribute to an exceedance of a water quality standard exists, a numeric limitation must be included in the permit. Rather than conducting the appropriate RP determination, the previous permit simply placed the prohibitions in the permit. These conditions were removed from the permit. Appropriate reasonable potential determinations were conducted for each general criterion listed in 10 CSR 20-7.031(4)(A) through (I) and effluent limitations were placed in the permit for those general criteria where it was determined the discharge had reasonable potential to cause or contribute to excursions of the general criteria. Specific effluent limitations were not included for those general criteria where it was determined the discharges will not cause or contribute to excursions of general criteria. Removal of the prohibitions does not reduce the protections of the permit or allow for impairment of the receiving stream. The permit maintains sufficient effluent limitations, monitoring requirements and best management practices to protect water quality while maintaining permit conditions applicable to permittee disclosures and in accordance with 10 CSR 20-7.031(4) where no water contaminant by itself or in combination with other substances shall prevent the water of the state from meeting the following conditions: (only discharging outfalls were considered below)

- (A) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses.
  - For all outfalls, there is no RP for putrescent bottom deposits preventing full maintenance of beneficial uses because nothing disclosed by the permittee indicates putrescent wastewater would be discharged from the facility.
  - For all outfalls, there is RP for unsightly or harmful bottom deposits preventing full maintenance of beneficial uses because solids are discharged at all outfalls, the outfall contains either TSS or SS limitations.
- (B) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses.
  - For all outfalls except for outfall #002, there is RP for oil in sufficient amounts to be unsightly preventing full maintenance of beneficial uses because oil and grease may be discharged from these outfalls. Outfall #002 has no RP because this is pool drainage and no oils or greases are expected to be present in sufficient amounts to develop a limit for this general criteria.
  - For all outfalls, there is no RP for scum and floating debris in sufficient amounts to be unsightly preventing full maintenance of beneficial uses because solids could be discharged through any outfall therefore TSS or SS limits were implemented for all discharging outfalls.
- (C) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses.
  - For all outfalls, there is RP for unsightly color or turbidity in sufficient amounts preventing full maintenance of beneficial uses because solids could be discharged through any outfall therefore TSS or SS limits were implemented for all discharging outfalls.
  - For all outfalls, there is no RP for offensive odor in sufficient amounts preventing full maintenance of beneficial uses because nothing disclosed by the permittee indicates offensive odor will be present in sufficient amounts to impair beneficial uses.
- (D) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life.
  - The permit writer considered specific toxic pollutants when writing this permit. Numeric effluent limitations are included for those pollutants could be discharged in toxic amounts. These effluent limitations are protective of human health, animals, and aquatic life.
- (E) There shall be no significant human health hazard from incidental contact with the water.
  - This criterion is very similar to (D) above. See Part IV, Effluent Limits Derivation below.
- (F) There shall be no acute toxicity to livestock or wildlife watering.
  - This criterion is very similar to (D) above. See Part IV, Effluent Limits Derivation below.
- (G) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community.
  - For all outfalls, there is RP for physical changes impairing the natural biological community because this facility discharges cooling water; limitations for temperature are applied to this facility.
  - It has been established any chemical changes are covered by the specific numeric effluent limitations established in the permit.
  - For all outfalls, there is no RP for hydrologic changes impairing the natural biological community because nothing disclosed by the permittee indicates this is occurring.
- (H) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.
  - There are no solid waste disposal activities or any operation which has reasonable potential to cause or contribute to the materials listed above being discharged through any outfall.



- The previous permit's special conditions required sampling of total petroleum hydrocarbons (TPH) under the decision model to discharge stormwater having a sheen in secondary containment. The special condition has been revised in all permits beginning in 2015 to remove TPH as 40 CFR 136 does not contain any approved methods for the TPH parameter nor are there water quality standards for TPH. This permit requires oil and grease and BTEX (benzene, toluene, ethylbenzene, and xylene) sampling of the potentially contaminated stormwater in secondary containment. The facility need only sample for these constituents prior to release when a sheen or petroleum odor is present.
- The previous permit special conditions stated: "AFO Production Area Requirements:" There shall be no discharge of manure, litter, or process wastewater into waters of the state from production area point sources. Stockpiling of uncovered dry process waste within the production area without runoff collection is not allowed. Liquid and solid wastes shall be land applied according to agronomic rates. Land application shall occur on property owned or leased by the permittee. And These areas must be included in the SWPPP." The permit writer has determined these regulations were removed from rule and do not apply to this facility.
- The previous permit special condition stated: "Any pesticide discharge from any point source shall comply with the requirements of Federal Insecticide, Fungicide and Rodenticide Act, as amended (7 U.S.C. 136 et. seq.) and the use of such pesticides shall be in a manner consistent with its label." The permit writer has determined this special condition was outside the scope of NPDES permitting and was removed.

#### **ANTIDEGRADATION REVIEW:**

Process water discharges with new, altered, or expanding flows, the Department is to document, by means of antidegradation review, if the use of a water body's available assimilative capacity is justified. In accordance with Missouri's water quality regulations for antidegradation [10 CSR 20-7.031(3)], degradation may be justified by documenting the socio-economic importance of a discharge after determining the necessity of the discharge. Facilities must submit the antidegradation review request to the Department prior to establishing, altering, or expanding discharges. See <http://dnr.mo.gov/env/wpp/permits/antideg-implementation.htm>

- ✓ Not applicable; the facility has not submitted information proposing expanded or altered process water discharge; no further degradation proposed therefore no further review necessary.

#### **CHANGES IN DISCHARGES OF TOXIC POLLUTANT:**

This special condition reiterates the federal rules found in 40 CFR 122.44(f) and 122.42(a)(1). In these rules, the facility is required to report changes in amounts of toxic substances discharged. Toxic substances are defined in 40 CFR 122.2 as "...any pollutant listed as toxic under section 307(a)(1) or, in the case of "sludge use or disposal practices," any pollutant identified in regulations implementing section 405(d) of the CWA." Section 307 of the clean water act then refers to those parameters found in 40 CFR 401.15. The permittee should also consider any other toxic pollutant in the discharge as reportable under this condition.

#### **COMPLIANCE AND ENFORCEMENT:**

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

- ✓ Not applicable; the permittee/facility is not currently under Water Protection Program enforcement action.

#### **DOMESTIC WASTEWATER:**

Domestic wastewater is defined as wastewater (i.e., human sewage) originating primarily from the sanitary conveniences of residences, commercial buildings, factories, and institutions, including any water which may have infiltrated the sewers. Domestic wastewater excludes stormwater, animal waste, process waste, and other similar waste.

- ✓ Not applicable, this facility discharges domestic wastewater to an off-site permitted wastewater treatment facility (POTW).

#### **EFFLUENT LIMITATIONS:**

Effluent limitations derived and established for this permit are based on current operations of the facility and applied per 10 CSR 20-7.015(9)(A). Any flow through the outfall is considered a discharge and must be sampled and reported as provided in Part A of the permit. Future permit action due to facility modification may contain new operating permit terms and conditions which supersede the terms and conditions, including effluent limitations, of this operating permit. Daily maximums and monthly averages are required per 40 CFR 122.45(d)(1) for continuous discharges (not from a POTW).

#### **EFFLUENT LIMITATION GUIDELINE:**

Effluent Limitation Guidelines, or ELGs, are found at 40 CFR 400-499. These are limitations established by the EPA based on the SIC code and the type of work a facility is conducting. Most ELGs are for process wastewater and some address stormwater. All are technology based limitations which must be met by the applicable facility at all times.

- ✓ The facility does not have an associated ELG.

#### **ELECTRONIC DISCHARGE MONITORING REPORT (EDMR) SUBMISSION SYSTEM:**

The U.S. Environmental Protection Agency (EPA) promulgated a final rule on October 22, 2015, to modernize Clean Water Act reporting for municipalities, industries, and other facilities by converting to an electronic data reporting system. The final rule requires

regulated entities and state and federal regulators to use information technology to electronically report data required by the National Pollutant Discharge Elimination System (NPDES) permit program instead of filing paper reports. To comply with the federal rule, the Department is requiring all permittees to begin submitting discharge monitoring data and reports online.

Per 40 CFR 127.15 and 127.24, permitted facilities may request a temporary waiver for up to 5 years or a permanent waiver from electronic reporting from the Department. To obtain an electronic reporting waiver, a permittee must first submit an eDMR Waiver Request Form: <http://dnr.mo.gov/forms/780-2692-f.pdf>. A request must be made for each facility. If more than one facility is owned or operated by a single entity, then the entity must submit a separate request for each facility based on its specific circumstances. An approved waiver is not transferable.

The Department must review and notify the facility within 120 calendar days of receipt if the waiver request has been approved or rejected [40 CFR 124.27(a)]. During the Department review period as well as after a waiver is granted, the facility must continue submitting a hard-copy of any reports required by their permit. The Department will enter data submitted in hard-copy from those facilities allowed to do so and electronically submit the data to the EPA on behalf of the facility.

To assist the facility in entering data into the eDMR system, the permit describes limit sets in each table in Part A of the permit. The data entry personnel should use these identifiers to assure data entry is being completed appropriately.

- ✓ The permittee/facility is currently using the eDMR data reporting system.

#### **GENERAL CRITERIA CONSIDERATIONS:**

In accordance with 40 CFR 122.44(d)(1), effluent limitations shall be placed into permits for pollutants determined to cause, have reasonable potential to cause, or to contribute to, an excursion above any water quality standard, including narrative water quality criteria. In order to comply with this regulation, the permit writer has completed a reasonable potential determination on whether discharges have reasonable potential to cause, or contribute to an excursion of the general criteria listed in 10 CSR 20-7.031(4). In instances where reasonable potential exists, the permit includes limitations within the permit to address the reasonable potential. In discharges where reasonable potential does not exist, the permit may include monitoring to later determine the discharge's potential to impact the narrative criteria. Additionally, §644.076.1, RSMo as well as Section D – Administrative Requirements of Standard Conditions Part I of this permit state it shall be unlawful for any person to cause or allow any discharge of water contaminants from any water contaminant or point source located in Missouri in violation of sections 644.006 to 644.141 of the Missouri Clean Water Law or any standard, rule, or regulation promulgated by the commission.

- ✓ Applicable; this permit contains effluent limitations for oil and grease; the permit writer has determined this facility has reasonable potential to discharge a sheen or oil per 10 CSR 20-7.031(4)(B) therefore limits were applied. See Part IV.
- ✓ Applicable; this permit contains effluent limitations to protect for toxicity in accordance with 10 CSR 20-7.031(4)(D) and (G); see Part IV for specific pollutant discussion.
- ✓ Applicable; this permit contains effluent limitations for solids to protect for color, turbidity, scum, floating debris, and physical changes.

#### **GROUNDWATER MONITORING:**

Groundwater is a water of the state according to 10 CSR 20-2.010(82), and is subject to regulations at 10 CSR 20-7.015(7) and 10 CSR 20-7.031(6) and must be protected accordingly.

- ✓ This facility is not required to monitor groundwater for the water protection program.

#### **MAJOR WATER USER:**

Any surface or groundwater user with a water source and the equipment necessary to withdraw or divert 100,000 gallons (or 70 gallons per minute) or more per day combined from all sources from any stream, river, lake, well, spring, or other water source is considered a major water user in Missouri. All major water users are required by law to register water use annually (Missouri Revised Statutes Chapter 256.400 Geology, Water Resources and Geodetic Survey Section). <https://dnr.mo.gov/pubs/pub2337.htm>

- ✓ Applicable; this facility is a major water user and is registered with the state.

#### **NO-DISCHARGE LAND APPLICATION:**

Land application of wastewater or sludge shall comply with the all applicable no-discharge requirements listed in 10 CSR 20-6.015 and all facility operations and maintenance requirements listed in 10 CSR 20-8.020(15). These requirements ensure appropriate operation of the no-discharge land application systems and prevent unauthorized and illicit discharges to waters of the state. Land applications by a contract hauler on fields the permittee has a spreading agreement on are not required to be in this permit. A spreading agreement does not constitute the field being rented or leased by the permittee as they do not have any control over management of the field.

- ✓ Applicable; this permit authorizes operation of a no-discharge land application system to disperse wastewater and sludge.

#### **OIL/WATER SEPARATORS:**

Oil water separators (OWS) are frequently found at industrial sites where process water and stormwater may contain oils and greases, oily wastewaters, or other immiscible liquids requiring separation. Food industry discharges typically require pretreatment prior to

discharge to municipally owned treatment works. Per 10 CSR 26-2.010(2)(B), all oil water separators must be operated according to manufacturer's specifications and authorized in NPDES permits or may be regulated as a petroleum tank.

- ✓ Not applicable; the permittee has not disclosed the use of any oil water separators at this permitted facility and therefore oil water separator tanks are not authorized by this permit.

#### **REASONABLE POTENTIAL (RP):**

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants which are (or may be) discharged at a level causing or have the reasonable potential to cause (or contribute to) an in-stream excursion above narrative or numeric water quality standards. Per 10 CSR 20-7.031(4), general criteria shall be applicable to all waters of the state at all times; however, acute toxicity criteria may be exceeded by permit in zones of initial dilution, and chronic toxicity criteria may be exceeded by permit in mixing zones. If the permit writer determines any given pollutant has the reasonable potential to cause or contribute to an in-stream excursion above the WQS, the permit must contain effluent limits for the pollutant per 40 CFR Part 122.44(d)(1)(iii) and the most stringent limits per 10 CSR 20-7.031(9)(A). Permit writers may use mathematical reasonable potential analysis (RPA) using the Technical Support Document for Water Quality Based Toxics Control (TSD) methods (EPA/505/2-90-001) as found in Section 3.3.2, or may also use reasonable potential determinations (RPD) as provided in Sections 3.1.2, 3.1.3, and 3.2 of the TSD.

- ✓ Not applicable; a mathematical RPA was not conducted for this facility. However, the permit writer completed an RPD, a reasonable potential determination, using best professional judgment for all of the appropriate parameters in this permit. An RPD consists of reviewing application data and/or discharge monitoring data for the last five years and comparing those data to narrative or numeric water quality criteria.
- ✓ Permit writers use the Department's permit writer's manual (<http://dnr.mo.gov/env/wpp/permits/manual/permit-manual.htm>), the EPA's permit writer's manual (<https://www.epa.gov/npdes/npdes-permit-writers-manual>), program policies, and best professional judgment. For each parameter in each permit, the permit writer carefully considers all applicable information regarding: technology based effluent limitations, effluent limitation guidelines, water quality standards, stream flows and uses, and all applicable site specific information and data gathered by the permittee through discharge monitoring reports and renewal (or new) application sampling. Best professional judgment is based on the experience of the permit writer, cohorts in the Department and resources at the EPA, research, and maintaining continuity of permits if necessary. For stormwater permits, the permit writer is required per 10 CSR 6.200(6)(B)2 to consider: A. application and other information supplied by the permittee; B. effluent guidelines; C. best professional judgment of the permit writer; D. water quality; and E. BMPs. Part IV provides specific decisions related to this permit.

#### **SAMPLING FREQUENCY JUSTIFICATION:**

Sampling and reporting frequency was generally retained from previous permit. 40 CFR 122.45(d)(1) indicates all continuous discharges shall be permitted with daily maximum and monthly average limits. Minimum sampling frequency for all parameters is annually per 40 CFR 122.44(i)(2).

#### **SAMPLING TYPE JUSTIFICATION:**

Sampling type was continued from the previous permit. The sampling types are representative of the discharges, and are protective of water quality. Discharges with altering effluent should have composite sampling; discharges with uniform effluent can have grab samples. Grab samples are usually appropriate for stormwater. Parameters which must have grab sampling are: pH, ammonia, *E. coli*, total residual chlorine, free available chlorine, hexavalent chromium, dissolved oxygen, total phosphorus, volatile organic compounds, and others.

#### **SCHEDULE OF COMPLIANCE (SOC):**

A schedule of remedial measures included in a permit, including an enforceable sequence of interim requirements (actions, effluent limits, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit. SOC's are allowed under 40 CFR 122.47 providing certain conditions are met. A SOC is not allowed:

- For effluent limitations based on technology-based standards established in accordance with federal requirements, if the deadline for compliance established in federal regulations has passed. 40 CFR § 125.3.
- For a newly constructed facility in most cases. Newly constructed facilities must meet applicable effluent limitations when discharge begins, because the facility has installed the appropriate control technology as specified in a permit or antidegradation review. A SOC is allowed for a new water quality based effluent limit not included in a previously public noticed permit or antidegradation review, which may occur if a regulation changes during construction.
- To develop a TMDL, UAA, or other study associated with development of a site specific criterion. A facility is not prohibited from conducting these activities, but a SOC may not be granted for conducting these activities.

In order to provide guidance in developing SOC's, and to attain a greater level of consistency, the Department issued a policy on development of SOC's on October 25, 2012. The policy provides guidance to permit writers on standard time frames for schedules for common activities, and guidance on factors to modify the length of the schedule.

- ✓ Not applicable; this permit does not contain a SOC.

#### **SLUDGE – DOMESTIC BIOSOLIDS:**

Biosolids are solid materials resulting from domestic wastewater treatment meeting federal and state criteria for beneficial use (i.e. fertilizer). Sewage sludge is solid, semi-solid, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information: <http://extension.missouri.edu/main/DisplayCategory.aspx?C=74> (WQ422 through WQ449).

✓ Not applicable; the facility has not disclosed domestic wastewater is managed on-site.

#### **SLUDGE – INDUSTRIAL:**

Industrial sludge is solid, semi-solid, or liquid residue generated during the treatment of industrial process wastewater in a treatment works; including but not limited to, scum or solids removed in primary, secondary, or advanced wastewater treatment process; scum and solids filtered from water supplies and backwashed; and a material derived from industrial sludge.

✓ Not applicable; industrial sludge is not generated at this facility.

#### **SPILL REPORTING:**

Per 260.505 RSMo, any emergency involving a hazardous substance must be reported to the Department's 24 hour Environmental Emergency Response hotline at (573) 634-2436 at the earliest practicable moment after discovery. The Department may require the submittal of a written report detailing measures taken to clean up a spill. These reporting requirements apply whether or not the spill results in chemicals or materials leaving the permitted property or reaching waters of the state. This requirement is in addition to the noncompliance reporting requirement found in Standard Conditions Part I. <http://dnr.mo.gov/env/esp/spillbill.htm>

#### **STANDARD CONDITIONS:**

The standard conditions Part I attached to this permit incorporate all sections of 40 CFR 122.41(a) through (n) by reference as required by law. These conditions, in addition to the conditions enumerated within the standard conditions should be reviewed by the permittee to ascertain compliance with this permit, state regulations, state statutes, federal regulations, and the Clean Water Act. Standard Conditions Part III, if attached to this permit, incorporate all requirements dealing with domestic sludges.

#### **STORMWATER PERMITTING: LIMITATIONS AND BENCHMARKS:**

When a permitted feature or outfall consists of only stormwater, a benchmark may be implemented at the discretion of the permit writer, if there is no RP for water quality excursions.

✓ Not applicable; this facility does not have any stormwater-only outfalls.

#### **STORMWATER POLLUTION PREVENTION PLAN (SWPPP):**

In accordance with 40 CFR 122.44(k), Best Management Practices (BMPs) must be used to control or abate the discharge of pollutants when: 1) Authorized under section 304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities; 2) Authorized under section 402(p) of the CWA for the control of stormwater discharges; 3) Numeric effluent limitations are infeasible; or 4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA. In accordance with the EPA's *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (EPA 833-B-09-002) published by the EPA in 2015 [https://www.epa.gov/sites/production/files/2015-11/documents/swppp\\_guide\\_industrial\\_2015.pdf](https://www.epa.gov/sites/production/files/2015-11/documents/swppp_guide_industrial_2015.pdf), BMPs are measures or practices used to reduce the amount of pollution entering waters of the state from a permitted facility. BMPs may take the form of a process, activity, or physical structure. Additionally in accordance with the Stormwater Management, a SWPPP is a series of steps and activities to 1) identify sources of pollution or contamination, and 2) select and carry out actions which prevent or control the pollution of storm water discharges. Additional information can be found in *Stormwater Management for Industrial Activities: Developing Pollution Prevention Plans and Best Management Practices* (EPA 832-R-92-006; September 1992).

A SWPPP must be prepared by the permittee if the SIC code is found in 40 CFR 122.26(b)(14) and/or 10 CSR 20-6.200(2). A SWPPP may be required of other facilities where stormwater has been identified as necessitating better management. The purpose of a SWPPP is to comply with all applicable stormwater regulations by creating an adaptive management plan to control and mitigate stream pollution from stormwater runoff. Developing a SWPPP provides opportunities to employ appropriate BMPs to minimize the risk of pollutants being discharged during storm events. The following paragraph outlines the general steps the permittee should take to determine which BMPs will work to achieve the benchmark values or limits in the permit. This section is not intended to be all encompassing or restrict the use of any physical BMP or operational and maintenance procedure assisting in pollution control. Additional steps or revisions to the SWPPP may be required to meet the requirements of the permit.

Areas which should be included in the SWPPP are identified in 40 CFR 122.26(b)(14). Once the potential sources of stormwater pollution have been identified, a plan should be formulated to best control the amount of pollutant being released and discharged by each activity or source. This should include, but is not limited to, minimizing exposure to stormwater, good housekeeping measures, proper facility and equipment maintenance, spill prevention and response, vehicle traffic control, and proper materials handling. Once a plan has been developed the facility will employ the control measures determined to be adequate to achieve the benchmark values

discussed above. The facility will conduct monitoring and inspections of the BMPs to ensure they are working properly and re-evaluate any BMP not achieving compliance with permitting requirements. For example, if sample results from an outfall show values of TSS above the benchmark value, the BMP being employed is deficient in controlling stormwater pollution. Corrective action should be taken to repair, improve, or replace the failing BMP. This internal evaluation is required at least once per month but should be continued more frequently if BMPs continue to fail. If failures do occur, continue this trial and error process until appropriate BMPs have been established.

For new, altered, or expanded stormwater discharges, the SWPPP shall identify reasonable and effective BMPs while accounting for environmental impacts of varying control methods. The antidegradation analysis must document why no discharge or no exposure options are not feasible. The selection and documentation of appropriate control measures shall serve as an alternative analysis of technology and fulfill the requirements of antidegradation [10 CSR 20-7.031(3)]. For further guidance, consult the antidegradation implementation procedure (<http://dnr.mo.gov/env/wpp/docs/AIP050212.pdf>).

- ✓ Applicable; a SWPPP shall be developed and implemented for this facility. A SWPPP is required because this facility conducts land application of animal waste and has a concrete plant on site.

#### **SUFFICIENTLY SENSITIVE ANALYTICAL METHODS:**

Please review Standard Conditions Part 1, section A, number 4. The analytical and sampling methods used shall conform to the reference methods listed in 10 CSR 20-7.015 and/or 40 CFR 136 unless alternates are approved by the Department. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. The facility shall ensure the selected methods are able to quantify the presence of pollutants in a given discharge at concentrations are low enough to determine compliance with Water Quality Standards in 10 CSR 20-7.031 or effluent limitations unless provisions in the permit allow for other alternatives. A method is “sufficiently sensitive” when; 1) the method quantifies the pollutant below the level of the applicable water quality criterion or; 2) the method minimum level is above the applicable water quality criterion, but the amount of pollutant in a facility’s discharge is high enough the method detects and quantifies the level of pollutant in the discharge, or 3) the method has the lowest minimum level of the analytical methods approved under 10 CSR 20-7.015 and or 40 CFR 136. These methods are also required for parameters listed as monitoring only, as the data collected may be used to determine if numeric limitations need to be established. A permittee is responsible for working with their contractors to ensure the analysis performed is sufficiently sensitive. 40 CFR 136 lists the approved methods accepted by the Department. Tables A1-B3 at 10 CSR 20-7.031 shows water quality standards.

#### **UNDERGROUND INJECTION CONTROL (UIC):**

The UIC program for all classes of wells in the State of Missouri is administered by the Missouri Department of Natural Resources and approved by EPA pursuant to section 1422 and 1425 of the Safe Drinking Water Act (SDWA) and 40 CFR 147 Subpart AA. Injection wells are classified based on the liquids which are being injected. Class I wells are hazardous waste wells which are banned by RSMo 577.155; Class II wells are established for oil and natural gas production; Class III wells are used to inject fluids to extract minerals; Class IV wells are also banned by Missouri in RSMo 577.155; Class V wells are shallow injection wells; some examples are heat pump wells and groundwater remediation wells. Domestic wastewater being disposed of sub-surface is also considered a Class V well. In accordance with 40 CFR 144.82, construction, operation, maintenance, conversion, plugging, or closure of injection wells shall not cause movement of fluids containing any contaminant into Underground Sources of Drinking Water (USDW) if the presence of any contaminant may cause a violation of drinking water standards or groundwater standards under 10 CSR 20-7.031, or other health based standards, or may otherwise adversely affect human health. If the director finds the injection activity may endanger USDWs, the Department may require closure of the injection wells, or other actions listed in 40 CFR 144.12(c), (d), or (e). In accordance with 40 CFR 144.26, the permittee shall submit a Class V Well Inventory Form for each active or new underground injection well drilled, or when the status of a well changes, to the Missouri Department of Natural Resources, Geological Survey Program, P.O. Box 250, Rolla, Missouri 65402. The Class V Well Inventory Form can be requested from the Geological Survey Program or can be found at the following web address: <http://dnr.mo.gov/forms/780-1774-f.pdf>

- ✓ Not applicable; the permittee has not submitted materials indicating the facility will be performing UI at this site.

#### **VARIANCE:**

Per the Missouri Clean Water Law §644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §644.006 to 644.141.

- ✓ Not applicable; this permit is not drafted under premise of a petition for variance.

#### **WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:**

As per [10 CSR 20-2.010(78)], the WLA is the amount of pollutant each discharger is allowed to discharge into the receiving stream without endangering water quality. Two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs) are reviewed. If one limit does not provide adequate protection for the receiving water, then the other must be used per 10 CSR 20-7.015(9)(A).

- ✓ Applicable; wasteload allocations for toxic parameters were calculated using water quality criteria or water quality model results and by applying the dilution equation below; WLAs are calculated using the *Technical Support Document For Water Quality-Based Toxics Control* or TSD EPA/505/2-90-001; 3/1991.

$$C = \frac{(C_s \times Q_s) + (C_e \times Q_e)}{(Q_e + Q_s)} \quad (\text{EPA/505/2-90-001, Section 4.5.5})$$

Where    C = downstream concentration  
          C<sub>s</sub> = upstream concentration  
          Q<sub>s</sub> = upstream flow  
          C<sub>e</sub> = effluent concentration  
          Q<sub>e</sub> = effluent flow

- ✓ Acute wasteload allocations designated as daily maximum limits (MDL) were determined using applicable water quality criteria (CMC: criteria maximum concentration) and stream volume of flow at the edge of the zone of initial dilution (ZID).
- ✓ Chronic wasteload allocations designated as monthly average limits (AML) were determined using applicable chronic water quality criteria (CCC: criteria continuous concentration) and stream volume of flow at the edge of the mixing zone (MZ).
- ✓ Number of Samples “n”: effluent quality is determined by the underlying distribution of daily values, which is determined by the Long Term Average (LTA) associated with a particular Wasteload Allocation (WLA) and by the Coefficient of Variation (CV) of the effluent concentrations. Increasing or decreasing the monitoring frequency does not affect this underlying assumption which should be, at a minimum, targeted to comply with the values dictated by the WLA. Therefore, it is recommended the actual planned frequency of monitoring be used to determine the value of “n” for calculating the AML. However, in situations where monitoring frequency is once per month or less, a higher value for “n” must be assumed for AML derivation purposes. Thus, the statistical procedure being employed using an assumed number of samples is “n = 4”. For total ammonia as nitrogen, “n = 30” is used.

#### **WASTELOAD ALLOCATION (WLA) MODELING:**

Permittees may submit site specific studies to better determine the site specific wasteload allocations applied in permits.

- ✓ Not applicable; a WLA study was either not submitted or determined not applicable by Department staff.

**PART IV. EFFLUENT LIMITS DETERMINATIONS****OUTFALLS #001, #005, #006, #007, #008, & #010 – COOLING WATER DISCHARGES****EFFLUENT LIMITATIONS TABLE:**

PARAMETERS	UNIT	DAILY MAXIMUM	MONTHLY AVERAGE MAXIMUM	PREVIOUS PERMIT LIMITATIONS	MINIMUM SAMPLING FREQUENCY	MINIMUM REPORTING FREQUENCY	SAMPLE TYPE
PHYSICAL							
FLOW	MGD	*	*	SAME	ONCE/MONTH	ONCE/MONTH	TOTAL
TEMPERATURE (#006, #007, #008)	°F	68	68	90	ONCE/MONTH	ONCE/MONTH	GRAB
TEMPERATURE (#005, #010)	°F	90	90	SAME	ONCE/MONTH	ONCE/MONTH	GRAB
CONVENTIONAL							
OIL & GREASE	mg/L	15	10	SAME	ONCE/MONTH	ONCE/MONTH	GRAB
pH <sup>†</sup>	SU	6.5 TO 9.0	6.5 TO 9.0	SAME	ONCE/MONTH	ONCE/MONTH	GRAB
TSS	mg/L	30	20	SAME	ONCE/MONTH	ONCE/MONTH	GRAB
NUTRIENTS							
PHOSPHORUS, TOTAL (TP)	mg/L	*	*	NEW	ONCE/MONTH	ONCE/MONTH	GRAB

\* Monitoring and reporting requirement only

† Report the minimum and maximum pH values; pH is not to be averaged

**DERIVATION AND DISCUSSION OF LIMITS:****Flow**

In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification. The facility will report in MGD, continued from previous permit. Flow sample type was changed from estimated to total, the facility shall determine a method by which to measure and calculate total flow for the day.

**Oil & Grease**

15 mg/L daily maximum; 10 mg/L monthly average; continued from previous permit. Oil and grease is considered a conventional pollutant. Oil and grease is a comprehensive test which measures for gasoline, diesel, crude oil, creosote, kerosene, heating oils, heavy fuel oils, lubricating oils, waxes, and some asphalt and pitch. The test can also detect some volatile organics such as benzene, toluene, ethylbenzene, or toluene, but these constituents are often lost during testing due to their boiling points. The facility reported from 2 to 6.9 mg/L. The permit writer completed an RPD on this parameter and found RP due to parameter detections. Oils and greases of different densities will possibly form sheen or unsightly bottom deposits at levels which vary from 10 mg/L. To protect the general criteria, it is the responsibility of the permittee to visually observe the discharge and receiving waters for sheen or bottom deposits.

AQL Chronic: 10 mg/L per 10 CSR 20-7.031 Table A1

Set chronic standard equal to chronic WLA per TSD §5.4.2 (EPA/505/2-90-001); multiply by 1.5 to obtain acute limit.

10 mg/L \* 1.5 = 15 mg/L

**pH**

6.5 to 9.0 SU. Water Quality Standard at 10 CSR 20-7.015 states water contaminants shall not cause pH to be outside the range of 6.5 to 9.0 SU; continued from previous permit. The facility reported from 6.6 to 7.94 SU for these outfalls since last renewal.

**Total Suspended Solids (TSS)**

30 mg/L as a daily maximum and 20 mg/L as a monthly average; continued from previous permit to adhere to antibacksliding regulations. There is no water quality standard for TSS; however, sediment discharges can negatively impact aquatic life habitat. TSS is also a valuable indicator parameter. Effluent limitations from the previous state operating permit have been reassessed and verified that they are still protective of the receiving stream's Water Quality. Lake Taneycomo is classified as an L2 lake; these limitations will maintain the fishable swimmable onus of the Clean Water Act.

**Temperature: Outfall #001**

Monitoring and limitations removed. See Part III, ANTIBACKSLIDING for additional information.

**Temperature: Outfalls #006, #007, and #008**

Lake Taneycomo is a cold water fishery [10 CSR 20-7.031(5)(D)3], the discharges are within ½ mile of the Lake therefore 10 CSR 20.7031(5)(D)3 applies; water contaminant sources shall not cause or contribute to stream temperature in excess of 68 degrees Fahrenheit. 10 CSR 20-7.015(3)(A) indicates all releases within ½ mile is considered a discharge to the lake. The permit will only require temperature be monitored and reported in degrees Fahrenheit. Previous permit was 90 degrees Fahrenheit for these outfalls.

**Temperature: Outfalls #005 and #010**

Lake Taneycomo is a cold water fishery [10 CSR 20-7.031(5)(D)3], however, the discharges are to tributaries of the Lake greater than ½ mile therefore 10 CSR 20.7031(5)(D)1 applies; water contaminant sources shall not cause or contribute to stream temperature in excess of 90 degrees Fahrenheit. The permit will only require temperature be monitored and reported in degrees Fahrenheit. Continued from previous permit.

**Temperature Change ( $\Delta T$ )**

Change in temperature,  $\Delta T$ , the facility shall monitor the change in temperature from the intake to each of the outfall. The facility shall use the absolute value of intake minus outfall. Monitoring is required to determine compliance with 10 CSR 20-7.031(5)(D)3 and reasonable potential.

**NUTRIENTS:**

**Phosphorus, Total (TP)**

These outfalls were permitted prior to 1994 therefore monitoring of phosphorus applies per 10 CSR 20-7.015(3)(E).



## **OUTFALL #002 – SWIMMING POOL DISCHARGE**

### **EFFLUENT LIMITATIONS TABLE:**

PARAMETERS	UNIT	DAILY MAXIMUM	MONTHLY AVERAGE	PREVIOUS PERMIT LIMITS	MINIMUM SAMPLING FREQUENCY	MINIMUM REPORTING FREQUENCY	SAMPLE TYPE
PHYSICAL							
FLOW	MGD	*	*	SAME	ONCE/DISCHARGE ‡	‡	ESTIMATE
CONVENTIONAL							
CHLORINE, TOTAL RESIDUAL	µg/L	19	9.5	SAME	ONCE/DISCHARGE ‡	‡	GRAB
DISSOLVED OXYGEN	mg/L	6.0 MINIMUM	6.0 MINIMUM	5.0	ONCE/DISCHARGE ‡	‡	GRAB
pH	SU	6.5 TO 9	6.5 TO 9	SAME	ONCE/DISCHARGE ‡	‡	GRAB
SETTLABLE SOLIDS	mL/L/hr	1.5	1.0	SAME	ONCE/DISCHARGE ‡	‡	GRAB
NUTRIENTS							
PHOSPHORUS, TOTAL	mg/L	0.5	0.5	NEW	ONCE/DISCHARGE ‡	‡	GRAB

\* Monitoring and reporting requirement only

† Report the minimum and maximum pH values; pH is not to be averaged

‡ Once/discharge means the facility will sample the effluent each time the pool is drained. The facility will report on the 28<sup>th</sup> day of the month following discharge.

### **DERIVATION AND DISCUSSION OF LIMITS:**

#### **PHYSICAL:**

##### **Flow**

In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification. Units changed from gallons per day to MGD-millions of gallons per day to align with other facilities.

#### **CONVENTIONAL:**

##### **Chlorine, Total Residual (TRC)**

This limit corresponds to Missouri's acute toxicity criteria for the protection of aquatic life (10 CSR 20-7.031). Acute criteria apply at the end of pipe because discharges are expected to be episodic in nature and lasting less than four days. No mixing zone is allowed. Standard compliance language for TRC, including the minimum level (ML), is included in the permit. Minimum level required for reporting purposes is 130 µg/L. These limits are exactly the same as previous effluent limitations although mg/L was changed to µg/L: 19 µg/L daily maximum, 9.5 µg/L monthly average. No schedule of compliance is allowed because the facility expects to only drain the pool once every three or four years. The limits are derived exactly from the swimming pool general permit.

##### **Dissolved Oxygen**

The previous permit and the general permit for swimming pools sets DO at a minimum of 5.0 mg/L; However, this facility discharges to a cold water lake therefore the minimum value required for this permit is 6.0 mg/L per 10 CSR 20-7.031 Table A. This value is protective of the receiving waterbody's water quality. The facility reported 7.8 mg/L in a pool drainage occurring on May 6 and 7 in 2016.

##### **pH**

6.5 to 9.0 SU. Water Quality Standard at 10 CSR 20-7.015 states water contaminants shall not cause pH to be outside the range of 6.5 to 9.0 SU.

##### **Settleable Solids**

The previous permit and the general permit for swimming pool discharges set the daily maximum at 1.5 mL/L/hr and the monthly average at 1.0 mL/L/hour. These limits have been reassessed and verified they are protective of the receiving waterbody's water quality and are retained.

**NUTRIENTS:**

**Phosphorus, Total (TP)**

0.5 mg/L daily maximum and monthly average. Limitations from 10 CSR 20-7.015(3)(E) incorporated into this permit to protect nutrient loading in Lake Taneycomo.

## **OUTFALL #009 – CONCRETE BATCH PLANT AND STORMWATER**

**EFFLUENT LIMITATIONS TABLE:**

PARAMETERS	UNIT	DAILY MAXIMUM	MONTHLY AVERAGE MAXIMUM	PREVIOUS PERMIT LIMITATIONS	MINIMUM SAMPLING FREQUENCY	MINIMUM REPORTING FREQUENCY	SAMPLE TYPE
PHYSICAL							
FLOW	MGD	*	*	*, *	ONCE/QUARTER	ONCE/QUARTER	ESTIMATE
PRECIPITATION	inches	*	n/a	SAME	ONCE/QUARTER	ONCE/QUARTER	MEASURED
CONVENTIONAL							
OIL & GREASE	mg/L	15	10	SAME	ONCE/QUARTER	ONCE/QUARTER	GRAB
pH †	SU	6.5-9	6.5-9	SAME	ONCE/QUARTER	ONCE/QUARTER	GRAB
SETTLABLE SOLIDS	mL/L/hr	1.5	1.0	SAME	ONCE/QUARTER	ONCE/QUARTER	GRAB
TSS	mg/L	70	70	SAME	ONCE/QUARTER	ONCE/QUARTER	GRAB
NUTRIENTS							
PHOSPHORUS, TOTAL	mg/L	0.5	0.5	NEW	ONCE/QUARTER	ONCE/QUARTER	GRAB

\* Monitoring and reporting requirement only

† Report the minimum and maximum pH values; pH is not to be averaged

### **DERIVATION AND DISCUSSION OF LIMITS:**

#### **Flow**

In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification. Units changed from gallons per day to MGD-millions of gallons per day to align with other facilities.

#### **Precipitation**

Monitoring only requirement; measuring the amount of precipitation [(10 CSR 20-6.200(2)(C)1.E(VI)] during an event is necessary to ensure adequate stormwater management exists at the site. Knowing the amount of potential stormwater runoff can provide the permittee a better understanding of specific control measure that should be employed to ensure protection of water quality. The facility should only report the amount of rainfall for the 24 hours of the day the samples were collected.

### **CONVENTIONAL:**

#### **Oil & Grease**

15 mg/L daily maximum; 10 mg/L monthly average; continued from previous permit. Oil and grease is considered a conventional pollutant. Oil and grease is a comprehensive test which measures for gasoline, diesel, crude oil, creosote, kerosene, heating oils, heavy fuel oils, lubricating oils, waxes, and some asphalt and pitch. The test can also detect some volatile organics such as benzene, toluene, ethylbenzene, or toluene, but these constituents are often lost during testing due to their boiling points. The facility reported from 5.1 to 5.7 mg/L. The permit writer completed an RPD on this parameter and found RP based on the activities occurring and those associated potential discharges from this area. Oils and greases of different densities will possibly form sheen or unsightly bottom deposits at levels which vary from 10 mg/L. To protect the general criteria, it is the responsibility of the permittee to visually observe the discharge and receiving waters for sheen or bottom deposits. AQL Chronic: 10 mg/L per 10 CSR 20-7.031 Table A1; set chronic standard equal to chronic WLA per TSD §5.4.2 (EPA/505/2-90-001); multiply by 1.5 to obtain acute limit;  $10 * 1.5 = 15$  mg/L

#### **pH**

6.5 to 9.0 SU. Water Quality Standard at 10 CSR 20-7.015 states water contaminants shall not cause pH to be outside the range of 6.5 to 9.0 SU. Continued from previous permit.

#### **Settleable Solids**

There is no water quality standard for TSS; however, sediment discharges can negatively impact aquatic life habitat. Settleable solids are also a valuable indicator parameter. Solids monitoring allows the permittee to identify increases in sediment and solids that may indicate uncontrolled materials leaving the site. The general permit MOG49 provided a daily maximum of 1.5 mL/L/hr and a monthly average of 1.0 mL/L/hr. These limits have been reassessed and verified they are protective of the receiving water.

**Total Suspended Solids (TSS)**

70 mg/L as a daily maximum and monthly average. Effluent limitations from the previous state operating permit have been reassessed and verified that they are still protective of the receiving stream's Water Quality. Effluent limitations have been retained from previous state operating permit to adhere to antibacksliding regulations.

**NUTRIENTS:**

**Phosphorus, Total (TP)**

0.5 mg/L daily maximum and monthly average. Limitations from 10 CSR 20-7.015(3)(E) incorporated into this permit to protect nutrient loading in Lake Taneycomo. This outfall was established in this permit after 1994.

## **PERMITTED FEATURE #011 – COOLING WATER INTAKE STRUCTURE**

### **EFFLUENT LIMITATIONS TABLE:**

PARAMETERS	UNIT	DAILY MAXIMUM	MONTHLY AVERAGE	PREVIOUS PERMIT LIMITATIONS	MINIMUM SAMPLING FREQUENCY	MINIMUM REPORTING FREQUENCY	SAMPLE TYPE
PHYSICAL							
INTAKE FLOW	ft/sec	0.5	*	NEW	ONCE/DAY	ONCE/MONTH	CALCULATED

\* Monitoring and reporting requirement only

### **DERIVATION AND DISCUSSION OF LIMITS:**

#### **Intake Flow**

In accordance with 40 CFR 122.21(r)(6) and 40 CFR 125.98(b)(2) the Department is recording the facility's chosen method of impingement compliance as a flow-through velocity of less than 0.5 foot per second per 40 CFR 125.64(c)(3). The facility will be determining the velocity of the structure intake daily in accordance with the above. Exceedance of the maximum velocity must not occur even in extreme or unusual hydrologic circumstances.

This facility is subject to Clean Water Act §316(b). The previous permit was issued prior to the rule becoming effective however, this permit contains a special condition relating to these newly promulgated requirements.

#### **COOLING WATER INTAKE STRUCTURE (CWIS); CLEAN WATER ACT § 316(b)**

Section 316(b) of the Clean Water Act (CWA) applies to new or existing facilities operating a cooling water intake structure (CWIS). Section 316(b) requires location, design, construction, and capacity of CWISs reflect the best technology available (BTA) for minimizing adverse environmental impacts (AEI). Under current regulations, existing facilities are subject to section 316(b) conditions that reflect BTA for minimizing AEI on a case-by-case, best professional judgment (BPJ) basis.

The Environmental Protection Agency's (EPA) Phase II Section 316(b) Existing Facilities Rule was remanded to the EPA in *Riverkeeper, Inc. et al. v EPA* 475 F.3d 83 (2d Cir. 2007). The Federal Water Pollution Control Act Amendments of 1972 require cooling water intake structures to reflect the best technology available for minimizing adverse environmental impact. Best technology available must consider intake design, location, construction, and capacity. The EPA has finalized the 316(b) standards and they became effective on October 16, 2014 (<http://water.epa.gov/lawsregs/lawsguidance/cwa/316b/index.cfm>).

EPA consulted with the US Fish and Wildlife Service and the National Marine Fisheries Service under the Endangered Species Act rules. The Services concluded the new 316(b) rule is not likely to jeopardize the continued existence of listed species or result in adverse modification of designated critical habitat. However the Services added a number of conditions to the final rule. The rule requires each facility identify all federally-listed, threatened, and endangered species and designated critical habitat present in the zone of influence of the intake. This condition includes all listed species not just fish and shellfish. Additional control measures and monitoring and reporting requirements may be established to minimize incidental take. The Services will have 60 days to review and comment on measures related to listed species and critical habitat during the next permit renewal process.

This operating permit contains language indicating the permit may be reopened and modified, or alternatively revoked and reissued to: incorporate new or modified requirements applicable to existing cooling water intake structures under Section 316(b) of the Clean Water Act consistent with any standard established pursuant to section 1311 or section 1316 of 33 USC 1326. In the event it is necessary for this permit to be reopened and modified, or alternatively revoked and reissued, the permittee shall comply with any such new or modified requirements or standards applicable to existing cooling water intake structures under §316(b) of the Clean Water Act.

To meet the 316(b) requirements, the facility will be required to submit the following information with the next permit renewal application. As 40 CFR 122.21(r)(1)(2) indicates:

- i. Source Water Physical Data Report : 40 CFR 122.21(r)(2) This report requires a description and scaled drawings showing the physical configuration of the water body, including areal dimensions, depths, and temperature regimes, identification and characterization of the source waterbody's hydrological and geomorphological features, estimate the intake's area of influence within the waterbody and locational maps.
- ii. Cooling Water Intake Structure Data Report, 40 CFR 122.21(r)(3) This report requires information on the design of the intake structure and its location in the water column. It includes design intake flows, daily hours of operation, number of days of the year in operation and seasonal changes, if applicable; a flow distribution and water balance diagram that includes all sources of water to the facility, recirculating flows, and discharges, and engineering drawings of the cooling water intake structure.

- iii. Cooling Water System Data Report, 40 CFR 122.21(r)(5) This report provides information on the operation of the cooling water system including descriptions of reductions in water withdrawals, recycled water, proportion of the source waterbody withdrawn.
- iv. Chosen Method of Compliance with Impingement Mortality Standard, 40 CFR 122.21(r)(6) This facility must identify their chosen compliance method and if applicant chooses to comply with a different technology, then they must describe it.
- v. Operational Status, 40 CFR 122.21(r)(8) The operational status report includes descriptions of each unit's operating status including age of the unit, capacity utilization for the previous 5 years, and any major upgrades completed within the last 15 years, including boiler replacement, condenser replacement, turbine replacement, and fuel change.

**PERMITTED FEATURE #12N AND #12S – AFO HOLDING STRUCTURES**

**EFFLUENT LIMITATIONS TABLE:**

PARAMETERS	UNIT	DAILY MINIMUM	DAILY MAXIMUM	AVERAGE	PREVIOUS PERMIT LIMITATIONS	MINIMUM SAMPLING FREQUENCY	MINIMUM REPORTING FREQUENCY	SAMPLE TYPE
PHYSICAL								
FREEBOARD IN TANK	feet	1	-	*	SAME	ONCE/MONTH	ONCE/MONTH	MEASURED
VOLUME PUMPED	MGD	-	*	*	SAME	ONCE/DAY	ONCE/MONTH	MEASURED

\* Monitoring and reporting requirement only

**DERIVATION AND DISCUSSION OF LIMITS:**

The facility is to operate these structures as no-discharge permitted features. Freeboard will be monitored monthly and the volume pumped will be monitored daily when being pumped out. These values are reported to the department on a monthly basis. An annual report is no longer required. The facility uses this wastewater as a productive agricultural use on the 1,000 acre College of the Ozarks campus.

**Freeboard**

The distance in feet between the top of the water level and the point at which the water would discharge from the structure. The facility shall maintain at least 1 foot of freeboard in this structure. The facility will monitor monthly; an average will be supplied to the department (new to this permit).

**Volume Pumped**

Estimated millions of gallons per day of liquids or biosolids removed from the structure. There is no need to report zero on days where no extraction took place. The facility will report the average for all days pumped.

## **PART V. ADMINISTRATIVE REQUIREMENTS**

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

### **PERMIT SYNCHRONIZATION:**

The Department of Natural Resources is currently undergoing a synchronization process for operating permits. Permits are normally issued on a five-year term, but to achieve synchronization many permits will need to be issued for less than the full five years allowed by regulation. The intent is all permits within a watershed will move through the Watershed Based Management (WBM) cycle together will all expire in the same fiscal year. <http://dnr.mo.gov/env/wpp/cpp/docs/watershed-based-management.pdf>. This will allow further streamlining by placing multiple permits within a smaller geographic area on public notice simultaneously, thereby reducing repeated administrative efforts. This will also allow the Department to explore a watershed based permitting effort at some point in the future. Renewal applications must continue to be submitted within 180 days of expiration, however, in instances where effluent data from the previous renewal is less than two years old, such data may be re-submitted to meet the requirements of the renewal application. If the permit provides a schedule of compliance for meeting new water quality based effluent limits beyond the expiration date of the permit, the time remaining in the schedule of compliance will be allotted in the renewed permit.

✓ This permit will maintain synchronization by expiring the end of the 3<sup>rd</sup> quarter, 2024.

### **PUBLIC NOTICE:**

The Department shall give public notice a draft permit has been prepared and its issuance is pending.

<http://dnr.mo.gov/env/wpp/permits/pn/index.html> Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in or with water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing.

The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.

For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

✓ The Public Notice period for this operating permit was from 6/14/2019 to 7/15/2019; no comments were received. A copy of the public notice draft was mailed to the United States Fish and Wildlife Services in Columbia Missouri. There were no comments from the Services.

**DATE OF FACT SHEET:** JULY 16, 2019

### **COMPLETED BY:**

PAM HACKLER, ENVIRONMENTAL SCIENTIST  
MISSOURI DEPARTMENT OF NATURAL RESOURCES  
WATER PROTECTION PROGRAM  
OPERATING PERMITS SECTION - INDUSTRIAL UNIT  
573-526-3386  
[pam.hackler@dnr.mo.gov](mailto:pam.hackler@dnr.mo.gov)





STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

These Standard Conditions incorporate permit conditions as required by 40 CFR 122.41 or other applicable state statutes or regulations. These minimum conditions apply unless superseded by requirements specified in the permit.

## Part I – General Conditions

### Section A – Sampling, Monitoring, and Recording

1. **Sampling Requirements.**
  - a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
  - b. All samples shall be taken at the outfall(s) or Missouri Department of Natural Resources (Department) approved sampling location(s), and unless specified, before the effluent joins or is diluted by any other body of water or substance.
2. **Monitoring Requirements.**
  - a. Records of monitoring information shall include:
    - i. The date, exact place, and time of sampling or measurements;
    - ii. The individual(s) who performed the sampling or measurements;
    - iii. The date(s) analyses were performed;
    - iv. The individual(s) who performed the analyses;
    - v. The analytical techniques or methods used; and
    - vi. The results of such analyses.
  - b. If the permittee monitors any pollutant more frequently than required by the permit at the location specified in the permit using test procedures approved under 40 CFR Part 136, or another method required for an industry-specific waste stream under 40 CFR subchapters N or O, the results of such monitoring shall be included in the calculation and reported to the Department with the discharge monitoring report data (DMR) submitted to the Department pursuant to Section B, paragraph 7.
3. **Sample and Monitoring Calculations.** Calculations for all sample and monitoring results which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in the permit.
4. **Test Procedures.** The analytical and sampling methods used shall conform to the reference methods listed in 10 CSR 20-7.015 unless alternates are approved by the Department. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. The facility shall ensure that the selected methods are able to quantify the presence of pollutants in a given discharge at concentrations that are low enough to determine compliance with Water Quality Standards in 10 CSR 20-7.031 or effluent limitations unless provisions in the permit allow for other alternatives. A method is “sufficiently sensitive” when; 1) the method minimum level is at or below the level of the applicable water quality criterion for the pollutant or, 2) the method minimum level is above the applicable water quality criterion, but the amount of pollutant in a facility’s discharge is high enough that the method detects and quantifies the level of pollutant in the discharge, or 3) the method has the lowest minimum level of the analytical methods approved under 10 CSR 20-7.015. These methods are also required for parameters that are listed as monitoring only, as the data collected may be used to determine if limitations need to be established. A permittee is responsible for working with their contractors to ensure that the analysis performed is sufficiently sensitive.
5. **Record Retention.** Except for records of monitoring information required by the permit related to the permittee’s sewage sludge use and disposal activities, which shall be retained for a period of at least five (5) years (or longer as required by 40 CFR part 503), the permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the application for the permit, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.

6. **Illegal Activities.**
  - a. The Federal Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under the permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than two (2) years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than four (4) years, or both.
  - b. The Missouri Clean Water Law provides that any person or who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than six (6) months, or by both. Second and successive convictions for violation under this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.

### Section B – Reporting Requirements

1. **Planned Changes.**
  - a. The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility when:
    - i. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b); or
    - ii. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in the permit, nor to notification requirements under 40 CFR 122.42;
    - iii. The alteration or addition results in a significant change in the permittee’s sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan;
    - iv. Any facility expansions, production increases, or process modifications which will result in a new or substantially different discharge or sludge characteristics must be reported to the Department 60 days before the facility or process modification begins. Notification may be accomplished by application for a new permit. If the discharge does not violate effluent limitations specified in the permit, the facility is to submit a notice to the Department of the changed discharge at least 30 days before such changes. The Department may require a construction permit and/or permit modification as a result of the proposed changes at the facility.
2. **Non-compliance Reporting.**
  - a. The permittee shall report any noncompliance which may endanger health or the environment. Relevant information shall be provided orally or via the current electronic method approved by the Department, within 24 hours from the time the permittee becomes aware of the circumstances, and shall be reported to the appropriate Regional Office during normal business hours or the Environmental Emergency Response hotline at 573-634-2436 outside of normal business hours. A written submission shall also be provided within five (5) business days of the time the permittee becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.



STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

- b. The following shall be included as information which must be reported within 24 hours under this paragraph.
    - i. Any unanticipated bypass which exceeds any effluent limitation in the permit.
    - ii. Any upset which exceeds any effluent limitation in the permit.
    - iii. Violation of a maximum daily discharge limitation for any of the pollutants listed by the Department in the permit required to be reported within 24 hours.
  - c. The Department may waive the written report on a case-by-case basis for reports under paragraph 2. b. of this section if the oral report has been received within 24 hours.
3. **Anticipated Noncompliance.** The permittee shall give advance notice to the Department of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements. The notice shall be submitted to the Department 60 days prior to such changes or activity.
  4. **Compliance Schedules.** Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of the permit shall be submitted no later than 14 days following each schedule date. The report shall provide an explanation for the instance of noncompliance and a proposed schedule or anticipated date, for achieving compliance with the compliance schedule requirement.
  5. **Other Noncompliance.** The permittee shall report all instances of noncompliance not reported under paragraphs 2, 3, and 6 of this section, at the time monitoring reports are submitted. The reports shall contain the information listed in paragraph 2. a. of this section.
  6. **Other Information.** Where the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Department, it shall promptly submit such facts or information.
  7. **Discharge Monitoring Reports.**
    - a. Monitoring results shall be reported at the intervals specified in the permit.
    - b. Monitoring results must be reported to the Department via the current method approved by the Department, unless the permittee has been granted a waiver from using the method. If the permittee has been granted a waiver, the permittee must use forms provided by the Department.
    - c. Monitoring results shall be reported to the Department no later than the 28<sup>th</sup> day of the month following the end of the reporting period.
- b. Notice.
    - i. Anticipated bypass. If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible at least 10 days before the date of the bypass.
    - ii. Unanticipated bypass. The permittee shall submit notice of an unanticipated bypass as required in Section B – Reporting Requirements, paragraph 5 (24-hour notice).
  - c. Prohibition of bypass.
    - i. Bypass is prohibited, and the Department may take enforcement action against a permittee for bypass, unless:
      1. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
      2. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and
      3. The permittee submitted notices as required under paragraph 2. b. of this section.
    - ii. The Department may approve an anticipated bypass, after considering its adverse effects, if the Department determines that it will meet the three (3) conditions listed above in paragraph 2. c. i. of this section.
3. **Upset Requirements.**
    - a. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of paragraph 3. b. of this section are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review.
    - b. Conditions necessary for a demonstration of upset. A permittee who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:
      - i. An upset occurred and that the permittee can identify the cause(s) of the upset;
      - ii. The permitted facility was at the time being properly operated; and
      - iii. The permittee submitted notice of the upset as required in Section B – Reporting Requirements, paragraph 2. b. ii. (24-hour notice).
      - iv. The permittee complied with any remedial measures required under Section D – Administrative Requirements, paragraph 4.
    - c. Burden of proof. In any enforcement proceeding, the permittee seeking to establish the occurrence of an upset has the burden of proof.

## Section C – Bypass/Upset Requirements

1. **Definitions.**
  - a. *Bypass*: the intentional diversion of waste streams from any portion of a treatment facility, except in the case of blending.
  - b. *Severe Property Damage*: substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
  - c. *Upset*: an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
2. **Bypass Requirements.**
  - a. Bypass not exceeding limitations. The permittee may allow any bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of paragraphs 2. b. and 2. c. of this section.

## Section D – Administrative Requirements

1. **Duty to Comply.** The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the Missouri Clean Water Law and Federal Clean Water Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application.
  - a. The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
  - b. The Federal Clean Water Act provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The Federal Clean Water Act provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement



STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

- imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the CWA, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions.
- c. Any person may be assessed an administrative penalty by the EPA Director for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000.
- d. It is unlawful for any person to cause or permit any discharge of water contaminants from any water contaminant or point source located in Missouri in violation of sections 644.006 to 644.141 of the Missouri Clean Water Law, or any standard, rule or regulation promulgated by the commission. In the event the commission or the director determines that any provision of sections 644.006 to 644.141 of the Missouri Clean Water Law or standard, rules, limitations or regulations promulgated pursuant thereto, or permits issued by, or any final abatement order, other order, or determination made by the commission or the director, or any filing requirement pursuant to sections 644.006 to 644.141 of the Missouri Clean Water Law or any other provision which this state is required to enforce pursuant to any federal water pollution control act, is being, was, or is in imminent danger of being violated, the commission or director may cause to have instituted a civil action in any court of competent jurisdiction for the injunctive relief to prevent any such violation or further violation or for the assessment of a penalty not to exceed \$10,000 per day for each day, or part thereof, the violation occurred and continues to occur, or both, as the court deems proper. Any person who willfully or negligently commits any violation in this paragraph shall, upon conviction, be punished by a fine of not less than \$2,500 nor more than \$25,000 per day of violation, or by imprisonment for not more than one year, or both. Second and successive convictions for violation of the same provision of this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.
2. **Duty to Reapply.**
- a. If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for and obtain a new permit.
- b. A permittee with a currently effective site-specific permit shall submit an application for renewal at least 180 days before the expiration date of the existing permit, unless permission for a later date has been granted by the Department. (The Department shall not grant permission for applications to be submitted later than the expiration date of the existing permit.)
- c. A permittee with currently effective general permit shall submit an application for renewal at least 30 days before the existing permit expires, unless the permittee has been notified by the Department that an earlier application must be made. The Department may grant permission for a later submission date. (The Department shall not grant permission for applications to be submitted later than the expiration date of the existing permit.)
3. **Need to Halt or Reduce Activity Not a Defense.** It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.
4. **Duty to Mitigate.** The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment.
5. **Proper Operation and Maintenance.** The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems which are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit.
6. **Permit Actions.**
- a. Subject to compliance with statutory requirements of the Law and Regulations and applicable Court Order, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to, the following:
- i. Violations of any terms or conditions of this permit or the law;
- ii. Having obtained this permit by misrepresentation or failure to disclose fully any relevant facts;
- iii. A change in any circumstances or conditions that requires either a temporary or permanent reduction or elimination of the authorized discharge; or
- iv. Any reason set forth in the Law or Regulations.
- b. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition.
7. **Permit Transfer.**
- a. Subject to 10 CSR 20-6.010, an operating permit may be transferred upon submission to the Department of an application to transfer signed by the existing owner and the new owner, unless prohibited by the terms of the permit. Until such time the permit is officially transferred, the original permittee remains responsible for complying with the terms and conditions of the existing permit.
- b. The Department may require modification or revocation and reissuance of the permit to change the name of the permittee and incorporate such other requirements as may be necessary under the Missouri Clean Water Law or the Federal Clean Water Act.
- c. The Department, within 30 days of receipt of the application, shall notify the new permittee of its intent to revoke or reissue or transfer the permit.
8. **Toxic Pollutants.** The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the Federal Clean Water Act within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
9. **Property Rights.** This permit does not convey any property rights of any sort, or any exclusive privilege.



STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
REVISED  
AUGUST 1, 2014

10. **Duty to Provide Information.** The permittee shall furnish to the Department, within a reasonable time, any information which the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit or to determine compliance with this permit. The permittee shall also furnish to the Department upon request, copies of records required to be kept by this permit.
11. **Inspection and Entry.** The permittee shall allow the Department, or an authorized representative (including an authorized contractor acting as a representative of the Department), upon presentation of credentials and other documents as may be required by law, to:
  - a. Enter upon the permittee's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of the permit;
  - b. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit;
  - c. Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this permit; and
  - d. Sample or monitor at reasonable times, for the purposes of assuring permit compliance or as otherwise authorized by the Federal Clean Water Act or Missouri Clean Water Law, any substances or parameters at any location.
12. **Closure of Treatment Facilities.**
  - a. Persons who cease operation or plan to cease operation of waste, wastewater, and sludge handling and treatment facilities shall close the facilities in accordance with a closure plan approved by the Department.
  - b. Operating Permits under 10 CSR 20-6.010 or under 10 CSR 20-6.015 are required until all waste, wastewater, and sludges have been disposed of in accordance with the closure plan approved by the Department and any disturbed areas have been properly stabilized. Disturbed areas will be considered stabilized when perennial vegetation, pavement, or structures using permanent materials cover all areas that have been disturbed. Vegetative cover, if used, shall be at least 70% plant density over 100% of the disturbed area.
13. **Signatory Requirement.**
  - a. All permit applications, reports required by the permit, or information requested by the Department shall be signed and certified. (See 40 CFR 122.22 and 10 CSR 20-6.010)
  - b. The Federal Clean Water Act provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or non-compliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six (6) months per violation, or by both.
  - c. The Missouri Clean Water Law provides that any person who knowingly makes any false statement, representation or certification in any application, record, report, plan, or other document filed or required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than ten thousand dollars, or by imprisonment for not more than six months, or by both.
14. **Severability.** The provisions of the permit are severable, and if any provision of the permit, or the application of any provision of the permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of the permit, shall not be affected thereby.

**STANDARD CONDITIONS FOR NPDES PERMITS**  
**ISSUED BY**  
**THE MISSOURI DEPARTMENT OF NATURAL RESOURCES**  
**MISSOURI CLEAN WATER COMMISSION**  
**March 1, 2015**

**PART III – SLUDGE AND BIOSOLIDS FROM DOMESTIC AND INDUSTRIAL WASTEWATER  
TREATMENT FACILITIES**

**SECTION A – GENERAL REQUIREMENTS**

1. This permit pertains to sludge requirements under the Missouri Clean Water Law and regulation for domestic wastewater and industrial process wastewater. This permit also incorporates applicable federal sludge disposal requirements under 40 CFR 503 for domestic wastewater. The Environmental Protection Agency (EPA) has principal authority for permitting and enforcement of the federal sludge regulations under 40 CFR 503 for domestic wastewater. EPA has reviewed and accepted these standard sludge conditions. EPA may choose to issue a separate sludge addendum to this permit or a separate federal sludge permit at their discretion to further address the federal requirements.
2. These PART III Standard Conditions apply only to sludge and biosolids generated at domestic wastewater treatment facilities, including public owned treatment works (POTW), privately owned facilities and sludge or biosolids generated at industrial facilities.
3. Sludge and Biosolids Use and Disposal Practices:
  - a. The permittee is authorized to operate the sludge and biosolids treatment, storage, use, and disposal facilities listed in the facility description of this permit.
  - b. The permittee shall not exceed the design sludge volume listed in the facility description and shall not use sludge disposal methods that are not listed in the facility description, without prior approval of the permitting authority.
  - c. The permittee is authorized to operate the storage, treatment or generating sites listed in the Facility Description section of this permit.
4. Sludge Received from other Facilities:
  - a. Permittees may accept domestic wastewater sludge from other facilities including septic tank pumpings from residential sources as long as the design sludge volume is not exceeded and the treatment facility performance is not impaired.
  - b. The permittee shall obtain a signed statement from the sludge generator or hauler that certifies the type and source of the sludge
5. These permit requirements do not supersede nor remove liability for compliance with county and other local ordinances.
6. These permit requirements do not supersede nor remove liability for compliance with other environmental regulations such as odor emissions under the Missouri Air Pollution Control Law and regulations.
7. This permit may (after due process) be modified, or alternatively revoked and reissued, to comply with any applicable sludge disposal standard or limitation issued or approved under Section 405(d) of the Clean Water Act under Chapter 644 RSMo.
8. In addition to STANDARD CONDITIONS, the Department may include sludge limitations in the special conditions portion or other sections of a site specific permit.
9. Alternate Limits in the Site Specific Permit.

Where deemed appropriate, the Department may require an individual site specific permit in order to authorize alternate limitations:

  - a. A site specific permit must be obtained for each operating location, including application sites.
  - b. To request a site specific permit, an individual permit application, permit fee, and supporting documents shall be submitted for each operating location. This shall include a detailed sludge/biosolids management plan or engineering report.
10. Exceptions to these Standard Conditions may be authorized on a case-by-case basis by the Department, as follows:
  - a. The Department will prepare a permit modification and follow permit notice provisions as applicable under 10 CSR 20-6.020, 40 CFR 124.10, and 40 CFR 501.15(a)(2)(ix)(E). This includes notification of the owner of the property located adjacent to each land application site, where appropriate.
  - b. Exceptions cannot be granted where prohibited by the federal sludge regulations under 40 CFR 503.



## **SECTION B – DEFINITIONS**

1. Best Management Practices include agronomic loading rates, soil conservation practices and other site restrictions.
2. Biosolids means organic fertilizer or soil amendment produced by the treatment of domestic wastewater sludge.
3. Biosolids land application facility is a facility where biosolids are spread onto the land at agronomic rates for production of food or fiber. The facility includes any structures necessary to store the biosolids until soil, weather, and crop conditions are favorable for land application.
4. Class A biosolids means a material that has met the Class A pathogen reduction requirements or equivalent treatment by a Process to Further Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
5. Class B biosolids means a material that has met the Class B pathogen reduction requirements or equivalent treatment by a Process to Significantly Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
6. Domestic wastewater means wastewater originating from the sanitary conveniences of residences, commercial buildings, factories and institutions; or co-mingled sanitary and industrial wastewater processed by a (POTW) or a privately owned facility.
7. Industrial wastewater means any wastewater, also known as process water, not defined as domestic wastewater. Per 40 CFR Part 122, process water means any water which, during manufacturing or processing, comes into direct contact with or results from the production or use of any raw material, intermediate product, finished product, byproduct, or waste product.
8. Mechanical treatment plants are wastewater treatment facilities that use mechanical devices to treat wastewater, including septic tanks, sand filters, extended aeration, activated sludge, contact stabilization, trickling filters, rotating biological discs, and other similar facilities. It does not include wastewater treatment lagoons and constructed wetlands for wastewater treatment.
9. Operating location as defined in 10 CSR 20-2.010 is all contiguous lands owned, operated or controlled by one (1) person or by two (2) or more persons jointly or as tenants in common.
10. Plant Available Nitrogen (PAN) is the nitrogen that will be available to plants during the growing seasons after biosolids application.
11. Public contact site is land with a high potential for contact by the public. This includes, but is not limited to, public parks, ball fields, cemeteries, plant nurseries, turf farms, and golf courses.
12. Sludge is the solid, semisolid, or liquid residue removed during the treatment of wastewater. Sludge includes septage removed from septic tanks or equivalent facilities. Sludge does not include carbon coal byproducts (CCBs)
13. Sludge lagoon is part of a mechanical wastewater treatment facility. A sludge lagoon is an earthen basin that receives sludge that has been removed from a wastewater treatment facility. It does not include a wastewater treatment lagoon or sludge treatment units that are not a part of a mechanical wastewater treatment facility.
14. Septage is the material pumped from residential septic tanks and similar treatment works (with a design population of less than 150 people). The standard for biosolids from septage is different from other sludges.

## **SECTION C – MECHANICAL WASTEWATER TREATMENT FACILITIES**

1. Sludge shall be routinely removed from wastewater treatment facilities and handled according to the permit facility description and sludge conditions of this permit.
2. The permittee shall operate the facility so that there is no sludge discharged to waters of the state.
3. Mechanical treatment plants shall have separate sludge storage compartments in accordance with 10 CSR 20, Chapter 8. Failure to remove sludge from these storage compartments on the required design schedule is a violation of this permit.

## **SECTION D – SLUDGE DISPOSED AT OTHER TREATMENT FACILITY OR CONTRACT HAULER**

1. This section applies to permittees that haul sludge to another treatment facility for disposal or use contract haulers to remove and dispose of sludge.
2. Permittees that use contract haulers are responsible for compliance with all the terms of this permit including final disposal, unless the hauler has a separate permit for sludge or biosolids disposal issued by the Department; or the hauler transports the sludge to another permitted treatment facility.
3. Haulers who land apply septage must obtain a state permit.
4. Testing of sludge, other than total solids content, is not required if sludge is hauled to a municipal wastewater treatment facility or other permitted wastewater treatment facility, unless it is required by the accepting facility.

## **SECTION E – INCINERATION OF SLUDGE**

1. Sludge incineration facilities shall comply with the requirements of 40 CFR 503 Subpart E; air pollution control regulations under 10 CSR 10; and solid waste management regulations under 10 CSR 80.
2. Permittee may be authorized under the facility description of this permit to store incineration ash in lagoons or ash ponds. This permit does not authorize the disposal of incineration ash. Incineration ash shall be disposed in accordance with 10 CSR 80; or if the ash is determined to be hazardous with 10 CSR 25.
3. In addition to normal sludge monitoring, incineration facilities shall report the following as part of the annual report, quantity of sludge incinerated, quantity of ash generated, quantity of ash stored, and ash used or disposal method, quantity, and location. Permittee shall also provide the name of the disposal facility and the applicable permit number.

## **SECTION F – SURFACE DISPOSAL SITES AND SLUDGE LAGOONS**

1. Surface disposal sites of domestic facilities shall comply with the requirements in 40 CFR 503 Subpart C; air pollution control regulations under 10 CSR 10; and solid waste management regulations under 10 CSR 80.
2. Sludge storage lagoons are temporary facilities and are not required to obtain a permit as a solid waste management facility under 10 CSR 80. In order to maintain sludge storage lagoons as storage facilities, accumulated sludge must be removed routinely, but not less than once every two years unless an alternate schedule is approved in the permit. The amount of sludge removed will be dependent on sludge generation and accumulation in the facility. Enough sludge must be removed to maintain adequate storage capacity in the facility.
  - a. In order to avoid damage to the lagoon seal during cleaning, the permittee may leave a layer of sludge on the bottom of the lagoon, upon prior approval of the Department; or
  - b. Permittee shall close the lagoon in accordance with Section H.

## **SECTION G – LAND APPLICATION**

1. The permittee shall not land apply sludge or biosolids unless land application is authorized in the facility description or the special conditions of the issued NPDES permit.
2. Land application sites within a 20 miles radius of the wastewater treatment facility are authorized under this permit when biosolids are applied for beneficial use in accordance with these standard conditions unless otherwise specified in a site specific permit. If the permittee's land application site is greater than a 20 mile radius of the wastewater treatment facility, approval must be granted from the Department.
3. Land application shall not adversely affect a threatened or endangered species or its designated critical habitat.
4. Biosolids shall not be applied unless authorized in this permit or exempted under 10 CSR 20, Chapter 6.
  - a. This permit does not authorize the land application of domestic sludge except for when sludge meets the definition of biosolids.
  - b. This permit authorizes "Class A or B" biosolids derived from domestic wastewater and/or process water sludge to be land applied onto grass land, crop land, timber or other similar agricultural or silviculture lands at rates suitable for beneficial use as organic fertilizer and soil conditioner.
5. Public Contact Sites:

Permittees who wish to apply Class A biosolids to public contact sites must obtain approval from the Department after two years of proper operation with acceptable testing documentation that shows the biosolids meet Class A criteria. A shorter length of testing will be allowed with prior approval from the Department. Authorization for land applications must be provided in the special conditions section of this permit or in a separate site specific permit.

  - a. After Class B biosolids have been land applied, public access must be restricted for 12 months.
  - b. Class B biosolids are only land applied to root crops, home gardens or vegetable crops whose edible parts will not be for human consumption.
6. Agricultural and Silvicultural Sites:

Septage – Based on Water Quality guide 422 (WQ422) published by the University of Missouri

  - a. Haulers that land apply septage must obtain a state permit
  - b. Do not apply more than 30,000 gallons of septage per acre per year.
  - c. Septage tanks are designed to retain sludge for one to three years which will allow for a larger reduction in pathogens and vectors, as compared to other mechanical type treatment facilities.
  - d. To meet Class B sludge requirements, maintain septage at 12 pH for at least thirty (30) minutes before land application. 50 pounds of hydrated lime shall be added to each 1,000 gallons of septage in order to meet pathogen and vector stabilization for septage biosolids applied to crops, pastures or timberland.
  - e. Lime is to be added to the pump truck and not directly to the septic tanks, as lime would harm the beneficial bacteria of the septic tank.

Biosolids - Based on Water Quality guide 423, 424, and 425 (WQ423, WQ424, WQ425) published by the University of Missouri;

- a. Biosolids shall be monitored to determine the quality for regulated pollutants
- b. The number of samples taken is directly related to the amount of sludge produced by the facility (See Section I of these Standard Conditions). Report as dry weight unless otherwise specified in the site specific permit. Samples should be taken only during land application periods. When necessary, it is permissible to mix biosolids with lower concentrations of biosolids as well as other suitable Department approved material to reach the maximum concentration of pollutants allowed.
- c. Table 1 gives the maximum concentration allowable to protect water quality standards

**TABLE 1**

Biosolids ceiling concentration <sup>1</sup>	
Pollutant	Milligrams per kilogram dry weight
Arsenic	75
Cadmium	85
Copper	4,300
Lead	840
Mercury	57
Molybdenum	75
Nickel	420
Selenium	100
Zinc	7,500

<sup>1</sup> Land application is not allowed if the sludge concentration exceeds the maximum limits for any of these pollutants

- d. The low metal concentration biosolids has reduced requirements because of its higher quality and can safely be applied for 100 years or longer at typical agronomic loading rates. (See Table 2)

**TABLE 2**

Biosolids Low Metal Concentration <sup>1</sup>	
Pollutant	Milligrams per kilogram dry weight
Arsenic	41
Cadmium	39
Copper	1,500
Lead	300
Mercury	17
Nickel	420
Selenium	36
Zinc	2,800

<sup>1</sup> You may apply low metal biosolids without tracking cumulative metal limits, provided the cumulative application of biosolids does not exceed 500 dry tons per acre.

- e. Each pollutant in Table 3 has an annual and a total cumulative loading limit, based on the allowable pounds per acre for various soil categories.

**TABLE 3**

Pollutant	CEC 15+		CEC 5 to 15		CEC 0 to 5	
	Annual	Total <sup>1</sup>	Annual	Total <sup>1</sup>	Annual	Total <sup>1</sup>
Arsenic	1.8	36.0	1.8	36.0	1.8	36.0
Cadmium	1.7	35.0	0.9	9.0	0.4	4.5
Copper	66.0	1,335.0	25.0	250.0	12.0	125.0
Lead	13.0	267.0	13.0	267.0	13.0	133.0
Mercury	0.7	15.0	0.7	15.0	0.7	15.0
Nickel	19.0	347.0	19.0	250.0	12.0	125.0
Selenium	4.5	89.0	4.5	44.0	1.6	16.0
Zinc	124.0	2,492.0	50.0	500.0	25.0	250.0

<sup>1</sup> Total cumulative loading limits for soils with equal or greater than 6.0 pH (salt based test) or 6.5 pH (water based test)



**TABLE 4** - Guidelines for land application of other trace substances <sup>1</sup>

Cumulative Loading	
Pollutant	Pounds per acre
Aluminum	4,000 <sup>2</sup>
Beryllium	100
Cobalt	50
Fluoride	800
Manganese	500
Silver	200
Tin	1,000
Dioxin	(10 ppt in soil) <sup>3</sup>
Other	<sup>4</sup>

<sup>1</sup> Design of land treatment systems for Industrial Waste, 1979. Michael Ray Overcash, North Carolina State University and Land Treatment of Municipal Wastewater, EPA 1981.)

<sup>2</sup> This applies for a soil with a pH between 6.0 and 7.0 (salt based test) or a pH between 6.5 to 7.5 (water based test). Case-by-case review is required for higher pH soils.

<sup>3</sup> Total Dioxin Toxicity Equivalents (TEQ) in soils, based on a risk assessment under 40 CFR 744, May 1998.

<sup>4</sup> Case by case review. Concentrations in sludge should not exceed the 95<sup>th</sup> percentile of the National Sewage Sludge Survey, EPA, January 2009.

Best Management Practices – Based on Water Quality guide 426 (WQ426) published by the University of Missouri

- a. Use best management practices when applying biosolids.
- b. Biosolids cannot discharge from the land application site
- c. Biosolid application is subject to the Missouri Department of Agriculture State Milk Board concerning grazing restrictions of lactating dairy cattle.
- d. Biosolid application must be in accordance with section 4 of the Endangered Species Act.
- e. Do not apply more than the agronomic rate of nitrogen needed.
- f. The applicator must document the Plant Available Nitrogen (PAN) loadings, available nitrogen in the soil, and crop removal when either of the following occurs: 1) When biosolids are greater than 50,000 mg/kg TN; or 2) When biosolids are land applied at an application rate greater than two dry tons per acre per year.
  - i. PAN can be determined as follows and is in accordance with WQ426  
(Nitrate + nitrite nitrogen) + (organic nitrogen x 0.2) + (ammonia nitrogen x volatilization factor<sup>1</sup>).
- g. Buffer zones are as follows:
  - i. 300 feet of a water supply well, sinkhole, lake, pond, water supply reservoir or water supply intake in a stream;
  - ii. 300 feet of a losing stream, no discharge stream, stream stretches designated for whole body contact recreation, wild and scenic rivers, Ozark National Scenic Riverways or outstanding state resource waters as listed in the Water Quality Standards, 10 CSR 20-7.031;
  - iii. 150 feet if dwellings;
  - iv. 100 feet of wetlands or permanent flowing streams;
  - v. 50 feet of a property line or other waters of the state, including intermittent flowing streams.
- h. Slope limitation for application sites are as follows;
  - i. A slope 0 to 6 percent has no rate limitation
  - ii. Applied to a slope 7 to 12 percent, the applicator may apply biosolids when soil conservation practices are used to meet the minimum erosion levels
  - iii. Slopes > 12 percent, apply biosolids only when grass is vegetated and maintained with at least 80 percent ground cover at a rate of two dry tons per acre per year or less.
- i. No biosolids may be land applied in an area that it is reasonably certain that pollutants will be transported into waters of the state.
- j. Do not apply biosolids to sites with soil that is snow covered, frozen or saturated with liquid without prior approval by the Department.
- k. Biosolids / sludge applicators must keep detailed records up to five years.

## SECTION H – CLOSURE REQUIREMENTS

1. This section applies to all wastewater facilities (mechanical, industrial, and lagoons) and sludge or biosolids storage and treatment facilities and incineration ash ponds. It does not apply to land application sites.
2. Permittees of a domestic wastewater facility who plan to cease operation must obtain Department approval of a closure plan which addresses proper removal and disposal of all residues, including sludge, biosolids. Mechanical plants, sludge lagoons, ash ponds and other storage structures must obtain approval of a closure plan from the Department. Permittee must maintain this permit until the facility is closed in accordance with the approved closure plan per 10 CSR 20 – 6. 010 and 10 CSR 20 – 6.015.
3. Residuals that are left in place during closure of a lagoon or earthen structure or ash pond shall not exceed the agricultural loading rates as follows:
  - a. Residuals shall meet the monitoring and land application limits for agricultural rates as referenced in Section H of these standard conditions.
  - b. If a wastewater treatment lagoon has been in operation for 15 years or more without sludge removal, the sludge in the lagoon qualifies as a Class B biosolids with respect to pathogens due to anaerobic digestion, and testing for fecal coliform is not required. For other lagoons, testing for fecal coliform is required to show compliance with Class B biosolids limitations. In order to reach Class B biosolids requirements, fecal coliform must be less than 2,000,000 colony forming units or 2,000,000 most probable number. All fecal samples must be presented as geometric mean per gram.
  - c. The allowable nitrogen loading that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. For a grass cover crop, the allowable PAN is 300 pounds/acre.
    - i. PAN can be determined as follows:
$$(\text{Nitrate} + \text{nitrite nitrogen}) + (\text{organic nitrogen} \times 0.2) + (\text{ammonia nitrogen} \times \text{volatilization factor}^1).$$

<sup>1</sup> Volatilization factor is 0.7 for surface application and 1 for subsurface application.
4. When closing a domestic wastewater treatment lagoon with a design treatment capacity equal or less than 150 persons, the residuals are considered “septage” under the similar treatment works definition. See Section B of these standard conditions. Under the septage category, residuals may be left in place as follows:
  - a. Testing for metals or fecal coliform is not required
  - b. If the wastewater treatment lagoon has been in use for less than 15 years, mix lime with the sludge at a rate of 50 pounds of hydrated lime per 1000 gallons (134 cubic feet) of sludge.
  - c. The amount of sludge that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. 100 dry tons/acre of sludge may be left in the basin without testing for nitrogen. If 100 dry tons/acre or more will be left in the lagoon, test for nitrogen and determine the PAN using the calculation above. Allowable PAN loading is 300 pounds/acre.
5. Residuals left within the domestic lagoon shall be mixed with soil on at least a 1 to 1 ratio, the lagoon berm shall be demolished, and the site shall be graded and contain  $\geq 70\%$  vegetative density over 100% of the site so as to avoid ponding of storm water and provide adequate surface water drainage without creating erosion.
6. Lagoons and/or earthen structure and/or ash pond closure activities shall obtain a storm water permit for land disturbance activities that equal or exceed one acre in accordance with 10 CSR 20-6.200
7. When closing a mechanical wastewater and/or industrial process wastewater plant; all sludge must be cleaned out and disposed of in accordance with the Department approved closure plan before the permit for the facility can be terminated.
  - a. Land must be stabilized which includes any grading, alternate use or fate upon approval by the Department, remediation, or other work that exposes sediment to stormwater per 10 CSR 20-6.200. The site shall be graded and contain  $\geq 70\%$  vegetative density over 100% of the site, so as to avoid ponding of storm water and provide adequate surface water drainage without creating erosion.
  - b. Per 10 CSR 20-6.015(4)(B)6, Hazardous Waste shall not be land applied or disposed during industrial and mechanical plant closures unless in accordance with Missouri Hazardous Waste Management Law and Regulations under 10 CSR 25.
  - c. After demolition of the mechanical plant / industrial plant, the site must only contain clean fill defined in RSMo 260.200 (5) as uncontaminated soil, rock, sand, gravel, concrete, asphaltic concrete, cinderblocks, brick, minimal amounts of wood and metal, and inert solids as approved by rule or policy of the Department for fill or other beneficial use. Other solid wastes must be removed.
8. If sludge from the domestic lagoon or mechanical treatment plant exceeds agricultural rates under Section G and/or H, a landfill permit or solid waste disposal permit must be obtained if the permittee chooses to seek authorization for on-site sludge disposal under the Missouri Solid Waste Management Law and regulations per 10 CSR 80, and the permittee must comply with the surface disposal requirements under 40 CFR 503, Subpart C.

## SECTION I – MONITORING FREQUENCY

1. At a minimum, sludge or biosolids shall be tested for volume and percent total solids on a frequency that will accurately represent sludge quantities produced and disposed. Please see the table below.

**TABLE 5**

Design Sludge Production (dry tons per year)	Monitoring Frequency (See Notes 1, 2, and 3)			
	Metals, Pathogens and Vectors	Nitrogen TKN <sup>1</sup>	Nitrogen PAN <sup>2</sup>	Priority Pollutants and TCLP <sup>3</sup>
0 to 100	1 per year	1 per year	1 per month	1 per year
101 to 200	biannual	biannual	1 per month	1 per year
201 to 1,000	quarterly	quarterly	1 per month	1 per year
1,001 to 10,000	1 per month	1 per month	1 per week	-- <sup>4</sup>
10,001 +	1 per week	1 per week	1 per day	-- <sup>4</sup>

<sup>1</sup> Test total Kjeldahl nitrogen, if biosolids application is 2 dry tons per acre per year or less.

<sup>2</sup> Calculate plant available nitrogen (PAN) when either of the following occurs: 1) when biosolids are greater than 50,000 mg/kg TN; or 2) when biosolids are land applied at an application rate greater than two dry tons per acre per year.

<sup>3</sup> Priority pollutants (40 CFR 122.21, Appendix D, Tables II and III) and toxicity characteristic leaching procedure (40 CFR 261.24) is required only for permit holders that must have a pre-treatment program.

<sup>4</sup> One sample for each 1,000 dry tons of sludge.

Note 1: Total solids: A grab sample of sludge shall be tested one per day during land application periods for percent total solids.

This data shall be used to calculate the dry tons of sludge applied per acre.

Note 2: Total Phosphorus: Total phosphorus and total potassium shall be tested at the same monitoring frequency as metals.

Note 3: Table 5 is not applicable for incineration and permit holders that landfill their sludge.

2. If you own a wastewater treatment lagoon or sludge lagoon that is cleaned out once a year or less, you may choose to sample only when the sludge is removed or the lagoon is closed. Test one composite sample for each 100 dry tons of sludge or biosolids removed from the lagoon during the year within the lagoon at closing. Composite sample must represent various areas at one-foot depth.
3. Additional testing may be required in the special conditions or other sections of the permit. Permittees receiving industrial wastewater may be required to conduct additional testing upon request from the Department.
4. At this time, the Department recommends monitoring requirements shall be performed in accordance with, "POTW Sludge Sampling and Analysis Guidance Document," United States Environmental Protection Agency, August 1989, and the subsequent revisions.

## SECTION J – RECORD KEEPING AND REPORTING REQUIREMENTS

1. The permittee shall maintain records on file at the facility for at least five years for the items listed in these standard conditions and any additional items in the Special Conditions section of this permit. This shall include dates when the sludge facility is checked for proper operation, records of maintenance and repairs and other relevant information.
2. Reporting period
  - a. By January 28<sup>th</sup> of each year, an annual report shall be submitted for the previous calendar year period for all mechanical wastewater treatment facilities, sludge lagoons, and sludge or biosolids disposal facilities.
  - b. Permittees with wastewater treatment lagoons shall submit the above annual report only when sludge or biosolids are removed from the lagoon during the report period or when the lagoon is closed.
3. Report Forms. The annual report shall be submitted on report forms provided by the Department or equivalent forms approved by the Department.
4. Reports shall be submitted as follows:

Major facilities (those serving 10,000 persons or 1 million gallons per day) shall report to both the Department and EPA. Other facilities need to report only to the Department. Reports shall be submitted to the addresses listed as follows:

DNR regional office listed in your permit  
(see cover letter of permit)  
ATTN: Sludge Coordinator

EPA Region VII  
Water Compliance Branch (WACM)  
Sludge Coordinator  
11201 Renner Blvd.  
Lenexa, KS 66219

5. Annual report contents. The annual report shall include the following:
- a. Sludge and biosolids testing performed. Include a copy or summary of all test results, even if not required by the permit.
  - b. Sludge or biosolids quantity shall be reported as dry tons for quantity generated by the wastewater treatment facility, the quantity stored on site at the end of the year, and the quantity used or disposed.
  - c. Gallons and % solids data used to calculate the dry ton amounts.
  - d. Description of any unusual operating conditions.
  - e. Final disposal method, dates, and location, and person responsible for hauling and disposal.
    - i. This must include the name, address for the hauler and sludge facility. If hauled to a municipal wastewater treatment facility, sanitary landfill, or other approved treatment facility, give the name of that facility.
    - ii. Include a description of the type of hauling equipment used and the capacity in tons, gallons, or cubic feet.
  - f. Contract Hauler Activities:


If contract hauler, provide a copy of a signed contract from the contractor. Permittee shall require the contractor to supply information required under this permit for which the contractor is responsible. The permittee shall submit a signed statement from the contractor that he has complied with the standards contained in this permit, unless the contract hauler has a separate sludge or biosolids use permit.
  - g. Land Application Sites:
    - i. Report the location of each application site, the annual and cumulative dry tons/acre for each site, and the landowners name and address. The location for each spreading site shall be given as a legal description for nearest ¼, ¼, Section, Township, Range, and county, or UTM coordinates. The facility shall report PAN when either of the following occurs: 1) When biosolids are greater than 50,000 mg/kg TN; or 2) when biosolids are land applied at an application rate greater than two dry tons per acre per year.
    - ii. If the "Low Metals" criteria are exceeded, report the annual and cumulative pollutant loading rates in pounds per acre for each applicable pollutant, and report the percent of cumulative pollutant loading which has been reached at each site.
    - iii. Report the method used for compliance with pathogen and vector attraction requirements.
    - iv. Report soil test results for pH, CEC, and phosphorus. If none was tested during the year, report the last date when tested and results.

31913

RECEIVED

MAR 04 2019

Water Protection Program

MISSOURI DEPARTMENT OF NATURAL RESOURCES  
WATER PROTECTION PROGRAM**FORM A – APPLICATION FOR NONDOMESTIC PERMIT  
UNDER MISSOURI CLEAN WATER LAW****FOR AGENCY USE ONLY**

CHECK NUMBER

DATE RECEIVED

FEE SUBMITTED

3-4-19

0.88

NOTE: PLEASE READ THE ACCOMPANYING INSTRUCTIONS BEFORE COMPLETING THIS FORM.

**1. This application is for: (Select only one.)**

- ☐ An operating permit for a new or unpermitted facility. Number of original construction permit: MO \_\_\_\_\_
- ☒ Renewal of an operating permit. Permit number: MO 0089117 Expiration date: Sept.30 2019
- ☐ Modification of an operating permit. Permit number: MO \_\_\_\_\_ Modification reason: \_\_\_\_\_

1.1 Is the appropriate fee included with the application? (See instructions for appropriate fee.) ☐ Yes ☒ No**2. FACILITY**

NAME College of the Ozarks	TELEPHONE NUMBER WITH AREA CODE 471-690-3273	EMAIL rfredrick@cofo.edu	
PHYSICAL ADDRESS (PHYSICAL) 174 Industrial Place	CITY Point Lookout	STATE MO	ZIP CODE 65726

**3. OWNER**

NAME College of the Ozarks	TELEPHONE NUMBER WITH AREA CODE 417-690-3273	EMAIL rfredrick@cofo.edu	
MAILING ADDRESS PO Box 17	CITY Point Lookout	STATE MO	ZIP CODE 65726

3.1 Do you want to review draft permit prior to public notice? ☒ Yes ☐ No**4. CONTINUING AUTHORITY**

NAME College of the Ozarks	TELEPHONE NUMBER WITH AREA CODE 417-690-3273	EMAIL rfredrick@cofo.edu	
MAILING ADDRESS PO Box 17	CITY Point Lookout	STATE MO	ZIP CODE 65726

**5. OPERATOR**

NAME Richard Fredrick	CERTIFICATE NUMBER 14283	TELEPHONE NUMBER WITH AREA CODE 417-294-8848	
MAILING ADDRESS PO Box 17	CITY Point Lookout	STATE MO	ZIP CODE 65726

**6. FACILITY CONTACT**

NAME Richard Fredrick	TITLE Water Treatment Plant Supervisor	TELEPHONE NUMBER WITH AREA CODE 417-690-3273
EMAIL rfredrick@cofo.edu		

**7. ADDITIONAL FACILITY INFORMATION****7.1 Legal description of outfalls (Attach additional sheets, if necessary.)**

001 NW 1/4 SW 1/4 Sec 8 T 22W R 21W Taney County  
UTM Coordinates Easting (X): 466548 Northing (Y): 4119704

For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83)

002 NW 1/4 SW 1/4 Sec 8 T 22W R 21W Taney County  
UTM Coordinates Easting (X): 478401 Northing (Y): 4052860

003 1/4 1/4 Sec T R County  
UTM Coordinates Easting (X): Northing (Y):

004 1/4 1/4 Sec T R County  
UTM Coordinates Easting (X): Northing (Y):

**7.2 Primary standard industrial classification (SIC) and North American Industrial Classification System (NAICS) codes**

001 – SIC 8221 and NAICS 4961 002 – SIC 8221 and NAICS 7999  
003 – SIC and NAICS 004 – SIC and NAICS



<b>8. ADDITIONAL FORMS AND MAPS NECESSARY TO COMPLETE APPLICATION (Complete all applicable forms.)</b>			
A.	Is your facility a manufacturing, commercial, mining or silviculture waste treatment facility? If yes, complete Form C or 2F. (2F is EPA's Application for Storm Water Discharges Associated with Industrial Activity.)	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
B.	Is application for stormwater discharges only? If yes, complete Form C or 2F.	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
C.	Is your facility considered a "primary industry" under EPA guidelines: If yes, complete Forms C or 2F and D.	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
D.	Is wastewater land-applied? If yes, complete Form I.	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
E.	Are biosolids, sludge, ash or residuals generated, treated, stored or land-applied? If yes, complete Form R.	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>
F.	If you are a Class IA CAFO, disregard Parts D and E, above, but attach any revisions to the nutrient management plan.		
G.	Attach a map showing all outfalls and the receiving stream at 1" = 2,000' scale.		
<b>9. ELECTRONIC DISCHARGE MONITORING REPORT (eDMR) SUBMISSION SYSTEM</b>			
Per 40 CFR Part 127 National Pollutant Discharge Elimination System (NPDES) Electronic Reporting Rule, permittee shall report effluent limits and monitoring via an electronic system to ensure timely, complete, accurate and nationally consistent data. <b>Check one of the following for this application to be considered complete.</b> (Check only one.) To access the facility participation package, visit <a href="http://dnr.mo.gov/env/wpp/edmr.htm">dnr.mo.gov/env/wpp/edmr.htm</a> .			
<input type="checkbox"/> You completed and submitted with this permit application the required documentation to participate in the eDMR system.			
<input checked="" type="checkbox"/> You previously submitted required documentation to participate in the eDMR system and/or you currently use the eDMR system.			
<input type="checkbox"/> You submitted a written request for a waiver from electronic reporting. See instructions for information regarding waivers.			
<b>9. DOWNSTREAM LANDOWNER(S)</b> Attach additional sheets as necessary. See Instructions. PLEASE SHOW LOCATION ON MAP. SEE 8(D) ABOVE.			
NAME Dr. Howell Keeter			
ADDRESS 380 Shockley Rd.		CITY Hollister	STATE MO
			ZIP CODE 65672
<b>11.</b> I certify that I am familiar with the information contained in this application. To the best of my knowledge and belief, such information is true, complete and accurate. If granted this permit, I agree to abide by the Missouri Clean Water Law and all rules, regulations, orders and decisions subject to any legitimate appeal to the Missouri Clean Water Commission available to the applicant under the Missouri Clean Water Law.			
NAME AND OFFICIAL TITLE (TYPE OR PRINT) Richard Fredrick Water Treatment Plant Supervisor		TELEPHONE NUMBER WITH AREA CODE (417) 690-3273	
SIGNATURE 		DATE SIGNED 2-28-19	

MO 780-1479 (04-18)

**BEFORE MAILING, PLEASE ENSURE ALL SECTIONS ARE COMPLETE.**

**ALSO INCLUDE APPLICABLE ADDITIONAL FORMS.**

Submitting an incomplete application may result in the application being returned.

HAVE YOU INCLUDED THE FOLLOWING?

- |  |  |
|--|--|
| <input type="checkbox"/> Appropriate fees<br><input checked="" type="checkbox"/> Map at 1" = 2000' scale<br><input checked="" type="checkbox"/> Signature<br><input checked="" type="checkbox"/> Form C or 2F, if applicable<br><input type="checkbox"/> Form D, if applicable | <input type="checkbox"/> Form I (Irrigation), if applicable<br><input type="checkbox"/> Form R (Sludge), if applicable<br><input type="checkbox"/> Revised nutrient management plan, if applicable |
|--|--|

MISSOURI DEPARTMENT OF NATURAL RESOURCES

WATER PROTECTION PROGRAM, WATER POLLUTION CONTROL BRANCH

**FORM A—APPLICATION FOR CONSTRUCTION OR OPERATING PERMIT UNDER MISSOURI CLEAN WATER LAW**

**FACILITY NAME:** College of the Ozarks

**PERMIT NUMBER:** MO0089117

**7. ADDITIONAL FACILITY INFORMATION**

7.1 Legal Description of Outfalls

Out Fall 005    NW1/4            SW1/4            Sec8            T22W            R21W            Taney  
County

UTM Coordinates Easting (X) 466548    Northing (Y) 4119704

*For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83)*

Out Fall 006    NW1/4            SW1/4            Sec8            T22W            R21W            Taney  
County

UTM Coordinates Easting (X) 478358            Northing (Y) 4052650

Out Fall 007    NW1/4            SW1/4            Sec8            T22W            R21W            Taney  
County UTM Coordinates Easting (X) 0478353            Northing (Y) 4052531

Out Fall 008    NW1/4            SW1/4            Sec8            T22W            R21W            Taney  
County UTM Coordinates Easting (X) 478399            Northing (Y) 4052864

Out Fall 009    NW1/4            SW1/4            Sec8            T22W            R21W            Taney  
County UTM Coordinates Easting (X) 47885            Northing (Y) 4052675

Permitted Feature 010 NW1/4            SW1/4            Sec8            T22W            R21W    Taney  
County UTM Coordinates Easting (X) 47885            Northing (Y) 4052675

Permitted Feature 011 NW1/4            SW1/4            Sec8            T22W            R21W    Taney  
County UTM Coordinates Easting (X) 478291            Northing (Y) 4052447

Permitted Feature 012 NW1/4            SW1/4            Sec8            T22W            R21W    Taney  
County UTM Coordinates Easting (X) 479037            Northing (Y) 405202

MISSOURI DEPARTMENT OF NATURAL RESOURCES

WATER PROTECTION PROGRAM, WATER POLLUTION CONTROL BRANCH

**FORM A—APPLICATION FOR CONSTRUCTION OR OPERATING PERMIT UNDER MISSOURI CLEAN  
WATER LAW**

**FACILITY NAME:** College of the Ozarks

**PERMIT NUMBER:** MO0089117

**7. ADDITIONAL FACILITY INFORMATION**

7.2 Primary standard industrial classification (SIC) and North American Industrial Classification

System (NAICS) codes

005- SIC 8221 and NAICS 4961

006- SIC 8221 and NAICS 4961

007- SIC 8221 and NAICS 4961

008- SIC 8221

009- SIC 8221 and NAICS 1422

010- SIC 8221

011- SIC 8221

012- SIC 8221





Down Stream Landowner  
Dr. Howell Keeter  
380 Shockley Road


Home Search Full Extent

Open Legend Open Scale Bar and Zoom Slider


Latitude: 36.6358 Longitude: -93.2373



To report a problem with inform

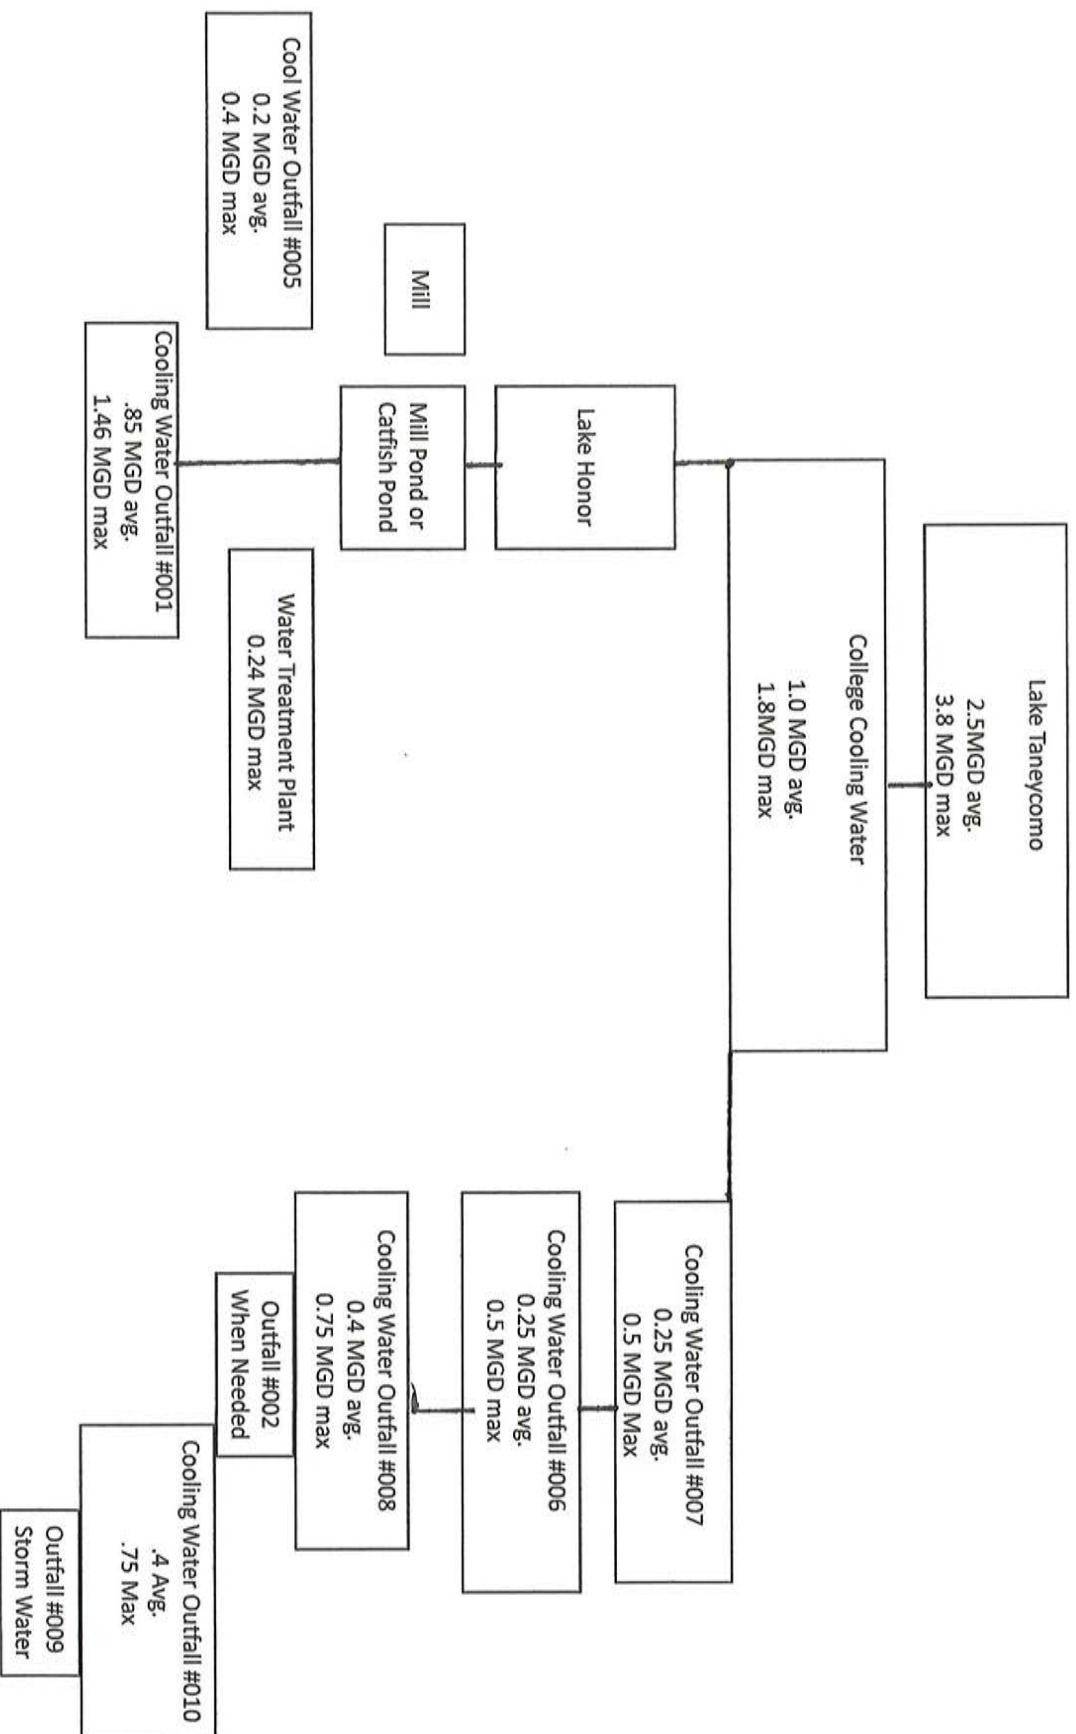



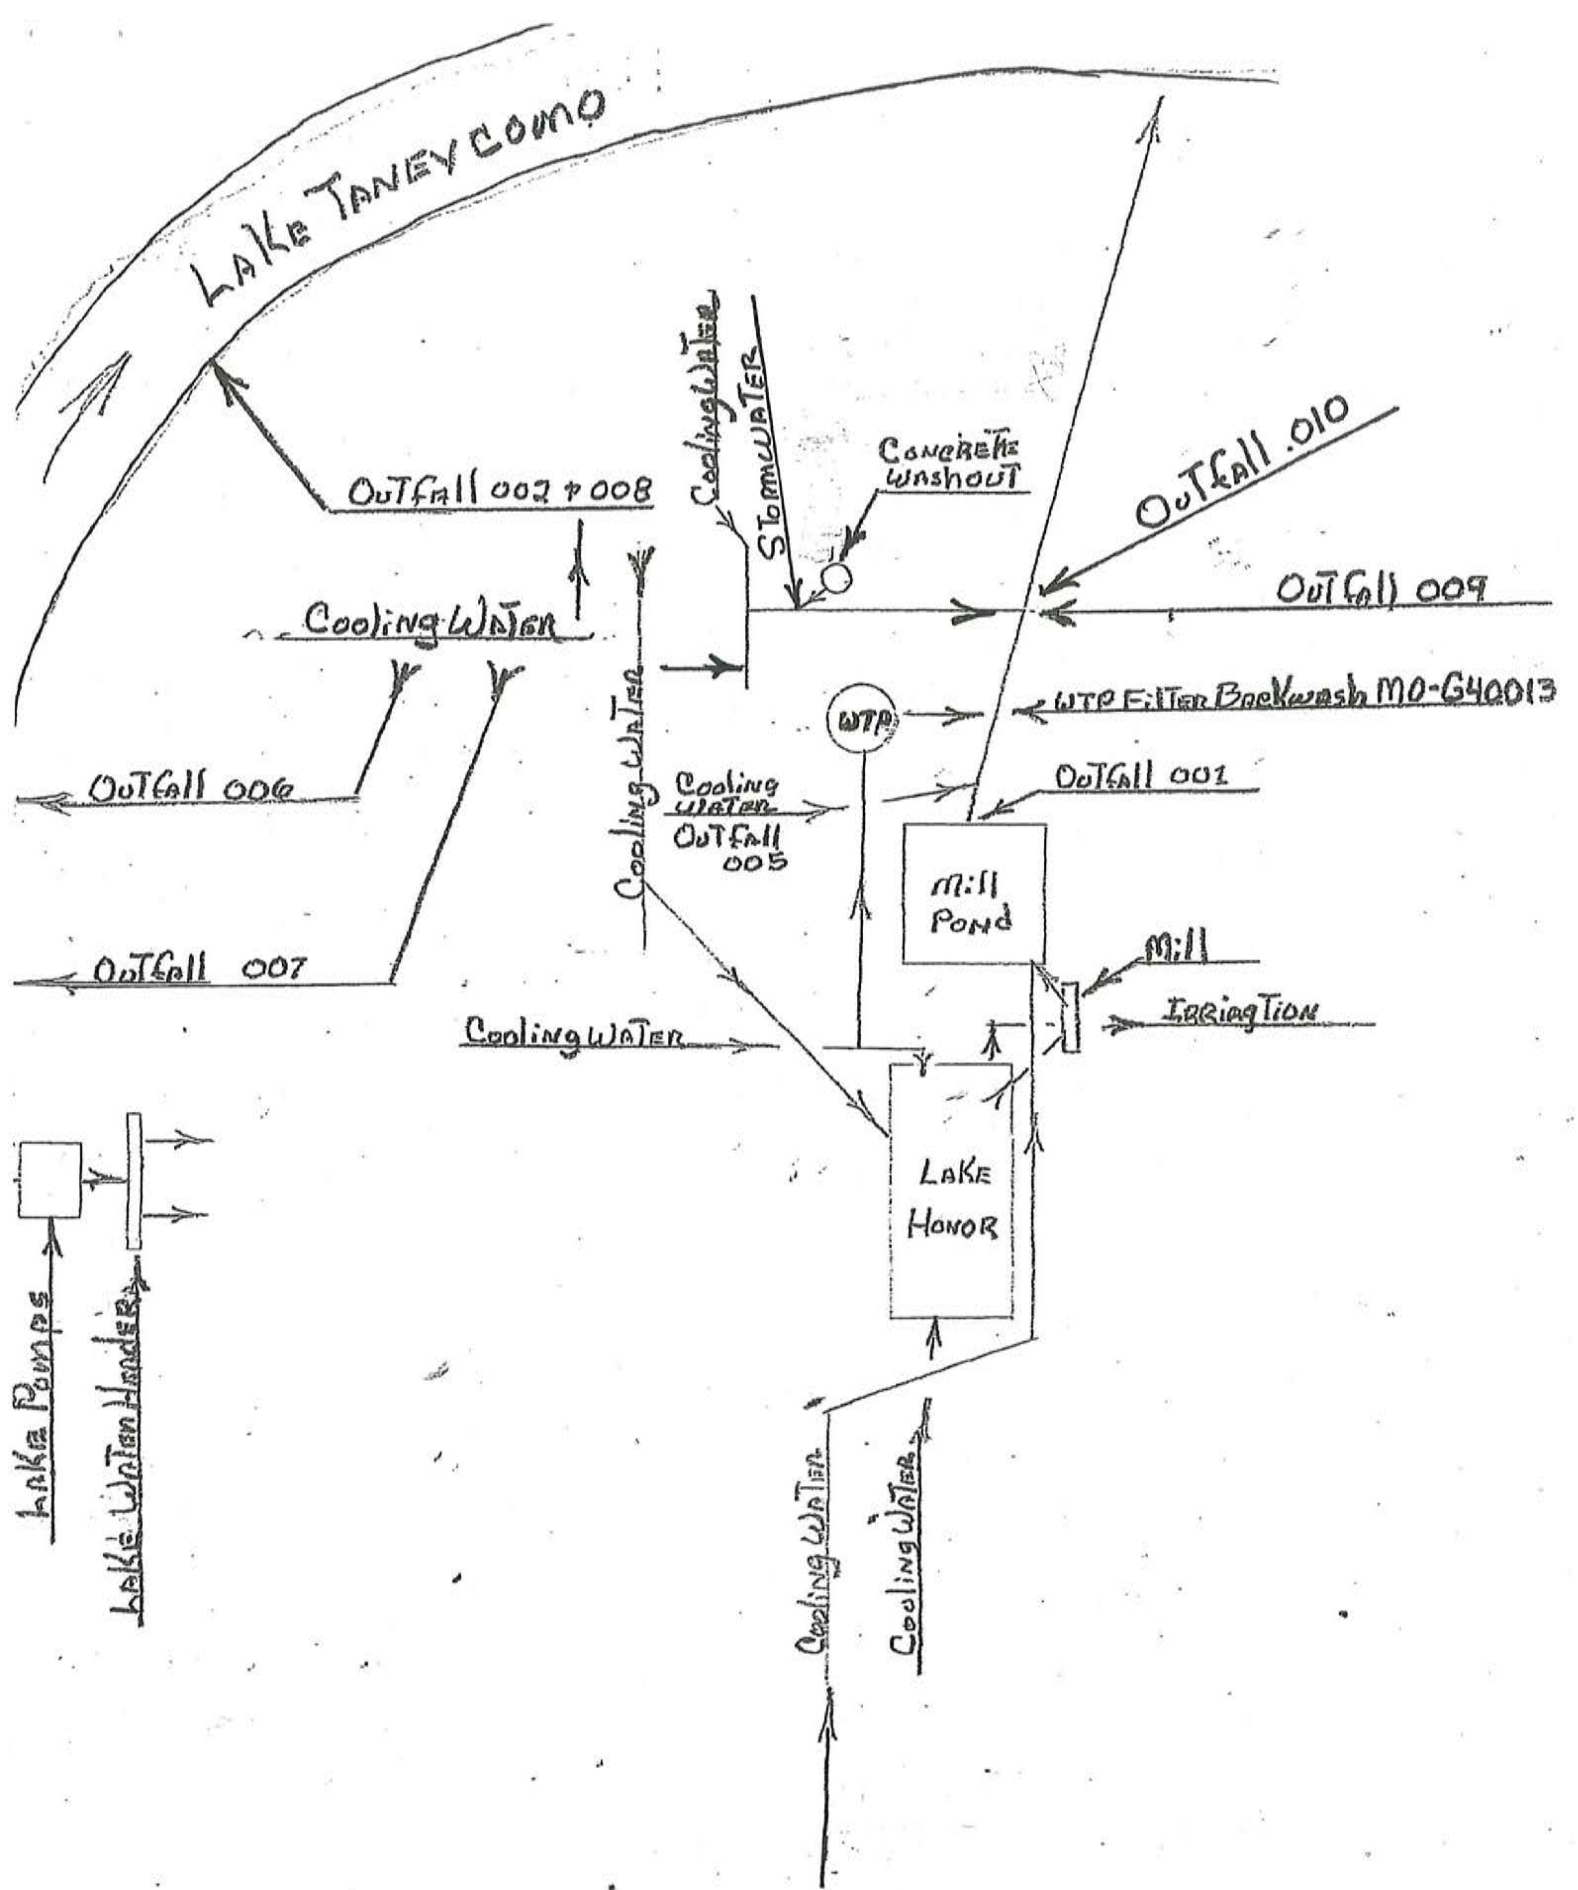





Operating  
Permit  
MO-0089117  
&  
MO-G640013

Permitted  
Feature #012  
Aeration  
Basin  
Daily

WTP Effluent  
Backwash  
NO-G440013

Over Flow at  
Mill Pond  
Outfall  
#001

500#  
1005

Permitted  
Feature #010  
Cooling  
Water  
Barrett Dorm

New  
Outfall  
#009

Mill Pond

Lake Honor

Permitted  
Feature #011  
Intake  
Structure  
Lake  
Taneycomo

Lake Water Header

Outfall #007

Outfall  
#006

Outfalls  
#002 & #008





MISSOURI DEPARTMENT OF NATURAL RESOURCES  
WATER PROTECTION PROGRAM, WATER POLLUTION BRANCH  
**FORM C – APPLICATION FOR DISCHARGE PERMIT –**  
**MANUFACTURING, COMMERCIAL, MINING,**  
**SILVICULTURE OPERATIONS, PROCESS AND STORMWATER**

RECEIVED

MAR 04 2019

Water Protection Program

**FOR AGENCY USE ONLY**

CHECK NO.

DATE RECEIVED

FEE SUBMITTED

**NOTE: DO NOT ATTEMPT TO COMPLETE THIS FORM BEFORE READING THE ACCOMPANYING INSTRUCTIONS**

1.00 NAME OF FACILITY

College of the Ozarks

1.10 THIS FACILITY IS NOW IN OPERATION UNDER MISSOURI OPERATING PERMIT NUMBER

MO-0089117

1.20 THIS IS A NEW FACILITY AND WAS CONSTRUCTED UNDER MISSOURI CONSTRUCTION PERMIT NUMBER (COMPLETE ONLY IF THIS FACILITY DOES NOT HAVE AN OPERATING PERMIT).

2.00 LIST THE STANDARD INDUSTRIAL CLASSIFICATION (SIC) CODES APPLICABLE TO YOUR FACILITY (FOUR DIGIT CODE)

A. FIRST 8221

B. SECOND

C. THIRD

D. FOURTH

2.10 FOR EACH OUTFALL GIVE THE LEGAL DESCRIPTION.

OUTFALL NUMBER (LIST) NW 1/4 SW 1/4 SEC 8 T 22N R 21W Taney COUNTY

2.20 FOR EACH OUTFALL LIST THE NAME OF THE RECEIVING WATER

OUTFALL NUMBER (LIST)  
#001, #002, #005, #006, #007, #008 #009, #010  
Permitted Feature #011 ( Intake structure )  
Permitted Feature #012 (Aeration Basin Dairy )

RECEIVING WATER  
All unnamed tributaries to Lake Taneycomo.

2.30 BRIEFLY DESCRIBE THE NATURE OF YOUR BUSINESS

4-year Liberal Arts College

B. For each outfall, provide a description of 1. All operations contributing wastewater to the effluent, including process wastewater, sanitary wastewater, cooling water and storm water runoff. 2. The average flow contributed by each operation. 3. The treatment received by the wastewater. Continue on additional sheets if necessary.

[illegible]

## 2.40 CONTINUED

C. EXCEPT FOR STORM RUNOFF, LEAKS OR SPILLS, ARE ANY OF THE DISCHARGES DESCRIBED IN ITEMS A OR B INTERMITTENT OR SEASONAL?

☒ YES (COMPLETE THE FOLLOWING TABLE)☐ NO (GO TO SECTION 2.50)

1. OUTFALL NUMBER <i>(list)</i>	2. OPERATION(S) CONTRIBUTING FLOW <i>(list)</i>	3. FREQUENCY		4. FLOW				C. DURATION <i>(in days)</i>
				A. FLOW RATE <i>(in mgd)</i>		B. TOTAL VOLUME <i>(specify with units)</i>		
		A. DAYS PER WEEK <i>(specify average)</i>	B. MONTHS PER YEAR <i>(specify average)</i>	1. LONG TERM AVERAGE	2. MAXIMUM DAILY	4. LONG TERM DAILY	3. MAXIMUM AVERAGE	
#001	cooling water continuous	7	12					
#005	cooling water seasonal	7	6					
#006	cooling water seasonal	7	6					
#007	cooling water seasonal	7	6					
#008	cooling water continuous	7	12					
#010	cooling water continuous	7	12					

## 2.50 MAXIMUM PRODUCTION

A. DOES AN EFFLUENT GUIDELINE LIMITATION PROMULGATED BY EPA UNDER SECTION 304 OF THE CLEAN WATER ACT APPLY TO YOUR FACILITY?

☐ YES (COMPLETE B.)☒ NO (GO TO SECTION 2.60)

B. ARE THE LIMITATIONS IN THE APPLICABLE EFFLUENT GUIDELINES EXPRESSED IN TERMS OF PRODUCTION (OF OTHER MEASURE OF OPERATION)?

☐ YES (COMPLETE C.)☐ NO (GO TO SECTION 2.60)

C. IF YOU ANSWERED "YES" TO B. LIST THE QUANTITY THAT REPRESENTS AN ACTUAL MEASUREMENT OF YOUR MAXIMUM LEVEL OF PRODUCTION, EXPRESSED IN THE TERMS AND UNITS USED IN THE APPLICABLE EFFLUENT GUIDELINE AND INDICATE THE AFFECTED OUTFALLS.

1. MAXIMUM QUANTITY			2. AFFECTED OUTFALLS (list outfall numbers)
A. QUANTITY PER DAY	B. UNITS OF MEASURE	C. OPERATION, PRODUCT, MATERIAL, ETC. (specify)	

## 2.60 IMPROVEMENTS

A. ARE YOU NOW REQUIRED BY ANY FEDERAL, STATE OR LOCAL AUTHORITY TO MEET, ANY IMPLEMENTATION SCHEDULE FOR THE CONSTRUCTION, UPGRADING OR OPERATION OF WASTEWATER TREATMENT EQUIPMENT OR PRACTICES OR ANY OTHER ENVIRONMENTAL PROGRAMS THAT MAY AFFECT THE DISCHARGES DESCRIBED IN THIS APPLICATION? THIS INCLUDES, BUT IS NOT LIMITED TO, PERMIT CONDITIONS, ADMINISTRATIVE OR ENFORCEMENT ORDERS, ENFORCEMENT COMPLIANCE SCHEDULE LETTERS, STIPULATIONS, COURT ORDERS AND GRANT OR LOAN CONDITIONS.

☐ YES (COMPLETE THE FOLLOWING TABLE)☒ NO (GO TO 3.00)

1. IDENTIFICATION OF CONDITION AGREEMENT, ETC.	2. AFFECTED OUTFALLS		3. BRIEF DESCRIPTION OF PROJECT	4. FINAL COMPLIANCE DATE	
				A. REQUIRED	B. PROJECTED

B. OPTIONAL: YOU MAY ATTACH ADDITIONAL SHEETS DESCRIBING ANY ADDITIONAL WATER POLLUTION CONTROL PROGRAMS (OR OTHER ENVIRONMENTAL PROJECTS WHICH MAY AFFECT YOUR DISCHARGES) YOU NOW HAVE UNDER WAY OR WHICH YOU PLAN. INDICATE WHETHER EACH PROGRAM IS NOW UNDER WAY OR PLANNED, AND INDICATE YOUR ACTUAL OR PLANNED SCHEDULES FOR CONSTRUCTION.

☐ MARK "X" IF DESCRIPTION OF ADDITIONAL CONTROL PROGRAMS IS ATTACHED.

[illegible]



## 3.10 BIOLOGICAL TOXICITY TESTING DATA

DO YOU HAVE ANY KNOWLEDGE OR REASON TO BELIEVE THAT ANY BIOLOGICAL TEST FOR ACUTE OR CHRONIC TOXICITY HAS BEEN MADE ON ANY OF YOUR DISCHARGES OR ON RECEIVING WATER IN RELATION TO YOUR DISCHARGE WITHIN THE LAST THREE YEARS?

☐ YES (IDENTIFY THE TEST(S) AND DESCRIBE THEIR PURPOSES BELOW.)

☒ NO (GO TO 3.20)

## 3.20 CONTRACT ANALYSIS INFORMATION

WERE ANY OF THE ANALYSES REPORTED PERFORMED BY A CONTRACT LABORATORY OR CONSULTING FIRM?

☒ YES (LIST THE NAME, ADDRESS AND TELEPHONE NUMBER OF AND POLLUTANTS ANALYZED BY EACH SUCH LABORATORY OR FIRM BELOW.)

☐ NO (GO TO 3.30)

A. NAME	B. ADDRESS	C. TELEPHONE (area code and number)	D. POLLUTANTS ANALYZED (list)
Consulting Analytical Services International Incorporated	3378 S. Scenic Ave., Suite A Springfield Mo. 65807	(417) 882-1017	Total Suspended Solids Total Settleable Solids Oil and Grease Total Biochemical Oxygen Demand Chemical Oxygen Demand Ammonia as Nitrogen Total Organic Carbon

## 3.30 CERTIFICATION

I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED IN THIS APPLICATION AND ALL ATTACHMENTS AND THAT, BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THAT THE INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT.


NAME AND OFFICIAL TITLE (TYPE OR PRINT)

Richard Fredrick Water Treatment Plant Supervisor

TELEPHONE NUMBER WITH AREA CODE

417-690-3273

SIGNATURE (SEE INSTRUCTIONS)



DATE SIGNED

2-28-19

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet  
(Use the same format) instead of completing these pages.  
SEE INSTRUCTIONS

FORM C  
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS

OUTFALL NO.  
#001

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT										3. UNITS (specify if blank)		4. INTAKE (optional)		
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES		A. CONCENTRATION		B. MASS		A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1)	(2)	(1)	(2)	(1)	(2)	(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)	<2 mg/l	21.69 lbs			< mg/l	15.02 lbs	1								
B. Chemical Oxygen Demand (COD)	<10 mg/l	108.4 lbs			<10 mg/l	75.1 lbs	1								
C. Total organic Carbon (TOC)	2.5 mg/l	27.12 lbs			2.5 mg/l	18.77 lbs	1								
D. Total Suspended Solids (TSS)	5 mg/l	54.24 lbs			2.6 mg/l	19.52 lbs	12								
E. Ammonia (as N)	<0.1 mg/l	1.08 lbs			<0.1 mg/l	0.75 lbs	1								
F. Flow	1.3 MGD				0.9 MGD										
G. Temperature (winter)	4.4				8.3		12								
H. Temperature (summer)	20.5				17.2		12								
I. pH	MINIMUM 7.28	MAXIMUM 7.81													

PART B - Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT										4. UNITS		5. INTAKE (optional)		
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES		A. CONCENTRATION		B. MASS		A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1)	(2)	(1)	(2)	(1)	(2)	(1) CONCENTRATION	(2) MASS	
A. Bromide (24959-67-9)		X															
B. Chlorine, Total Residual		X															
C. Color		X															
D. Fecal Coliform		X															
E. Fluoride (16984-48-8)		X															
F. Nitrate - Nitrate (as N)		X															

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS						
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		5.5 mg/L	59.66 lbs			5.2 mg/L	39.05 lbs	12					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO <sup>4</sup> ) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO <sup>3</sup> ) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)		X												
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												
MO 780-1514 (06-13)														

PAGE 7



1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS						
<b>METALS, AND TOTAL PHENOLS</b>														
1M. Antimony, Total (7440-36-9)	X													
2M. Arsenic, Total (7440-38-2)	X													
3M. Beryllium, Total (7440-41-7)	X													
4M. Cadmium, Total (7440-43-9)	X													
5M. Chromium III (16065-83-1)	X													
6M. Chromium VI (18540-29-9)	X													
7M. Copper, Total (7440-50-8)	X													
8M. Lead, Total (7439-92-1)	X													
9M. Mercury, Total (7439-97-6)	X													
10M. Nickel, Total (7440-02-0)	X													
11M. Selenium, Total (7782-49-2)	X													
12M. Silver, Total (7440-22-4)	X													
13M. Thallium, Total (7440-28-0)	X													
14M. Zinc, Total (7440-66-6)	X													
15M. Cyanide, Amenable to Chlorination	X													
16M. Phenols, Total	X													
<b>RADIOACTIVITY</b>														
(1) Alpha Total	X													
(2) Beta Total	X													
(3) Radium Total	X													
(4) Radium 226 Total	X													

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet.  
(Use the same format) instead of completing these pages.  
SEE INSTRUCTIONS

FORM C  
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS

OUTFALL NO.  
#005

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)	<2 mg/l	5 lbs			<2 mg/l	3.3 lbs	1					
B. Chemical Oxygen Demand (COD)	<10 mg/l	25 lbs			<10 mg/l	16.69 lbs	1					
C. Total organic Carbon (TOC)	2.2 mg/l	5.5 lbs			2.2 mg/l	3.67 lbs	1					
D. Total Suspended Solids (TSS)	12 mg/l	30 lbs			3 mg/l	5 lbs	6					
E. Ammonia (as N)	<0.1 mg/l	0.25 lbs			<0.1 mg/l	0.16 lbs	1					
F. Flow	VALUE 0.3 MGD		VALUE		VALUE 0.2MGD					VALUE		
G. Temperature (winter)	VALUE 4.4		VALUE		VALUE 4.4		6		°C	VALUE		
H. Temperature (summer)	VALUE 18.8		VALUE		VALUE 16		6		°C	VALUE		
I. pH	MINIMUM 7.49	MAXIMUM 7.84	MINIMUM	MAXIMUM				STANDARD UNITS				

PART B - Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS														
A. Bromide (24959-67-9)		X												
B. Chlorine, Total Residual		X												
C. Color		X												
D. Fecal Coliform		X												
E. Fluoride (16984-48-8)		X												
F. Nitrate - Nitrate (as N)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "x"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		6.9 mg/L	17 lbs			5.4 mg/L	9.01 lbs	6					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO <sup>4</sup> ) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO <sup>3</sup> ) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)		X												
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-98-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

MO 780-1514 (06-13)

PAGE 7

MO 780-1514 (06-13)

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS						
<b>METALS, AND TOTAL PHENOLS</b>														
1M. Antimony, Total (7440-36-9)	X													
2M. Arsenic, Total (7440-38-2)	X													
3M. Beryllium, Total (7440-41-7)	X													
4M. Cadmium, Total (7440-43-9)	X													
5M. Chromium III (15065-83-1)	X													
6M. Chromium VI (18540-29-9)	X													
7M. Copper, Total (7440-50-8)	X													
8M. Lead, Total (7439-92-1)	X													
9M. Mercury, Total (7439-97-6)	X													
10M. Nickel, Total (7440-02-0)	X													
11M. Selenium, Total (7782-49-2)	X													
12M. Silver, Total (7440-22-4)	X													
13M. Thallium, Total (7440-28-0)	X													
14M. Zinc, Total (7440-66-6)	X													
15M. Cyanide, Amenable to Chlorination	X													
16M. Phenols, Total	X													
<b>RADIOACTIVITY</b>														
(1) Alpha Total	X													
(2) Beta Total	X													
(3) Radium Total	X													
(4) Radium 226 Total	X													



PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet  
(Use the same format) instead of completing these pages.  
SEE INSTRUCTIONS

FORM C  
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS

OUTFALL NO.  
#006

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)	<2 mg/l	7.51 lbs			<2 mg/l	15.02 lbs	1					
B. Chemical Oxygen Demand (COD)	<10 mg/l	37.55 lbs			<10 mg/l	75.1 lbs	1					
C. Total organic Carbon (TOC)	2.1 mg/l	7.88 lbs			2.1 mg/l	18.77 lbs	1					
D. Total Suspended Solids (TSS)	1 mg/l	3.75 lbs			1 mg/l	19.52 lbs	6					
E. Ammonia (as N)	<0.1 mg/l	0.37 lbs			<0.1 mg/l	0.75 lbs	1					
F. Flow	VALUE 0.45 MGD		VALUE		VALUE 0.25 MGD					VALUE		
G. Temperature (winter)	VALUE 6.6		VALUE		VALUE 6.6		6		°C	VALUE		
H. Temperature (summer)	VALUE 18.3		VALUE		VALUE 16		6		°C	VALUE		
I. pH	MINIMUM 7.36	MAXIMUM 7.67	MINIMUM	MAXIMUM				STANDARD UNITS				

PART B - Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT								4. UNITS		5. INTAKE (optional)		
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES	
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS		
CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS															
A. Bromide (24959-67-9)		X													
B. Chlorine, Total Residual		X													
C. Color		X													
D. Fecal Coliform		X													
E. Fluoride (16984-48-8)		X													
F. Nitrate - Nitrate (as N)		X													



1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "x"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		5.3 mg/L	19.9 lbs			5.18 mg/L	10.8 lbs	6					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO <sup>4</sup> ) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO <sup>3</sup> ) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)		X												
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												
MO 780-1514 (06-13)														
PAGE 7														

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
<b>METALS, AND TOTAL PHENOLS</b>														
1M. Antimony, Total (7440-36-9)	X													
2M. Arsenic, Total (7440-38-2)	X													
3M. Beryllium, Total (7440-41-7)	X													
4M. Cadmium, Total (7440-43-9)	X													
5M. Chromium III (15065-83-1)	X													
6M. Chromium VI (18540-29-9)	X													
7M. Copper, Total (7440-50-8)	X													
8M. Lead, Total (7439-92-1)	X													
9M. Mercury, Total (7439-97-6)	X													
10M. Nickel, Total (7440-02-0)	X													
11M. Selenium, Total (7782-49-2)	X													
12M. Silver, Total (7440-22-4)	X													
13M. Thallium, Total (7440-28-0)	X													
14M. Zinc, Total (7440-66-6)	X													
15M. Cyanide, Amenable to Chlorination	X													
16M. Phenols, Total	X													
<b>RADIOACTIVITY</b>														
(1) Alpha Total	X													
(2) Beta Total	X													
(3) Radium Total	X													
(4) Radium 226 Total	X													

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet  
(Use the same format) instead of completing these pages.  
SEE INSTRUCTIONS

FORM C  
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS

OUTFALL NO.  
#007

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)	<2 mg/l	7.51 lbs			<2 mg/l	4.17 lbs	1					
B. Chemical Oxygen Demand (COD)	<10 mg/l	37.55 lbs			<10 mg/l	20.86 lbs	1					
C. Total organic Carbon (TOC)	2.1 mg/l	7.88 lbs			2.1 mg/l	4.38 lbs	1					
D. Total Suspended Solids (TSS)	1 mg/l	3.75 lbs			1 mg/l	2.08 lbs	6					
E. Ammonia (as N)	<0.1 mg/l	0.37 lbs			<0.1 mg/l	0.2 lbs	1					
F. Flow	VALUE 0.45 MGD		VALUE		VALUE 0.25 MGD					VALUE		
G. Temperature <i>(winter)</i>	VALUE 6.6		VALUE		VALUE 6.6		6		°C	VALUE		
H. Temperature <i>(summer)</i>	VALUE 18.3		VALUE		VALUE 16.6		6		°C	VALUE		
I. pH	MINIMUM 7.39	MAXIMUM 7.74	MINIMUM	MAXIMUM				STANDARD UNITS				

PART B - Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS														
A. Bromide (24959-67-9)		X												
B. Chlorine, Total Residual		X												
C. Color		X												
D. Fecal Coliform		X												
E. Fluoride (16984-48-8)		X												
F. Nitrate - Nitrate (as N)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS						
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		5.4 mg/L	20.27 lb			5.1 mg/L	10.64 lbs	6					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO <sup>4</sup> ) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO <sup>3</sup> ) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)		X												
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-98-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												



1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELEVED PRESENT	B. BELEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS						
<b>METALS, AND TOTAL PHENOLS</b>														
1M. Antimony, Total (7440-36-9)	X													
2M. Arsenic, Total (7440-38-2)	X													
3M. Beryllium, Total (7440-41-7)	X													
4M. Cadmium, Total (7440-43-9)	X													
5M. Chromium III (16065-83-1)	X													
6M. Chromium VI (18540-29-9)	X													
7M. Copper, Total (7440-50-8)	X													
8M. Lead, Total (7439-92-1)	X													
9M. Mercury, Total (7439-97-6)	X													
10M. Nickel, Total (7440-02-0)	X													
11M. Selenium, Total (7782-49-2)	X													
12M. Silver, Total (7440-22-4)	X													
13M. Thallium, Total (7440-28-0)	X													
14M. Zinc, Total (7440-66-6)	X													
15M. Cyanide, Amenable to Chlorination	X													
16M. Phenols, Total	X													
<b>RADIOACTIVITY</b>														
(1) Alpha Total	X													
(2) Beta Total	X													
(3) Radium Total	X													
(4) Radium 226 Total	X													

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet  
(Use the same format) instead of completing these pages.  
SEE INSTRUCTIONS

FORM C  
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS

OUTFALL NO.  
#008

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT										3. UNITS (specify if blank)		4. INTAKE (optional)	
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES		
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS			
A. Biochemical Oxygen Demand (BOD)	<2 mg/l	10.01 lbs			<2 mg/l	4.17 lbs	1							
B. Chemical Oxygen Demand (COD)	<10 mg/l	50.07 lbs			<10 mg/l	20.86 lbs	1							
C. Total organic Carbon (TOC)	2.1 mg/l	10.51 lbs			2.1 mg/l	4.38 lbs	1							
D. Total Suspended Solids (TSS)	3 mg/l	15.02 lbs			1.3 mg/l	2.08 lbs	12							
E. Ammonia (as N)	<0.1 mg/l	0.5 lbs			<0.1 mg/l	0.2 lbs	1							
F. Flow	VALUE 0.6 MGD		VALUE		VALUE 0.4 MGD					VALUE				
G. Temperature (winter)	VALUE 4.4		VALUE		VALUE 10		12		°C	VALUE				
H. Temperature (summer)	VALUE 18.3		VALUE		VALUE 15		12		°C	VALUE				
I. pH	MINIMUM 7.28	MAXIMUM 7.84	MINIMUM	MAXIMUM					STANDARD UNITS					

PART B - Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Bromide (24959-67-9)	X													
B. Chlorine, Total Residual	X													
C. Color	X													
D. Fecal Coliform	X													
E. Fluoride (16984-48-8)	X													
F. Nitrate - Nitrate (as N)	X													

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		5.4 mg/L	27.03 lbs			5.1 mg/L	17.02 lbs	12					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO <sup>4</sup> ) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO <sup>3</sup> ) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)		X												
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

MO 780-1514 (06-13)

PAGE 7



1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
<b>METALS, AND TOTAL PHENOLS</b>														
1M. Antimony, Total (7440-36-9)	X													
2M. Arsenic, Total (7440-38-2)	X													
3M. Beryllium, Total (7440-41-7)	X													
4M. Cadmium, Total (7440-43-9)	X													
5M. Chromium III (16065-83-1)	X													
6M. Chromium VI (18540-29-9)	X													
7M. Copper, Total (7440-50-8)	X													
8M. Lead, Total (7439-92-1)	X													
9M. Mercury, Total (7439-97-6)	X													
10M. Nickel, Total (7440-02-0)	X													
11M. Selenium, Total (7782-49-2)	X													
12M. Silver, Total (7440-22-4)	X													
13M. Thallium, Total (7440-28-0)	X													
14M. Zinc, Total (7440-66-6)	X													
15M. Cyanide, Amenable to Chlorination	X													
16M. Phenols, Total	X													
<b>RADIOACTIVITY</b>														
(1) Alpha Total	X													
(2) Beta Total	X													
(3) Radium Total	X													
(4) Radium 226 Total	X													



PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet  
(Use the same format) instead of completing these pages.  
SEE INSTRUCTIONS

FORM C  
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS

OUTFALL NO.  
#009

PART A - You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)	<2 mg/l	10.01 lbs			<2 mg/l	1.81 lbs	1					
B. Chemical Oxygen Demand (COD)	<10 mg/l	50.07 lbs			<10 mg/l	9.09 lbs	1					
C. Total organic Carbon (TOC)	2.1 mg/l	10.51 lbs			2.1 mg/l	1.91 lbs	1					
D. Total Suspended Solids (TSS)	11 mg/l	15.02 lbs			7 mg/l	6 lbs	4					
E. Ammonia (as N)	<0.1 mg/l	0.5 lbs			<0.1 mg/l	0.09 lbs	1					
F. Flow	VALUE 0.188 MGD (Rain)		VALUE		VALUE 0.109 MGD (Rain)					VALUE		
G. Temperature (winter)	VALUE 5.5		VALUE		VALUE 14.4		4	°C		VALUE		
H. Temperature (summer)	VALUE 18.3		VALUE		VALUE 15		4	°C		VALUE		
I. pH	MINIMUM 7.35	MAXIMUM 7.88	MINIMUM	MAXIMUM				STANDARD UNITS				

PART B - Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS														
A. Bromide (24959-67-9)		X												
B. Chlorine, Total Residual		X												
C. Color		X												
D. Fecal Coliform		X												
E. Fluoride (16984-48-8)		X												
F. Nitrate - Nitrate (as N)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		5.7 mg/L	8.94 lbs			5 mg/L	4.54 lbs	4					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO <sup>4</sup> ) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO <sup>3</sup> ) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)		X												
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

MO 780-1514 (06-13)

PAGE 7

MO 780-1514 (06-13)

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
<b>METALS, AND TOTAL PHENOLS</b>														
1M. Antimony, Total (7440-36-9)	X													
2M. Arsenic, Total (7440-38-2)	X													
3M. Beryllium, Total (7440-41-7)	X													
4M. Cadmium, Total (7440-43-9)	X													
5M. Chromium III (16065-83-1)	X													
6M. Chromium VI (18540-29-9)	X													
7M. Copper, Total (7440-50-8)	X													
8M. Lead, Total (7439-92-1)	X													
9M. Mercury, Total (7439-97-6)	X													
10M. Nickel, Total (7440-02-0)	X													
11M. Selenium, Total (7782-49-2)	X													
12M. Silver, Total (7440-22-4)	X													
13M. Thallium, Total (7440-28-0)	X													
14M. Zinc, Total (7440-66-6)	X													
15M. Cyanide, Amenable to Chlorination	X													
16M. Phenols, Total	X													
<b>RADIOACTIVITY</b>														
(1) Alpha Total	X													
(2) Beta Total	X													
(3) Radium Total	X													
(4) Radium 226 Total	X													



PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet  
(Use the same format) instead of completing these pages.  
SEE INSTRUCTIONS

FORM C  
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS

OUTFALL NO.  
#010

PART A – You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)	<2 mg/l	10.01 lbs			<2 mg/l	6.67 lbs	1					
B. Chemical Oxygen Demand (COD)	<10 mg/l	50.07 lbs			<10 mg/l	33.38 lbs	1					
C. Total organic Carbon (TOC)	2.1 mg/l	10.51 lbs			2.1 mg/l	7.01 lbs	1					
D. Total Suspended Solids (TSS)	4 mg/l	20.02 lbs			1.6 mg/l	5.34 lbs	12					
E. Ammonia (as N)	<0.1 mg/l	0.5 lbs			<0.1 mg/l	0.33 lbs	1					
F. Flow	VALUE 0.6 MGD		VALUE		VALUE 0.4 MGD					VALUE		
G. Temperature (winter)	VALUE 7.2		VALUE		VALUE 11.1		12		°C	VALUE		
H. Temperature (summer)	VALUE 18.8		VALUE		VALUE 15.5		12		°C	VALUE		
I. pH	MINIMUM 7.28	MAXIMUM 7.94	MINIMUM	MAXIMUM				STANDARD UNITS				

PART B – Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS														
A. Bromide (24959-67-9)		X												
B. Chlorine, Total Residual		X												
C. Color		X												
D. Fecal Coliform		X												
E. Fluoride (16984-48-8)		X												
F. Nitrate - Nitrate (as N)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		5.4 mg/L	27.03 lbs			5.2 mg/L	17.35 lbs	12					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO <sub>4</sub> ) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO <sub>3</sub> ) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)		X												
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

IO 780-1514 (05-13)

PAGE 7

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
<b>METALS, AND TOTAL PHENOLS</b>														
1M. Antimony, Total (7440-36-9)	X													
2M. Arsenic, Total (7440-38-2)	X													
3M. Beryllium, Total (7440-41-7)	X													
4M. Cadmium, Total (7440-43-9)	X													
5M. Chromium III (15065-83-1)	X													
6M. Chromium VI (18540-29-9)	X													
7M. Copper, Total (7440-50-8)	X													
8M. Lead, Total (7439-92-1)	X													
9M. Mercury, Total (7439-97-6)	X													
10M. Nickel, Total (7440-02-0)	X													
11M. Selenium, Total (7782-49-2)	X													
12M. Silver, Total (7440-22-4)	X													
13M. Thallium, Total (7440-28-0)	X													
14M. Zinc, Total (7440-66-6)	X													
15M. Cyanide, Amenable to Chlorination	X													
16M. Phenols, Total	X													
<b>RADIOACTIVITY</b>														
(1) Alpha Total	X													
(2) Beta Total	X													
(3) Radium Total	X													
(4) Radium 226 Total	X													

**FLOW** 0.108 MGD

Settleable Solids 0.03 ml/L/HR

Total Residue  
Chlorine 0 mg/L

Dissolved Oxygen 7.9 mg/L

pH 7.28



## Annual Report For Aeration Basin At Dairy Barn Holding Tank Outfall #012 - MDNR Permit No. MO-0089117

**NOTE: Cofo will Work with 2300 Gals/Load at times. YEAR 2018**

Quarter#1 Date	No. of Loads	Freeboard FT. South Tank	Freeboard FT. North Tank	MG Pumped
1/2/18		7.25	5.83	
1/9		7.17	5.0	
1/16		7.17	4.17	
1/22		7.08	2.92	
1/29		6.0	2.92	
2/5/18		4.42	2.92	
2/12		2.92	2.92	
2/21		0.42	2.92	
2/26		0.42	.25	
3/5/18		0.42	.833	0.0122
3/6				0.0122
3/7				0.02925
3/8				0.0315
3/9				0.027
3/12		5.0	3.0	
3/19		3.0	3.0	
3/26		1.0	3.0	
Total				.11215

Quarter#3 Date	No. of Loads	Freeboard FT. South Tank	Freeboard FT. North Tank	MG Pumped
7/2/18		6	8.33	
7/9		4	8.16	
7/16		3	8.16	
7/23		2.16	5.83	
7/30		2.08	4	
8/6/18		2.33	2.33	
8/13		1.16	2.58	0.027
8/14				0.036
8/20		0.883	4.83	
8/21				0.018
8/23				0.0045
8/27		0.53	6.33	
8/28				0.01125
8/30				0.03375
8/31				0.02475
9/3/18		3.75	8.5	0.0135
9/4				0.02475
9/5				0.0225
9/6				0.018
9/10		8.16	8.5	
9/17		6	8.33	
9/24		4.25	8.25	
Total				0.234

Quarter#2 Date	No. of Loads	Freeboard FT. South Tank	Freeboard FT. North Tank	MG Pumped
4/2/18		1.0	2.5	
4/9		0.66	2.5	
4/16		0.33	2.5	
4/23		0.33	2.16	
4/27				0.009
4/28.				0.0135
4/29				0.01125
5/1/18				0.0225
5/2				0.03375
5/3				0.018
5/4				0.01575
5/7		2.83	8.83	0.02925
5/8				0.02925
5/9				0.02925
5/14		2.5	8.83	
5/21		2.16	7.08	
5/28		2.0	5.41	
6/4/18		2.08	4	
6/11		2.08	2.91	
6/15				0.0315
6/18		2.08	3.83	0.0315
6/19				0.0495
6/20				0.05175
6/21				0.05175
6/22				0.05175
6/25		7	8.33	
Total				.47925

Quarter#4 Date	No. of Loads	Freeboard FT. South Tank	Freeboard FT. North Tank	MG Pumped
10/1/18		2.66	8.16	
10/8		1.08	8.16	
10/15		1	6.66	
10/22		1	5.58	
10/29		1	3.91	
11/5/18		0.83	2.83	
11/12		0.91	1.66	
11/19		0.91	0.75	
11/26		1	0.83	0.01575
11/27				0.02925
11/28				0.0315
11/29				0.02475
11/30				0.02925
12/3		0.83	8.25	0.009
12/4				0.0225
12/5				0.027
12/6				0.018
12/10		4.5	8.25	
12/17		3.25	8.08	
12/24		1.41	8.08	
12/31		0.33	8	
Total				0.207

**Any Illegal Discharge: If Any On Back**

**Maintenance & Repairs:**

**If Any On Back**

**Total MG Pumped :**  
**1.0324**

**Name; Richard Fredrick**

**Signature:**

Date: 1/4/2019

**Title:** Supervisor