

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended,

Permit No. MO-0123943

Owner: Eagle View Estates Homeowners Association, Inc.
Address: 825 North Waco, Wichita, KS 67203

Continuing Authority: same as above
Address: same as above

Facility Name: Eagle View Estates WWTF
Facility Address: Lake Road 5-45, Sunrise Beach, MO 65079

Legal Description: NW¼, NW¼, Sec. 9, T39N, R17W, Camden County
UTM Coordinates: X = 517455, Y= 4221506

Receiving Stream: Lake of the Ozarks (L2)
First Classified Stream and ID: Lake of the Ozarks (L2) (7205)
USGS Basin & Sub-watershed No.: (10290109-0207)

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

FACILITY DESCRIPTION

Outfall #001 - NON-POTW – SIC # 8641
No Certified Operator Required.
Septic Tank/ Recirculating Sand Filter/ Chlorination/ Dechlorination/ Sludge disposal by contract hauler.
Design population equivalent is 30 PE.
Design flow is 2,220 gallons per day.
Actual flow is 440 gallons per day.
Design sludge production is 0.21 dry tons/year.

This permit authorizes only wastewater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 644.051.6 of the Law.

November 1, 2013
Effective Date

March 31, 2017
Expiration Date

Sara Parker Pauley, Director, Department of Natural Resources

John Madras, Director, Water Protection Program

OUTFALL #001	TABLE A. FINAL EFFLUENT LIMITATIONS and MONITORING REQUIREMENTS for LAKES and RESERVOIRS 10 CSR 20-7.015(3)					

The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective upon issuance and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:

EFFLUENT PARAMETER(S)	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
Flow	MGD	*		*	once/quarter***	24 hr. estimate
Biochemical Oxygen Demand ₅	mg/L		30	20	once/quarter***	grab
Total Suspended Solids	mg/L		30	20	once/quarter***	grab
pH – Units	SU	**		**	once/quarter***	grab
Ammonia as N	mg/L	12.1		4.6	once/quarter***	grab
<i>E. coli</i> ¹	#/100 ml	630		126	once/quarter***	grab
Total Residual Chlorine ²	µg/L	17 (130ML)		8 (130ML)	once/quarter***	grab

MONITORING REPORTS SHALL BE SUBMITTED QUARTERLY; THE FIRST REPORT IS DUE JANUARY 28, 2014. THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.

EFFLUENT PARAMETER(S)	UNITS	DAILY MINIMUM	WEEKLY AVERAGE MINIMUM	MONTHLY AVERAGE MINIMUM	MEASUREMENT FREQUENCY	SAMPLE TYPE
Dissolved Oxygen ²	mg/L	*		*	once/quarter***	grab

MONITORING REPORTS SHALL BE SUBMITTED QUARTERLY; THE FIRST REPORT IS DUE JANUARY 28, 2014.

- * Monitoring requirement only.
- ** pH is measured in pH units and is not to be averaged. The pH is limited to the range of 6.5-9.0 pH units.
- *** Quarterly sampling is required and samples shall be collected and tested for the parameters listed in Table A-2 if a discharge occurs during the reporting period. If the facility serves a part-time or seasonal establishment/residence(s), then sampling shall occur while the treatment facility is operating and after a discharge begins. See table on Page 3 for quarterly sampling schedule.

¹ Effluent limitations and monitoring requirements for *E. coli* are applicable only during the recreational season from April 1 through October 31. The Monthly Average Limit for *E. coli* is expressed as a geometric mean. The Weekly Average for *E. coli* will be expressed as a geometric mean if more than one (1) sample is collected during a calendar week (Sunday through Saturday).

² Effluent limitations and monitoring requirements for Total Residual Chlorine (TRC) and Dissolved Oxygen (DO) only apply to facilities using the chlorine method of disinfection.

- This effluent limit is below the minimum quantification level (ML) of the most common and practical EPA approved CLTRC methods. The department has determined the current acceptable ML for total residual chlorine to be 130 µg/L when using the DPD Colorimetric Method #4500 – CL G. from Standard Methods for the Examination of Waters and Wastewater. The permittee will conduct analyses in accordance with this method, or equivalent, and report actual analytical values. Measured values greater than or equal to the minimum quantification level of 130 µg/L will be considered violations of the permit and values less than the minimum quantification level of 130 µg/L will be considered to be in compliance with the permit limitation. The minimum quantification level does not authorize the discharge of chlorine in excess of the effluent limits stated in the permit.
- Do not chemically de-chlorinate **if it is not needed to meet the limits in your permit.**
- If no chlorine was used in a given sampling period, an actual analysis is not necessary. Simply report as “0 µg/L” TRC.
- DO monitoring requirements only apply during months that the facility is chlorinating.

Minimum Sampling Requirements				
Quarter	Months	E. coli, Total Residual Chlorine (TRC), and Dissolved Oxygen	All Other Parameters	Report is Due
First	January, February, March	Not required to sample.	Sample at least once during any month of the quarter	April 28 th
Second	April, May, June	Sample at least once during any month of the quarter	Sample at least once during any month of the quarter	July 28 th
Third	July, August, September	Sample at least once during any month of the quarter	Sample at least once during any month of the quarter	October 28 th
Fourth	October, November, December	Sample once during October; no sample required in either November or December	Sample at least once during any month of the quarter	January 28 th

B. STANDARD CONDITIONS

In addition to specified conditions stated herein, this permit is subject to the attached Parts I & III standard conditions dated October 1, 1980 and August 15, 1994, and hereby incorporated as though fully set forth herein.

C. SPECIAL CONDITIONS

1. This permit establishes final ammonia limitations based on Missouri's current Water Quality Standard. On August 22, 2013, the Environmental Protection Agency (EPA) published a notice in the Federal Register announcing the final national recommended ambient water quality criteria for protection of aquatic life from the effects of ammonia in freshwater. The EPA's guidance, Final Aquatic Life Ambient Water Quality Criteria for Ammonia – Fresh Water 2013, is not a rule, nor automatically part of a state's water quality standards. States must adopt new ammonia criteria consistent with EPA's published ammonia criteria into their water quality standards that protect the designated uses of the water bodies. The Department of Natural Resources intends to adopt the new ammonia criteria during the next review. Information on this topic can be obtained by viewing the Department's 2013 EPA criteria Factsheet located at <http://dnr.mo.gov/pubs/pub2481.pdf>.
2. This permit may be reopened and modified, or alternatively revoked and reissued, to:
 - (a) Comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
 - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
 - (2) controls any pollutant not limited in the permit.
 - (b) Incorporate new or modified effluent limitations or other conditions, if the result of a waste load allocation study, toxicity test or other information indicates changes are necessary to assure compliance with Missouri's Water Quality Standards.
 - (c) Incorporate new or modified effluent limitations or other conditions if, as the result of a watershed analysis, a Total Maximum Daily Load (TMDL) limitation is developed for the receiving waters which are currently included in Missouri's list of waters of the state not fully achieving the state's water quality standards, also called the 303(d) list.
 - (d) Incorporate the requirement to develop a pretreatment program pursuant to 40 CFR 403.8(a) when the Director of the Water Protection Program determines that a pretreatment program is necessary due to any new introduction of pollutants into the Publically Owned Treatment Works or any substantial change in the volume or character of pollutants being introduced.

The permit as modified or reissued under this paragraph shall also contain any other requirements of the Clean Water Act then applicable.

3. All outfalls must be clearly marked in the field.
4. Permittee will cease discharge by connection to a facility with an area-wide management plan per 10 CSR 20-6.010(3)(B) within 90 days of notice of its availability.

C. SPECIAL CONDITIONS (continued)

5. Water Quality Standards

- (a) To the extent required by law, discharges to waters of the state shall not cause a violation of water quality standards rule under 10 CSR 20-7.031, including both specific and general criteria.
- (b) General Criteria. The following general water quality criteria shall be applicable to all waters of the state at all times including mixing zones. No water contaminant, by itself or in combination with other substances, shall prevent the waters of the state from meeting the following conditions:
 - (1) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses;
 - (2) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses;
 - (3) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses;
 - (4) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life;
 - (5) There shall be no significant human health hazard from incidental contact with the water;
 - (6) There shall be no acute toxicity to livestock or wildlife watering;
 - (7) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community;
 - (8) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.

6. Changes in Discharges of Toxic Substances

The permittee shall notify the Director as soon as it knows or has reason to believe:

- (a) That any activity has occurred or will occur which would result in the discharge of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels:"
 - (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,5 dinitrophenol and for 2-methyl-4, 6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - (3) Five (5) times the maximum concentration value reported for the pollutant in the permit application;
 - (4) The level established by the Director in accordance with 40 CFR 122.44(f).
- (b) That they have begun or expect to begin to use or manufacture as an intermediate or final product or byproduct any toxic pollutant, which was not reported in the permit application.

7. Report as no-discharge when a discharge does not occur during the report period.

8. It is a violation of the Missouri Clean Water Law to fail to pay fees associated with this permit (644.055 RSMo).

9. Bypasses are not authorized at this facility and are subject to 40 CFR 122.41(m). If a bypass occurs, the permittee shall report in accordance to 40 CFR 122.41(m)(3)(i), and with Standard Condition Part I, Section B, subsection 2.b. Bypasses are to be reported to the appropriate Regional Office.

10. The facility must be sufficiently secured to restrict entry by children, livestock and unauthorized persons as well as to protect the facility from vandalism.

11. At least one gate must be provided to access the wastewater treatment facility and provide for maintenance and mowing. The gate shall remain locked except when opened by the permittee to perform operational monitoring, sampling, maintenance, mowing, or for inspections by the Department.

12. At least one (1) warning sign shall be placed on each side of the facility enclosure in such positions as to be clearly visible from all directions of approach. There shall also be one (1) sign placed for every five hundred feet (500') (150 m) of the perimeter fence. A sign shall also be placed on each gate. Minimum wording shall be SEWAGE TREATMENT FACILITY—KEEP OUT. Signs shall be made of durable materials with characters at least two inches (2") high and shall be securely fastened to the fence, equipment or other suitable locations.

13. An Operation and Maintenance (O & M) manual shall be maintained by the permittee and made available to the operator. The O & M manual shall include key operating procedures and a brief summary of the operation of the facility.

14. An all-weather access road shall be provided to the treatment facility.

C. SPECIAL CONDITIONS (continued)

15. The discharge from the wastewater treatment facility shall be conveyed to the receiving stream via a closed pipe or a paved or riprapped open channel. Sheet or meandering drainage is not acceptable. The outfall sewer shall be protected against the effects of floodwater, ice or other hazards as to reasonably insure its structural stability and freedom from stoppage. The outfall shall be maintained so that a sample of the effluent can be obtained at a point after the final treatment process and before the discharge mixes with the receiving waters.

Missouri Department of Natural Resources
Statement of Basis
#MO-0123943
Eagle View Estates

This Statement of Basis (Statement) gives pertinent information regarding minor/simple modification(s) to the above listed operating permit without the need for a public comment process.

A Statement is not an enforceable part of a Missouri State Operating Permit.

Part I – Facility Information

Facility Type: NON-POTW – SIC # 8641

Part II – Modification Rationale

This operating permit is hereby modified to revise Special Condition #1. The requirement to submit a report has been removed. No other changes were made at this time.

Part III – Administrative Requirements

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit.

Date of Statement of Basis: 10-24-2013

Submitted by

Curt Gateley, Chief
Domestic Wastewater Unit
Operating Permits Section
Water Protection Program

Missouri Department of Natural Resources
FACT SHEET
FOR RENEWAL OF
EAGLE VIEW ESTATES WWTF
MO-0123943

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollution Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of storm water from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)2.] a Factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (operating permit) listed below.

A Factsheet is not an enforceable part of an operating permit.

This Factsheet is for a Minor Operating Permit covering non-POTW domestic Wastewater Treatment Plants (WWTP).

Part I – Facility Information

Facility Type: NON-POTW SIC# - 8641

Facility Description:

Septic Tank/ Recirculating Sand Filter/ Chlorination/ Dechlorination/ Sludge disposal by contract hauler.

OUTFALL(S) TABLE:

OUTFALL	DESIGN FLOW (CFS)	TREATMENT LEVEL	EFFLUENT TYPE
#001	0.002	Secondary	Domestic (sanitary)

Part II – Operator Certification Requirements

As per [10 CSR 20-6.010(8) Terms and Conditions of a Permit], permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions and regulations. Operators or supervisors of operations at regulated wastewater treatment facilities shall be certified in accordance with [10 CSR 20-9.020(2)] and any other applicable state law or regulation. As per [10 CSR 20-9.020(2)(A)], requirements for operation by certified personnel shall apply to all wastewater treatment systems, if applicable, as listed below:

This facility is not required to have a certified operator.

Part III– Operational Monitoring

As per [10 CSR 20-9.010(4)], the facility is not required to conduct operational monitoring.

Part IV – Receiving Stream Information

10 CSR 20-7.031 Missouri Water Quality Standards, the Department defines the Clean Water Commission water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and/or 1st classified receiving stream's beneficial water uses to be maintained are located in the Receiving Stream Table located below in accordance with [10 CSR 20-7.031(3)].

APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:

As per Missouri's Effluent Regulations [10 CSR 20-7.015], the waters of the state are divided into seven (7) categories. Each category lists effluent limitations for specific parameters, which are presented in each outfall's Effluent Limitation Table and further discussed in the Derivation & Discussion of Limits section. This permit only applies to facilities discharging to the following categories of water body.

- ☐ Missouri or Mississippi River [10 CSR 20-7.015(2)];
☒ Lake or Reservoir [10 CSR 20-7.015(3)];
☐ Losing [10 CSR 20-7.015(4)];
☐ All Other Waters [10 CSR 20-7.015(8)];

RECEIVING STREAM(S) TABLE:

WATER-BODY NAME	CLASS	WBID	DESIGNATED USES*	12-DIGIT HUC	DISTANCE TO CLASSIFIED SEGMENT (MI)
Lake of the Ozarks	(L2)	--	General Criteria	102901090207	0.1
Lake of the Ozarks	(L2)	7205	LWW, AQL, WBC(A), SCR		

* - Irrigation (IRR), Livestock & Wildlife Watering (LWW), Protection of Warm Water Aquatic Life and Human Health-Fish Consumption (AQL), Cool Water Fishery(CLF), Cold Water Fishery (CDF), Whole Body Contact Recreation (WBC), Secondary Contact Recreation (SCR), Drinking Water Supply (DWS), Industrial (IND), Groundwater (GRW).

Part V – Rationale and Derivation of Effluent Limitations & Permit Conditions

ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

Not Applicable; permit renewal.

ANTI-BACKSLIDING:

A provision in the Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(I)] that requires a reissued permit to be as stringent as the previous permit with some exceptions.

All limits in this operating permit are at least as protective as those previously established; therefore, backsliding does not apply.

ANTIDEGRADATION:

In accordance with Missouri's Water Quality Standard [10 CSR 20-7.031(2)], the Department is to document by means of Antidegradation Review that the use of a water body's available assimilative capacity is justified. Degradation is justified by documenting the socio-economic importance of a discharging activity after determining the necessity of the discharge.

Antidegradation reviews are performed at the time of construction. No degradation proposed and no further review necessary. Facility did not apply for authorization to increase pollutant loading or to add additional pollutants to their discharge.

AREA-WIDE WASTE TREATMENT MANAGEMENT & CONTINUING AUTHORITY:

As per [10 CSR 20-6.010(3)(B)], ...An applicant may utilize a lower preference continuing authority by submitting, as part of the application, a statement waiving preferential status from each existing higher preference authority, providing the waiver does not conflict with any area-wide management plan approved under section 208 of the Federal Clean Water Act or any other regional sewage service and treatment plan approved for higher preference authority by the Department.

BIOSOLIDS & SEWAGE SLUDGE:

Biosolids are solid materials resulting from domestic wastewater treatment that meet federal and state criteria for beneficial uses (i.e. fertilizer). Sewage sludge is solids, semi-solids, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information regarding biosolids and sludge is located at the following web address: <http://dnr.mo.gov/env/wpp/pub/index.html>, items WQ422 through WQ449.

With prior approval from the Department, permittees are authorized to land apply biosolids, or utilize other methods of sludge disposal contained in Standard Conditions Part III.

CONSERVATIVE ASSUMPTIONS:

In order to ensure efficient processing of permit applications domestic wastewater treatment facilities under 50,000 receive an expedited permit renewal. If the permittee would prefer to have additional review conducted, such as reasonable potential analysis, or wish to submit time of travel calculations for the Department to consider ammonia degradation, the Department will accommodate such a request. The following conservative assumptions have been made regarding the facility:

- Ammonia is a constituent of domestic wastewater. Unless the facility is entitled to a large mixing zone/zone of initial dilution relative to the discharge volume, reasonable potential to violate water quality standards is assumed. If the facility is legally entitled to a mixing zone and zone of initial dilution, such dilution is documented in the effluent limit calculations.
- Reasonable Potential Analysis [statistical analysis] using facility data was not conducted. Default multipliers from EPA guidance utilized to calculate effluent limits.
- Where discharges are to an unclassified stream, no degradation of ammonia has been calculated.
- This facility was determined not to have other sources of wastewater which would introduce other pollutants. Only domestic wastewater is included in the influent to this facility.

SANITARY SEWER OVERFLOWS (SSO) AND INFLOW AND INFILTRATION (I&I):

Sanitary Sewer Overflows (SSOs) are defined as an untreated or partially treated sewage release are considered bypassing under state regulation [10 CSR 20-2.010(11)] and should not be confused with the federal definition of bypass. SSO's have a variety of causes including blockages, line breaks, and sewer defects that allow excess storm water and ground water to (1) enter and overload the collection system, and (2) overload the treatment facility. Additionally, SSO's can be also be caused by lapses in sewer system operation and maintenance, inadequate sewer design and construction, power failures, and vandalism. SSOs also include overflows out of manholes and onto city streets, sidewalks, and other terrestrial locations.

Additionally, Missouri RSMo §644.026.1 mandates that the Department require proper maintenance and operation of treatment facilities and sewer systems and proper disposal of residual waste from all such facilities.

This facility is not required to develop or implement a program for maintenance and repair of the collection system; however, it is a violation of Missouri State Environmental Laws and Regulations to allow untreated wastewater to discharge to waters of the state.

VARIANCE:

As per the Missouri Clean Water Law § 644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §§644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §644.006 to 644.141.

This operating permit is not drafted under premises of a petition for variance.

WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:

As per [10 CSR 20-2.010(78)], the amount of pollutant each discharger is allowed by the Department to release into a given stream after the Department has determined total amount of pollutant that may be discharged into that stream without endangering its water quality.

Wasteload allocations were calculated where applicable using water quality criteria or water quality model results and the dilution equation below:

$$C_e = \frac{(Q_e + Q_s)C - (C_s \times Q_s)}{(Q_e)} \quad (\text{EPA/505/2-90-001, Section 4.5.5})$$

Where C = downstream concentration
Cs = upstream concentration
Qs = upstream flow
Ce = effluent concentration
Qe = effluent flow

Chronic wasteload allocations were determined using applicable chronic water quality criteria (CCC: criteria continuous concentration) and stream volume of flow at the edge of the mixing zone (MZ). Acute wasteload allocations were determined using applicable water quality criteria (CMC: criteria maximum concentration) and stream volume of flow at the edge of the zone of initial dilution (ZID).

Water quality based maximum daily and average monthly effluent limitations were calculated using methods and procedures outlined in USEPA's "Technical Support Document For Water Quality-based Toxics Control" (EPA/505/2-90-001).

Number of Samples "n":

Additionally, in accordance with the TSD for water quality-based permitting, effluent quality is determined by the underlying distribution of daily values, which is determined by the Long Term Average (LTA) associated with a particular Wasteload Allocation (WLA) and by the Coefficient of Variation (CV) of the effluent concentrations. Increasing or decreasing the monitoring frequency does not affect this underlying distribution or treatment performance, which should be, at a minimum, be targeted to comply with the values dictated by the WLA. Therefore, it is recommended that the actual planned frequency of monitoring normally be used to determine the value of "n" for calculating the AML. However, in situations where monitoring frequency is once per month or less, a higher value for "n" must be assumed for AML derivation purposes. Thus, the statistical procedure being employed using an assumed number of samples is "n = 4" at a minimum. For Total Ammonia as Nitrogen, "n = 30" is used.

WATER QUALITY STANDARDS:

Per [10 CSR 20-7.031(3)], General Criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, [40 CFR 122.44(d)(1)] directs the Department to establish in each NPDES permit to include conditions to achieve water quality established under Section 303 of the Clean Water Act, including State narrative criteria for water quality.

WHOLE EFFLUENT TOXICITY (WET) TEST:

A WET test is a quantifiable method of determining if a discharge from a facility may be causing toxicity to aquatic life by itself, in combination with or through synergistic responses when mixed with receiving stream water.

At this time, the permittee is not required to conduct WET test for this facility.

40 CFR 122.41(M) - BYPASSES:

The federal Clean Water Act (CWA), Section 402 prohibits wastewater dischargers from "bypassing" untreated or partially treated sewage (wastewater) beyond the headworks. A bypass is defined as an intentional diversion of waste streams from any portion of a treatment facility, [40 CFR 122.41(m)(1)(i)]. Additionally, Missouri regulation 10 CSR 20-2.010(11) defines a bypass as the diversion of wastewater from any portion of wastewater treatment facility or sewer system to waters of the state. Only under exceptional and specified limitations do the federal regulations allow for a facility to bypass some or all of the flow from its treatment process. Bypasses are prohibited by the CWA unless a permittee can meet all of the criteria listed in 40 CFR 122.41(m)(4)(i)(A), (B), & (C). Any bypasses from this facility are subject to the reporting required in 40 CFR 122.41(l)(6) and per Missouri's Standard Conditions I, Section B, part 2.b. Additionally, Anticipated Bypasses include bypasses from peak flow basins or similar devices designed for peak wet weather flows.

This facility does not anticipate bypassing.

303(d) LIST & TOTAL MAXIMUM DAILY LOAD (TMDL):

Section 303(d) of the federal Clean Water Act requires that each state identify waters that are not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock and wildlife. The 303(d) list helps state and federal agencies keep track of waters that are impaired but not addressed by normal water pollution control programs.

A TMDL is a calculation of the maximum amount of a given pollutant that a body of water can absorb before its water quality is affected. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan will be developed that shall include the TMDL calculation

This permit does not apply within a watershed for which an approved Total Maximum Daily Load includes wasteload allocations for oxygen demand, nitrogen, phosphorus, or ammonia. These pollutants are discharged by domestic wastewater treatment facilities, and therefore it may be necessary to apply a lower wasteload allocation than appears in this permit to any new or existing discharge in order to protect water quality.

Part VI –2013 Water Quality Criteria for Ammonia

Upcoming changes to the Water Quality Standard for ammonia may require significant upgrades to wastewater treatment facilities.

On August 22, 2013, the U.S. Environmental Protection Agency (EPA) finalized new water quality criteria for ammonia, based on toxicity studies of mussels. Missouri's current ammonia criteria are based on toxicity testing of several species, but did not include data from mussels. Missouri is home to 65 of North America's mussel species, spread across the state. According to the Missouri Department of Conservation nearly two-thirds are considered to be "of conservation concern". Nine are listed as federally endangered, with one more currently proposed as endangered and another proposed as threatened.

The adult forms of mussels seen in rivers, lakes, and streams are sensitive to pollutants because they are sedentary filter feeders. They vacuum up many pollutants with the food they bring in and cannot escape to new habitats, so they can accumulate toxins in their bodies and die. But very young mussels, called glochidia, are exceptionally sensitive to ammonia in water. As a result of a citizen suit, the EPA was compelled to conduct toxicity testing and develop ammonia water quality criteria that would be protective if young mussels may be present in a waterbody. These new criteria will apply to any discharge with ammonia levels that may pose a reasonable potential to violate the standards. Nearly all discharging domestic wastewater treatment facilities (cities, subdivisions, mobile home parks, etc.), as well as certain industrial and stormwater dischargers with ammonia in their effluent, they will be affected by this change in the regulations.

When new water quality criteria are established by the EPA, states must adopt them into their regulations in order to keep their authorization to issue permits under the National Pollutant Discharge Elimination System (NPDES). States are required to review their water quality standards every three years, and if new criteria have been developed they must be adopted. States may be more protective than the Federal requirements, but not less protective. Missouri does not have the resources to conduct the studies necessary for developing new water quality standards, and therefore our standards mirror those developed by the EPA. However we will utilize any available flexibility based on actual species of mussels native to Missouri and their sensitivity to ammonia.

Many treatment facilities in Missouri are currently scheduled to be upgraded so as to comply with the current water quality standards. But these new standards may require a different treatment technology than the one being considered by the permittee. It is important that permittees discuss any new and upcoming requirements with their consulting engineers to ensure that their treatment systems are capable of complying with the new requirements. The Department encourages permittees to construct treatment technologies that can attain effluent quality that supports the EPA ammonia criteria.

Ammonia toxicity varies by temperature and by pH of the water. Assuming a stable pH value, but taking into account winter and summer temperatures, Missouri includes two seasons of ammonia effluent limitations. The effluent limitations in this permit are

All year – 12.1 mg/L daily maximum, 4.6 mg/L monthly average.

Under the new EPA criteria, where mussels are present or expected to be present, your estimated effluent limitations will be:

Summer – 3.4 mg/L daily maximum, 1.3 mg/L monthly average.

Winter – 8.1 mg/L daily maximum, 3.1 mg/L monthly average.

Actual effluent limits will depend in part on the actual performance of the facility.

Operating permits for facilities in Missouri must be written based on current statutes and regulations. It is expected that the new WQS will be adopted in the next review of our standards. Therefore permits will be written with the existing effluent limitations until the new standards are adopted. To aid permittees in decision making, an advisory will be added to permit Fact Sheets notifying permittees of the expected effluent limitations for ammonia. When setting schedules of compliance for ammonia effluent limitations, consideration will be given to facilities that have recently constructed upgraded facilities to meet the current ammonia limitations.

For more information on this topic feel free to contact the Missouri Department of Natural Resources, Water Protection Program, Water Pollution Control Branch, Operating Permits Section at (573) 751-1300.

Part VII – Effluent Limits Determination (ALL OUTFALLS)

EFFLUENT LIMITATIONS TABLE FOR LAKES OR RESERVOIRS:

PARAMETER	Unit	Basis for Limits	Daily Maximum	Weekly Average	Monthly Average
Flow	MGD	1	*		*
BOD ₅	mg/L	1, 2		30	20
TSS	mg/L	1, 2		30	20
pH	SU	1, 2	6.5-9.0		6.5-9.0
Ammonia as N	mg/L	2, 3, 5	12.1		4.6
Escherichia coli	***	1, 2, 3	630		126
Chlorine, Total Residual	µg/L	1, 3	17		8
Dissolved Oxygen	mg/L	3, 9	**		**

* - Monitoring requirement only.

** - For DO the Daily Maximum is a Daily Minimum and the Monthly Average is a Monthly Average Minimum.

*** - # of colonies/100mL; the Monthly Average for *E. coli* is a geometric mean.

Basis for Limitations Codes:

- | | |
|--|------------------------------------|
| 1. State or Federal Regulation/Law | 7. Antidegradation Policy |
| 2. Water Quality Standard | 8. Water Quality Model |
| 3. Water Quality Based Effluent Limits | 9. Best Professional Judgment |
| 4. Lagoon Policy | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy | 11. WET Test Policy |
| 6. Antidegradation Review | |

OUTFALL #001 – DERIVATION AND DISCUSSION OF LIMITS:

- **Flow.** In accordance with [40 CFR Part 122.44(i)(1)(ii)], the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification.
- **Biochemical Oxygen Demand (BOD₅).** Effluents limits for each type of receiving water body were set according to 10 CSR 20-7.015(2)-(8).
- **Total Suspended Solids (TSS).** Effluents limits for each type of receiving water body were set according to 10 CSR 20-7.015(2)-(8).
- **pH.** Effluent limitation range is 6.5 – 9.0 Standard pH Units (SU), as per the applicable section of 10 CSR 20-7.015. pH is not to be averaged.
- **Total Ammonia Nitrogen - Lakes.** Early Life Stages Present Total Ammonia Nitrogen criteria apply [10 CSR 20-7.031(4)(B)7.C. & Table B3] default pH 7.8 SU No Zone of Initial Dilution allowed, therefore effluent limits driven by acute water quality standard. Because no dilution is allowed, WLA = the applicable standard. Acute standard does not vary by season.

$$C_e = 12.1 \text{ mg/L}$$

$$LTA_a = 12.1 \text{ mg/L} (.0321) = 3.89 \text{ mg/L}$$

$$[CV = 0.6, 99^{\text{th}} \text{ Percentile}]$$

Use most protective number of LTA_c or LTA_a.

$$MDL = 3.89 \text{ mg/L} (3.11) = 12.1 \text{ mg/L}$$

$$[CV = 0.6, 99^{\text{th}} \text{ Percentile}]$$

$$AML = 3.89 \text{ mg/L} (1.19) = 4.6 \text{ mg/L}$$

$$[CV = 0.6, 95^{\text{th}} \text{ Percentile, } n=30]$$

- **Dissolved Oxygen**. Monitoring included to determine if the facility has the reasonable potential to cause a violation of water quality standards in the receiving stream. Dechlorination chemicals have the potential to reduce dissolved oxygen concentrations in the discharge, resulting in an anoxic discharge, unless carefully controlled. Data will be reviewed upon renewal to determine if an effluent limitation is necessary to protect water quality.
- **Escherichia coli (E. coli)**. Discharges to rivers/streams or lakes/reservoirs shall not exceed a monthly average of 126 per 100 ml as a geometric mean and Daily Maximum of 630 during the recreational season (April 1 – October 31), to protect Whole Body Contact Recreation designated use of the receiving stream, as per 10 CSR 20-7.031(4)(C).
- **Total Residual Chlorine (TRC)**. Warm-water Protection of Aquatic Life CCC = 10 µg/L, CMC = 19 µg/L [10 CSR 20-7.031, Table A]. Background TRC = 0.0 µg/L. Due to minimum detection limits, TRC effluent limits of 17 µg/L daily maximum, 8 µg/L monthly average are recommended if chlorine is used as a disinfectant.

Part VIII – Finding of Affordability

Pursuant to Section 644.145, RSMo., the Department is required to determine whether a permit or decision is affordable and makes a finding of affordability for certain permitting and enforcement decisions. This requirement applies to discharges from combined or separate sanitary sewer systems or publically-owned treatment works.

The Department is not required to determine findings of affordability because the facility is not a combined or separate sanitary sewer system for a publically-owned treatment works.

Part IX – Administrative Requirements

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

PERMIT SYNCHRONIZATION:

The Department of Natural Resources is currently undergoing a synchronization process for operating permits. Permits are normally issued on a five-year term, but to achieve synchronization many permits will need to be issued for less than the full five years allowed by regulation. The intent is that all permits within a watershed will move through the Watershed Based Management (WBM) cycle together and all expire in the same fiscal year. This will allow further streamlining by placing multiple permits within a smaller geographic area on public notice simultaneously, thereby reducing repeated administrative efforts. This will also allow the Department to explore a watershed based permitting effort at some point in the future. Renewal applications must continue to be submitted within 180 days of expiration, however, in instances where effluent data from the previous renewal is less than 4 years old, that data may be re-submitted to meet the requirements of the renewal application. If the permit provides a schedule of compliance for meeting new water quality based effluent limits beyond the expiration date of the permit, the time remaining in the schedule of compliance will be allotted in the renewed permit.

PUBLIC NOTICE:

The Department shall give public notice that a draft permit has been prepared and its issuance is pending. Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in and water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing.

The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.


For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

The Public Notice period for this operating permit was from 8/30/2013-9/30/2013. No comments were received.

DATE OF FACT SHEET: JULY 1, 2013

COMPLETED BY:

**ANGELA FALLS, ENVIRONMENTAL SPECIALIST
DOMESTIC WASTEWATER UNIT
WATER PROTECTION PROGRAM
MISSOURI DEPARTMENT OF NATURAL RESOURCES
(573) 751-1419
angela.falls@dnr.mo.gov**



MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM, WATER POLLUTION BRANCH
(SEE MAP FOR APPROPRIATE REGIONAL OFFICE)
**FORM B — APPLICATION FOR CONSTRUCTION OR
OPERATING PERMIT FOR FACILITIES WHICH
RECEIVE PRIMARILY DOMESTIC WASTE**
UNDER MISSOURI CLEAN WATER LAW

AP14331 C10732

FOR AGENCY USE ONLY	
CHECK NUMBER	
DATE RECEIVED	FEE SUBMITTED
1/10/13	@ 88

NOTE ► PLEASE READ THE ACCOMPANYING INSTRUCTIONS BEFORE COMPLETING THIS FORM

- 1.00** This application is for: ☐ Federal/State ☒ an operating permit renewal: permit # M00123943
☒ a construction permit ☐ Funded Project Expiration date: June 29th, 2013
☐ an operating permit for a new or unpermitted facility ☐ an operating permit modification
(See instructions for appropriate fee to be submitted with application) Reason: _____

2.00 FACILITY

NAME	Eagle View Estates WWTF	PHONE	316-652-0151
ADDRESS (PHYSICAL)	Lake Road 5-45	CITY	Sunrise Beach
		STATE	MO
		ZIP	65079
2.10 LEGAL DESCRIPTION:	$\frac{1}{4}$, NW $\frac{1}{4}$, NW $\frac{1}{2}$, Sec. 9, T 39N R 17W Camden County		

- 2.20** Is this a new facility constructed under a Missouri Construction Permit? ☐ YES ☒ NO
If yes, please provide Missouri Construction Permit Number: _____

2.30 Name of receiving stream(s) Lake of the Ozarks (L2) 303 (d)

3.00 OWNER

NAME	Eagle View Estates HOA, Inc.	EMAIL ADDRESS	n/a	PHONE	316-652-0151
ADDRESS	825 N. Waco	CITY	Wichita	STATE	KS
				ZIP	67203
3.10	Request review of draft permit prior to Public Notice? <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO				

- 4.00 CONTINUING AUTHORITY:** permanent organization which will serve as the continuing authority for the operation, maintenance and modernization of the facility.

NAME	Eagle View Estates HOA, Inc.	PHONE	316-652-0151
ADDRESS	825 N. Waco	CITY	Wichita
		STATE	KS
		ZIP	67203

5.00 OPERATOR


NAME	Kenny Colvin	CERTIFICATE NUMBER	8381	PHONE	573-346-3810
------	--------------	--------------------	------	-------	--------------

6.00 FACILITY CONTACT

NAME	David Saidian	TITLE	President	PHONE	316-652-0151
------	---------------	-------	-----------	-------	--------------

7.00 ADDITIONAL FACILITY INFORMATION

- 7.10** Description of facilities (attach additional sheet if required). Attach a 1" = 2000' scale USGS topographic map showing location of all outfalls.
- 7.15** Facility SIC code: 4952; Discharge SIC code: 4952
- 7.20** Number of separate discharge points 1
- 7.30** Number of persons presently connected or population equivalent _____ Design P.E. 30
Number of units presently connected: Homes _____ Trailers _____
Apartments _____ Other _____
Design flow: 2,220 Actual flow: _____
- 7.40** Does any bypassing occur anywhere in the collection system or at the treatment facility?
☐ Yes ☒ No (If yes, attach explanation)
- 7.50** Is industrial waste discharged to the facility identified in item 2? ☐ Yes ☒ No (If yes, see instructions)
- 7.60** Will the discharge be continuous through the year? ☒ Yes ☐ No
a. Discharge will occur during the following months: January - December
b. How many days of the week will the discharge occur? Seven
- 7.65** Is wastewater land applied? ☐ Yes ☒ No (If yes, attach Form I)
- 7.70** Will chlorine be added to the effluent? ☒ Yes ☐ No
a. If chlorine is added, what is the resulting residual? <0.13 mg/l
- 7.80** Does this facility discharge to a losing stream or sinkhole? ☐ Yes ☒ No
- 7.85** Attach a flow chart showing all influents, treatment facilities and outfalls.
- 7.90** Has a waste load allocation study been completed for this facility? ☐ Yes ☒ No
- 7.95** List all permit violations, including effluent limit exceedances in the last 5 years. Attach a separate sheet if necessary.
If none, write none. None known at this time

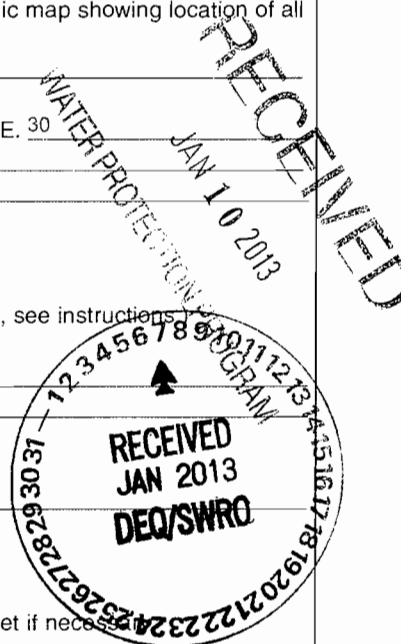

8.00 SLUDGE HANDLING, USE AND DISPOSAL

8.10 Is the sludge a hazardous waste as defined by 10 CSR 25? ☐ Yes ☒ No

8.20 Sludge Production, including sludge received from others: .21 Design Dry Tons/Year _____ Actual Dry Tons/Year _____

8.30 Capacity of sludge holding structures:

7.31 Sludge storage provided: _____ cubic feet; _____ days of storage
_____ average percent solids of sludge. ☒ No sludge storage is provided.

7.32 Type of storage: ☐ Holding tank ☐ Building
☐ Basin ☐ Other (describe) _____
☐ Concrete Pad _____

8.40 Sludge Treatment:

☐ Anaerobic Digester ☐ Lagoon ☐ Composting
☐ Storage Tank ☐ Aerobic Digester ☐ Other (attach description)
☐ Lime Stabilization ☐ Air or Heat Drying

8.50 Sludge Use or Disposal:

☐ Land Application ☐ Surface Disposal (Sludge Disposal Lagoon, Sludge held for more than 2 years)
☒ Contract Hauler ☐ Incineration
☐ Hauled to Another Treatment Facility ☐ Sludge Retained in Wastewater treatment lagoon
☐ Solid Waste Landfill ☐ Other _____ Attach explanation sheet.

8.60 PERSON RESPONSIBLE FOR HAULING SLUDGE TO DISPOSAL FACILITY

☐ By Applicant ☒ By Others (complete below)

NAME Operator/Owners Discretion

ADDRESS	CITY	STATE	ZIP
CONTACT PERSON	PHONE	PERMIT NO. MO-	

8.70 SLUDGE USE OR DISPOSAL FACILITY

☐ By Applicant ☒ By Others (complete below)

NAME Haulers Discretion

ADDRESS	CITY	STATE	ZIP
CONTACT PERSON	PHONE	PERMIT NO. MO-	

8.80 Does the sludge or biosolids disposal comply with federal sludge regulations under 40 CFR 503?

☒ Yes ☐ No (attach explanation)

9.00 DOWNSTREAM LANDOWNER(S). ATTACH ADDITIONAL SHEETS AS NECESSARY. SEE INSTRUCTIONS.

NAME _____

ADDRESS	CITY	STATE	ZIP
---------	------	-------	-----

10.00 DRINKING WATER SUPPLY INFORMATION**10.10 WHAT IS THE SOURCE OF YOUR DRINKING WATER SUPPLY:**

A. Public supply (municipal or water district water) _____
If public, please give name of the public supply _____

B. Private well _____

C. Surface water (lake, pond, or stream) _____

10.20 Does your drinking water source serve at least 25 people at least 60 days per year (not necessarily consecutive days)?

☐ Yes ☐ No

10.30 Does your supply serve housing which is occupied year round by the same people? This does not include housing which is occupied seasonally.

☐ Yes ☐ No


11.00 I certify that I am familiar with the information contained in the application, that to the best of my knowledge and belief such information is true, complete and accurate, and if granted this permit, I agree to abide by the Missouri Clean Water Law and all rules, regulations, orders and decisions, subject to any legitimate appeal available to applicant under the Missouri Clean Water Law.

NAME AND OFFICIAL TITLE (TYPE OR PRINT) David Saidian

PHONE NO. (AREA CODE & NO.) 316-652-0151

SIGNATURE 

DATE SIGNED 1-3-13

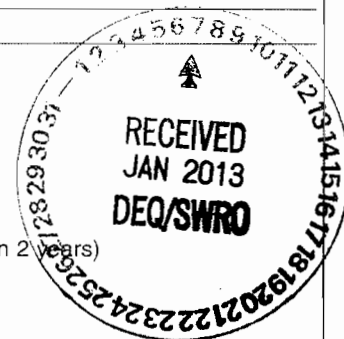

INSTRUCTIONS FOR COMPLETING FORM B
APPLICATION FOR CONSTRUCTION OR OPERATING PERMITS FOR
FACILITIES WHICH RECEIVE BASICALLY DOMESTIC WASTE



1.00 Check which permit type is applicable. DO NOT CHECK MORE THAN ONE ITEM.

Operating permit refers to permits issued by the Department of Natural Resources, Water Protection Program, Water Pollution Branch.

CONSTRUCTION PERMIT FEES (Please include fee with application.)

- a. \$750 for a sewage treatment facility with a design flow of less than 500,000 gallons per day.
- b. \$2,200 for a sewage treatment facility with a design flow of 500,000 gallons per day or more.

DOMESTIC OPERATING PERMIT FEES* (Annual operating permit fees are due each year on the anniversary date of the permit.)

Annual fee / Design flow	Annual fee / Design flow	Annual fee / Design flow
\$100 < 5,000	\$375 10,000 - 10,999 gpd	\$650 16,000 - 16,999 gpd
\$150 5,000 - 5,999 gpd	\$400 11,000 - 11,999 gpd	\$800 17,000 - 19,999 gpd
\$175 6,000 - 6,999 gpd	\$450 12,000 - 12,999 gpd	\$1,000 20,000 - 22,999 gpd
\$200 7,000 - 7,999 gpd	\$500 13,000 - 13,999 gpd	\$2,000 23,000 - 24,999 gpd
\$225 8,000 - 8,999 gpd	\$550 14,000 - 14,999 gpd	\$2,500 25,000 - 29,999 gpd
\$250 9,000 - 9,999 gpd	\$600 15,000 - 15,999 gpd	\$3,000 30,000 - 1 mgd
		\$3,500 > 1 mgd

Permit modifications, including transfers, are subject to the following fees:


- A. Municipals - \$200 each
- B. All others - 25% of annual fee

Note: Business name and address changes where owner, operator and continuing authority remain the same are not considered transfers.

- 2.00 Name of Facility - by what name is this facility locally known? Example: Southwest Sewage Treatment Plant, Country Club Mobile Home Park, etc. Give the street address or location of the facility. If the facility lacks a street name or route number, give the names of the closest intersection, highway, country road, etc.
- 2.10 Point of discharge should be given in terms of the legal description of the waste treatment plant. Sufficient information should be submitted that it may be located by Department staff.
- 2.20 Construction permit refers to permits issued by the Department of Natural Resources, Water Protection Program, Water Pollution Branch.
- 2.30 Receiving stream(s) - the name of the stream(s) to which the discharge is directed and any subsequent tributary until a continuous flowing stream is reached.
- 3.00 Owner - legal name and address of the owner.
- 3.10 If checked "YES", the statutory timeframe for issuing a final action on the permit application shall begin on the date the applicant's preliminary review comments are received by the department.
- 4.00 Continuing Authority - permanent organization which will serve as the continuing authority for the operation, maintenance and modernization of the facility.
- 5.00 Operator - name, certificate number and telephone number of the operator of the facility.
- 6.00 Give the name, title and work telephone number of a person who is thoroughly familiar with the operation of the facility and with the facts reported in this application and who can be contacted by the department if necessary.
- 7.10 Provide a brief description of the wastewater treatment facilities. Attach a 1" = 2000' scale USGS topographic map showing location of all outfalls. This type of map can be obtained from the Department of Natural Resources' Geological Survey & Resource Assessment Division in Rolla, Missouri. (573) 368-2125.
- 7.20 Include discharge points such as cooling water, sanitary waste, process waste, etc.
- 7.30 Indicate the total number of people presently served by the wastewater treatment facility. If this is a commercial establishment, indicate the number of employees and the number of guests or patrons served by the wastewater treatment facility.
- 7.40 Include overflows of combined sewers and lift stations or bypassing of the wastewater treatment facility. Provide a detailed description of the circumstances that sewage bypassing occurs and the frequency of occurrence.
- 7.50 Attach a list of industrial discharges into the system. For each industry, list: name of facility, address, flow and type of industry/SIC code.
- 7.60 - 7.65 Self-Explanatory
- 7.70 If chlorine is added, show the resulting residual in the discharge in mg/L.
- 7.80 - 6.95 Self-Explanatory
- 8.10 Copies of 10 CSR 25 are available from the Department of Natural Resources' Regional Offices.
- 8.20 - 8.70 Self-Explanatory
- 8.80 Please refer to University of Missouri Extension publications of Biosolids number WQ420 -426.
- 9.00 Provide the name and address of the first downstream landowner, different from that of the permitted facility, through whose property the discharge will flow.
- 10.00 - 10.30 Self-Explanatory
- 11.00 Signature - All applications must be signed as follows and the signatures must be **original**:
 - a. For a corporation, by an officer having responsibility for the overall operation of the regulated facility or activity or for environmental matters;
 - b. For a partnership or sole proprietorship, by a general partner or the proprietor.
 - c. For a municipal, state, federal or other public facility, by either a principal executive officer or by an individual having overall responsibility for environmental matters at the facility.

This completed form, along with the applicable permit fees, should be returned to the appropriate Regional Office (see map). If there are any questions concerning this form, please contact the appropriate Regional Office or the Department of Natural Resources, Water Protection Program, Water Pollution Branch, NPDES Permits & Engineering Section at (573) 751-6825.

A circular library stamp from the University of Wisconsin System. The outer ring contains the text "UNIVERSITY OF WISCONSIN SYSTEM" at the top and "LIBRARY" at the bottom. The center of the stamp contains the text "RECEIVED" and "JAN 2013". A horizontal line is drawn across the center, with "DEQ/SWRO" written below it. The stamp is slightly tilted and has a textured, aged appearance.

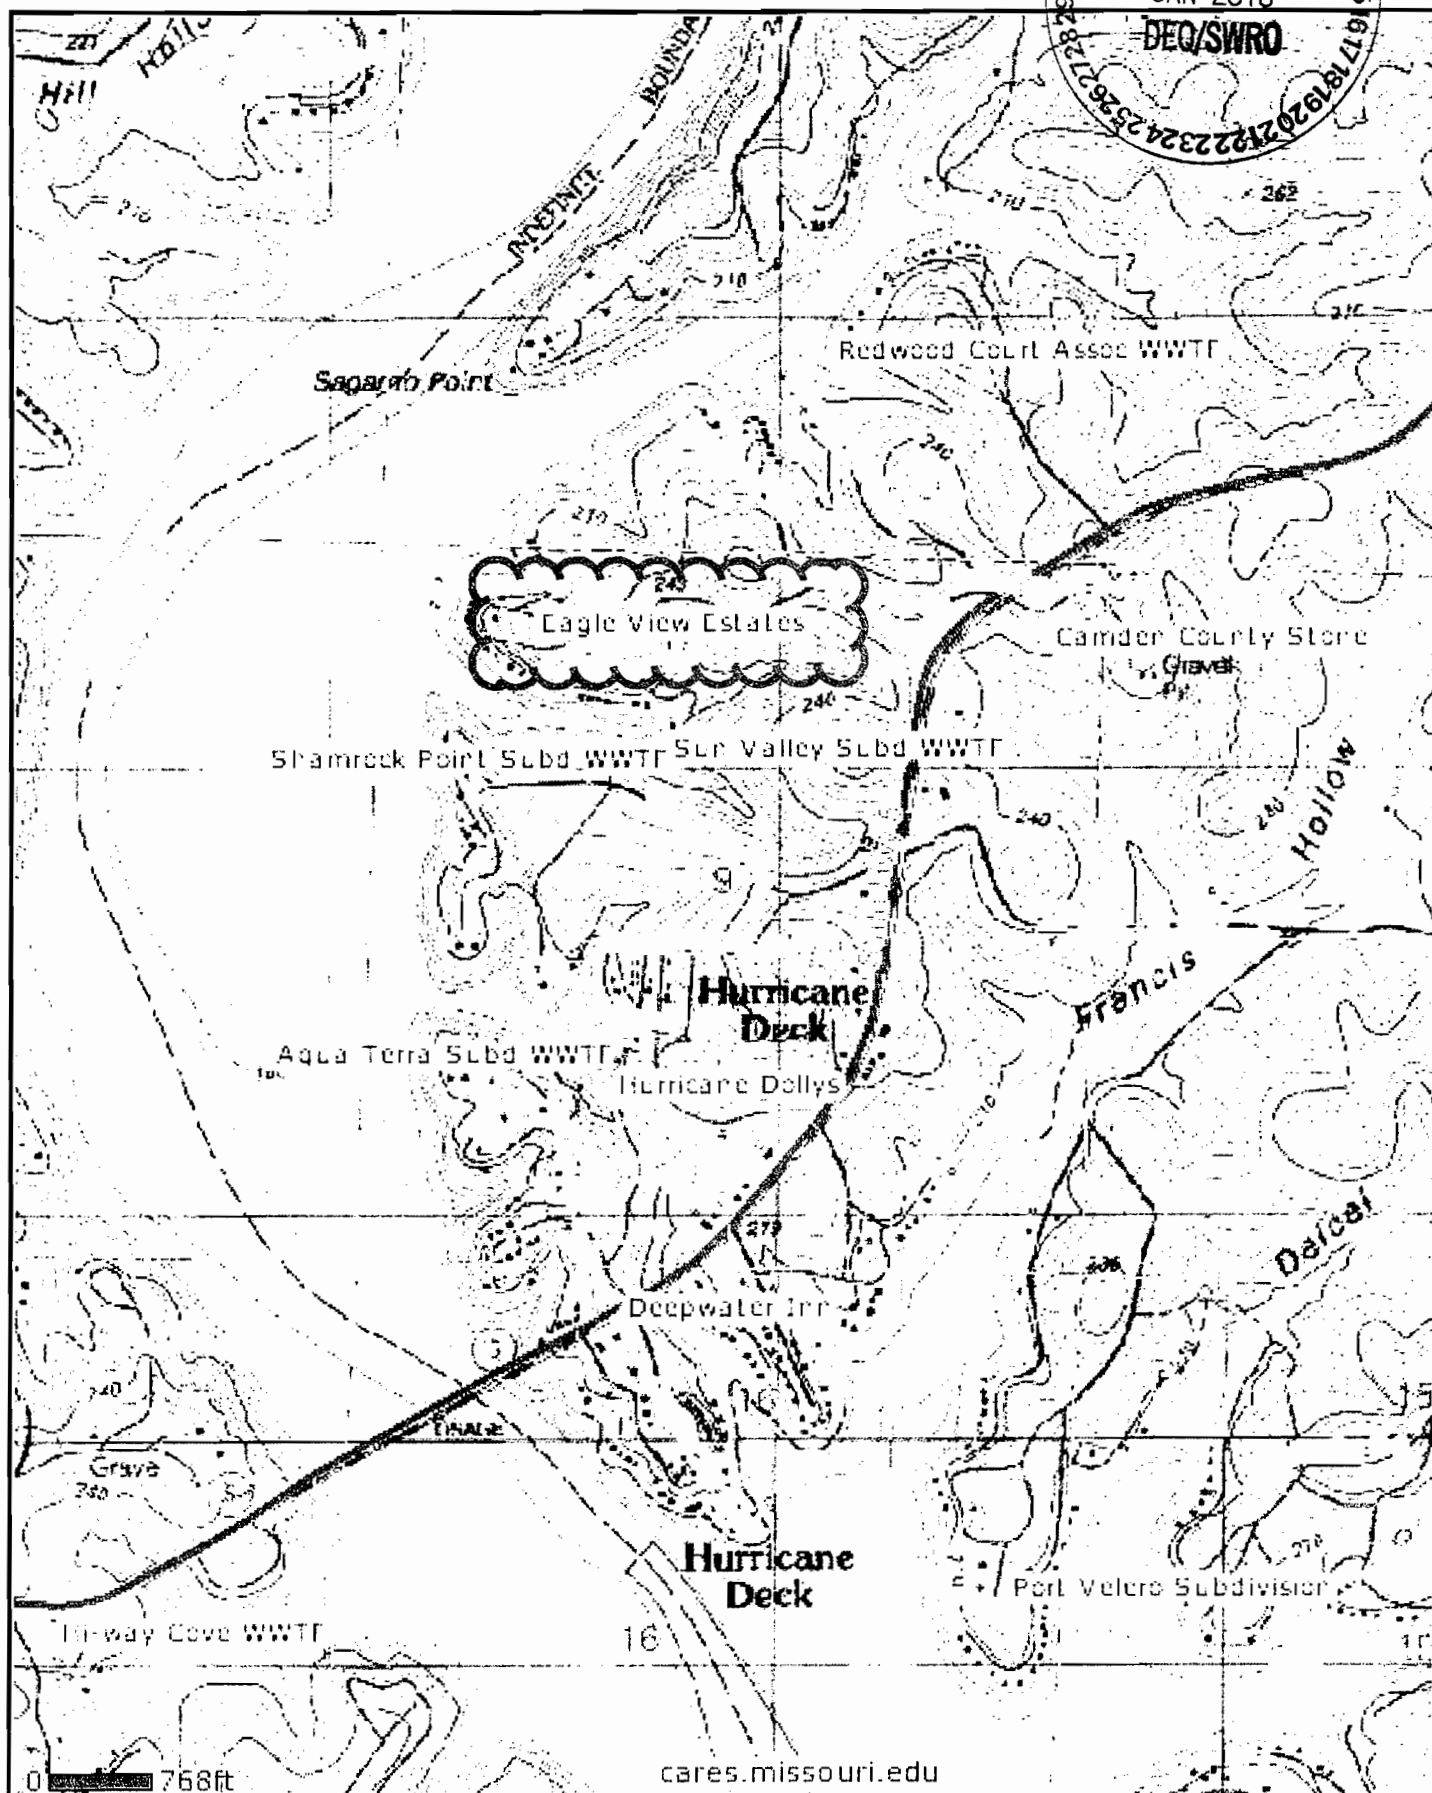

Legend

Locator Map

NPDES Pollutant Outfalls, 2007



CAFO



Publicly Owned Facilities

Other Facilities

MoDOT Roads and Highways, 2007



Interstate



U.S. Highway



State Numbered Highway



State Lettered Highway



Principal Road

Road or Street

Private Road or Drive

Public Land Survey Lines

Section Boundary


Land Grant Boundary

Township Boundary

State Boundary

Artificial Boundary

1:24,000 USGS Topographic Maps



Map prepared by:
<http://cares.missouri.edu>,
12/22/2008

