

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION



CONSTRUCTION PERMIT

The Missouri Department of Natural Resources hereby issues a permit to:

Ken Schroader, Church Representative
Racine Apostolic Church
12935 Diver Drive
Racine, MO 64850

for the construction of (described facilities):

See attached.

Permit Conditions:

See attached.

Construction of such proposed facilities shall be in accordance with the provisions of the Missouri Clean Water Law, Chapter 644, RSMo, and regulation promulgated thereunder, or this permit may be revoked by the Department of Natural Resources (department).

As the department does not examine structural features of design or the efficiency of mechanical equipment, the issuance of this permit does not include approval of these features.

A representative of the department may inspect the work covered by this permit during construction. Issuance of a permit to operate by the department will be contingent on the work substantially adhering to the approved plans and specifications.

This permit applies only to the construction of water pollution control components; it does not apply to other environmentally regulated areas.

June 30, 2025

Effective Date

June 29, 2027

Expiration Date

John Hoke, Director, Water Protection Program

CONSTRUCTION PERMIT

I. CONSTRUCTION DESCRIPTION

The Racine Apostolic Church is located at 12935 Diver Drive, Racine, in Newton County, Missouri. The facility has 7 existing conventional subsurface systems and is proposing to add 1 more tank to bring the system up to 8 systems, represented by 8 permitted features serving the church, old church, old cafeteria, new cafeteria, home, and RV spots. The design average flow for the entire Racine Apostolic Church system is 5,200 gallons per day (gpd) and serves a hydraulic population equivalent of approximately 52 people

Construction will cover approximately 136 lf of 6-inch pipe with 1 manhole from the septic tank to the dispersal field. Approximately 150 feet of 6-inch pipe was installed in 2024 to connect the building to the 1,000 gallon grease interceptor and 2,000 gallon septic tank. Additionally, construction will cover the installation of 1 conventional subsurface dispersal system with a loading rate of 0.4 gpd/sq ft to serve the new dining hall and cafeteria. The overall design average flow for the dining hall/cafeteria expansion is 1,500 gpd.

This project will also include general site work appropriate to the scope and purpose of the project and all necessary appurtenances to make a complete and usable wastewater treatment facility.

II. COST ANALYSIS FOR COMPLIANCE

Pursuant to Section 644.145, RSMo, when issuing permits under this chapter that incorporate a new requirement for discharges from publicly owned combined or separate sanitary or storm sewer systems or publicly owned treatment works, or when enforcing provisions of this chapter or the Federal Water Pollution Control Act, 33 U.S.C. 1251 et seq., pertaining to any portion of a publicly owned combined or separate sanitary or storm sewer system or [publicly owned] treatment works, the Department of Natural Resources shall make a “finding of affordability” on the costs to be incurred and the impact of any rate changes on ratepayers upon which to base such permits and decisions, to the extent allowable under this chapter and the Federal Water Pollution Control Act. This process is completed through a cost analysis for compliance. Permits that do not include new requirements may be deemed affordable.

The department is not required to complete a cost analysis for compliance because the facility is not a combined or separate sanitary sewer system for a publicly-owned treatment works.

III. CONSTRUCTION PERMIT CONDITIONS

The permittee is authorized to construct subject to the following conditions:

1. This construction permit does not authorize discharge.

2. All construction shall be consistent with plans and specifications signed and sealed by Mark Stanley, P.E. with Zanevan Engineering and as described in this permit.
3. The department must be contacted in writing prior to making any changes to the plans and specifications that would directly or indirectly have an impact on the capacity, flow, system layout, or reliability of the proposed wastewater treatment facilities or any design parameter that is addressed by 10 CSR 20-8, in accordance with 10 CSR 20-8.110(11).
4. State and federal law does not permit bypassing of raw wastewater, therefore steps must be taken to ensure that raw wastewater does not discharge during construction. If a sanitary sewer overflow or bypass occurs, report the appropriate information to the department's Southwest Regional Office per 10 CSR 20-7.015(9)(G).
5. The completed project shall be field tested to verify actual volume of each dose. The controls shall be set to ensure a dosing rate not to exceed the allowable rate of 0.40 gallons per square foot per day.
6. In addition to the requirements for a construction permit, 10 CSR 20-6.200 requires land disturbance activities of one acre or more to obtain a Missouri state operating permit to discharge stormwater. The permit requires best management practices sufficient to control runoff and sedimentation to protect waters of the state. Land disturbance permits will only be obtained by means of the department's ePermitting system available online at <https://dnr.mo.gov/data-e-services/missouri-gateway-environmental-management-mogem>. See <https://dnr.mo.gov/data-e-services/water/electronic-permitting-epermitting> for more information.
7. All construction must adhere to applicable 10 CSR 20-8 (Chapter 8) requirements listed below.
 - Flood protection shall apply to new construction and to existing facilities undergoing major modification. The wastewater facility structures, electrical equipment, and mechanical equipment shall be protected from physical damage by not less than the 100- year flood elevation. 10 CSR 20-8.140(2)(B)
 - Unless another distance is determined by the Missouri Geological Survey or by the department's Public Drinking Water Branch, the minimum distance between wastewater treatment facilities and all potable water sources shall be at least 300 feet. 10 CSR 20-8.140(2)(C)1.
 - No treatment unit with a capacity of 22,500 gpd or less shall be located closer than the minimum distance of 50 feet to a neighboring residence for all other discharging facilities. See 10 CSR 20-2.010(68) for the definition of a residence. 10 CSR 20-8.140(2)(C)2
 - Facilities shall be readily accessible by authorized personnel from a public right-of-way at all times. 10 CSR 20-8.140(2)(D)
 - All outfalls shall be posted with a permanent sign indicating the outfall number (i.e., Outfall #001). 10 CSR 20-8.140(6)(C)

- All wastewater treatment facilities shall be provided with an alternate source of electric power or pumping capability to allow continuity of operation during power failures. 10 CSR 20-8.140(7)(A)1.
- Electrical systems and components in raw wastewater or in enclosed or partially enclosed spaces where hazardous concentrations of flammable gases or vapors that are normally present, shall comply with the NFPA 70 *National Electric Code (NEC)* (2017 Edition), as approved and published August 24, 2016, requirements for Class I, Division 1, Group D locations. 10 CSR 20-8.140(7)(B)
- An audiovisual alarm or a more advanced alert system, with a self-contained power supply, capable of monitoring the condition of equipment whose failure could result in a violation of the operating permit, shall be provided for all wastewater treatment facilities. 10 CSR 20-8.140(7)(C)
- No piping or other connections shall exist in any part of the wastewater treatment facility that might cause the contamination of a potable water supply. 10 CSR 20-8.140(7)(D)1.
- A means of flow measurement shall be provided at all wastewater treatment facilities. 10 CSR 20-8.140(7)(E)
- Isolate all wastewater treatment components installed in a building where other equipment or offices are located from the rest of the building by an air-tight partition, provide separate outside entrances, and provide separate and independent fresh air supply. 10 CSR 20-8.140(7)(G)
- Adequate provisions shall be made to effectively protect facility personnel and visitors from hazards. The following shall be provided to fulfill the particular needs of each wastewater treatment facility:
 - Fencing. Enclose the facility site with a fence designed to discourage the entrance of unauthorized persons and animals; 10 CSR 20-8.140 (8) (A)
 - Gratings over appropriate areas of treatment units where access for maintenance is necessary; 10 CSR 20-8.140(8)(B)
 - First aid equipment; 10 CSR 20-8.140(8)(C)
 - Posted “No Smoking” signs in hazardous areas; 10 CSR 20-8.140(8)(D)
 - Appropriate personal protective equipment (PPE); 10 CSR 20-8.140(8)(E)
 - Portable blower and hose sufficient to ventilate accessed confined spaces; 10 CSR 20-8.140(8)(F)
 - 10 CSR 20-8.140(8)(G) Portable lighting equipment complying with NEC requirements. See subsection (7)(B) of this rule;
 - 10 CSR 20-8.140(8)(H) Gas detectors listed and labeled for use in NEC Class I, Division 1, Group D locations. See subsection (7)(B) of this rule;
 - Appropriately-placed warning signs for slippery areas, non-potable water fixtures (see subparagraph (7)(D)3.B. of this rule), low head clearance areas, open service manholes, hazardous chemical storage areas, flammable fuel storage areas, high noise areas, etc.; 10 CSR 20-8.140(8)(I)
 - Explosion-proof electrical equipment, non-sparking tools, gas detectors, and similar devices, in work areas where hazardous conditions may exist, such as digester vaults and other locations where potentially explosive atmospheres of flammable gas or vapor with air may accumulate. 10 CSR 20-8.140(8)(K)

- Provisions for local lockout/tagout on stop motor controls and other devices; 10 CSR 20-8.140(8)(L)
 - Provisions for an arc flash hazard analysis and determination of the flash protection boundary distance and type of PPE to reduce exposure to major electrical hazards shall be in accordance with NFPA 70E *Standard for Electrical Safety in the Workplace* (2018 Edition), as approved and published August 21, 2017. 10 CSR 20-8.140(8)(M)
- The materials utilized for storage, piping, valves, pumping, metering, and splash guards, etc., for chemical handling, shall be specially selected considering the physical and chemical characteristics of each hazardous or corrosive chemical. 10 CSR 20-8.140(9)(A)1.
- All wastewater treatment facilities must have a screening device, comminutor, or septic tank for the purpose of removing debris and nuisance materials from the influent wastewater. 10 CSR 20-8.150(2)
- Grease interceptors shall be provided on kitchen drain lines from institutions, hospitals, hotels, restaurants, schools, bars, cafeterias, clubs, and other establishments from which relatively large amounts of grease may be discharged to a wastewater treatment facility owned by the grease producing entity. Grease interceptors are typically constructed from fiberglass reinforced polyester, high density polyethylene (HDPE), or concrete. For corrugated HDPE grease interceptors, follow ASTM F2649 – 14 *Standard Specification for Corrugated High Density Polyethylene (HDPE) Grease Interceptor Tanks*, as approved and published September 1, 2014. For precast concrete grease interceptor tanks, follow ASTM C1613 – 17 *Standard Specification for Precast Concrete Grease Interceptor Tanks*, as approved and published September 1, 2017. 10 CSR 20-8.150(3)
- A septic tank must have a minimum capacity of at least 1,000 gallons. 10 CSR 20-8.180(2)(A)
- The septic tank shall be baffled. 10 CSR 20-8.180(2)(B)
- Subsurface systems shall—
 - Exclude unstabilized fill and soils that have been highly compacted and/or disturbed, such as old road beds, foundations, or similar things; 10 CSR 20-8.200 (8)(A)1.A.
 - Provide adequate surface drainage where slopes are less than two percent; 10 CSR 20-8.200(8)(A)1.B.
 - Provide surface and subsurface water diversion where necessary, such as a curtain or perimeter drain; 10 CSR 20-8.200(8)(A)1.C. and
 - Have a 10 foot buffer from the property line. 10 CSR 20-8.200(8)(A)1.D.
- The vertical separation between the bottom of the drip lines and/or the trench and a limiting layer, including but not limited to, bedrock; restrictive horizon; or seasonal high water table, shall be no less than:
 - Twenty-four inches; 10 CSR 20-8.200(8)(A)2.A. or
 - Twelve inches for systems dispersing secondary or higher quality effluent; 10 CSR 20-8.200(8)(A)2.B. or
 - Forty-eight inches where karst features are present unless the site can be reclassified. 10 CSR 20-8.200(8)(A)2.C.

- Subsurface systems shall be, at a minimum, preceded by preliminary treatment. 10 CSR 20-8.200(8)(B)
 - Loading rates shall not exceed the values assigned by the site and soil evaluation. 10 CSR 20-8.200(8)(C)
 - All network piping and low pressure distribution piping and fittings with polyvinyl chloride (PVC) shall meet ASTM Standard D 1785 *Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80, or 120* as approved and published August 1, 2015, or equivalent rated to meet or exceed ASTM D2466 *Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings* as approved and published August 1, 2017. These standards shall hereby be incorporated by reference into this rule, as published by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959. This rule does not incorporate any subsequent amendments or additions. 10 CSR 20-8.200(9)(A)2.
8. Upon completion of construction:
- A. Racine Apostolic Church will become the continuing authority for operation and maintenance of these facilities;
 - B. Submit an electronic copy of the as built if the project was not constructed in accordance with previously submitted plans and specifications; and
 - C. Submit the Statement of Work Completed form to the department in accordance with 10 CSR 20-6.010(5)(N) (<https://dnr.mo.gov/document-search/wastewater-construction-statement-work-completed-mo-780-2155>).

IV. REVIEW SUMMARY

1. CONSTRUCTION PURPOSE

Construction includes the new conventional subsurface dispersal lines to serve the new dining hall and cafeteria that was constructed in 2024.

2. FACILITY DESCRIPTION

The Racine Apostolic Church is located at 12935 Diver Drive, Racine , in Newton County, Missouri. The facility was previously under the Newton County Health Department for onsite systems, with the construction of the new cafeteria in 2024, the jurisdiction changed to the Department of Natural Resources. The facility has 8 systems onsite, which are estimated below. All are conventional subsurface dispersal systems. Most of the site is served by water from Missouri American Water, except the 4 RV spots, which are on their own well and across Highway K from the rest of the facility. Chris Miller, Southwest Regional Office along with Leasue Meyers from Engineering Section walked the site on July 30, 2024, with no signs of failure observed. Mark Stanley, P.E. with Zanevan Engineering evaluated the site and

observed no signs of failure of the existing systems. Below is a summary of the existing systems, see Appendix A for the new permitted system (permitted feature #001) and Appendix B for the existing site layout. The facility has a design average flow of 5,200 gpd and serves a hydraulic population equivalent of approximately 52 people.

| System | Serves | Construction Date | Details | Design Flow Estimate |
|--------|---|-------------------|--|---|
| 1 | Dining hall, served by MAWC | 2024 | 1,000 gallon grease interceptor 2,000 gallon baffled septic tank with alarm | Assuming 250 people and 5 gpd per person |
| | | | | 1,500gpd |
| 2 | Church, served by MAWC | 2019 | 2,000 gallon septic tank; DHSS permitted | Assuming 250 people and 5 gpd/person |
| | | | | 1,250 gpd |
| 3 | 4 RV sites, on well | 1970/1980 | Unknown | 75 gpd/site |
| | | | | 300 gpd |
| 4 | Old Church, served by MAWC | 1980s | Unknown, next to the building front door | Assume 100 people and 5 gpd/person |
| | | | | 500 gpd |
| 5 | Gym and old dining hall, served by MAWC | 1970/1980s | Unknown, tank located next to building approximately by old garage/shed door | Assume 50 people and 15 gpd/person |
| | | | | 750 gpd |
| 6 | School, served by MAWC | Unknown | Unknown, tank located next to building | Approximately 30 people and 15 gpd/person |
| | | | | 450 gpd |
| 7 | House-lower, served by MAWC | Unknown | Unknown | Assume 2 people and 75 gpd/person |
| | | | | 150 gpd |
| 8 | House-overall, served by MAWC | Unknown | Unknown | Assume 4 people and 75 gpd/person |
| | | | | 300 gpd |

3. COMPLIANCE PARAMETERS

The proposed project is required to meet the requirements of [MOG823](#) with an expiration date of August 24, 2027. As the facility is subsurface dispersal, there are no monitoring or reporting requirements in the permit.

4. REVIEW of MAJOR TREATMENT DESIGN CRITERIA

Existing major components that will remain in use include the following:

The existing subsurface system includes 7 other systems installed between the 1970s and 2020. While no system was showing failures at the time of the engineering evaluation, there are recommendations in the future to increase capacity or combine systems together to help equalize flow within the system and to replace older systems.

For the dining hall cafeteria, the following components were installed in 2024 with approval by the Newton County Health Department and the Department of Natural Resources for pump and haul operations for the end of July annual meeting. The tanks are installed in series.

- Grease Interceptor- A grease interceptor is utilized to intercept and collect grease from raw wastewater and prevents grease from clogging downstream components with an actual effective volume of 1,000 gallons.
 - The grease interceptor is 8.5 ft by 5.5 ft by 5 ft with a water depth of 4 feet.
 - Based on the peak usage during the annual meeting, of 250 people receiving meals twice a day, the minimum volume of the grease interceptor should be 200 gallons.
 - Accumulated grease in the interceptor shall be removed by a contract hauler.
- Septic Tank – A septic tank provides passive primary treatment as the settleable solids in raw wastewater settle onto the bottom of the tank. Raw wastewater will flow by gravity to the 2,000 gallon septic tank.
 - When the water level reaches a certain height, the wastewater flows into the second compartment by two tee-drop pipes. The septic tank is 12.5 ft x 7 ft x 5.4 ft with a water level depth of 4 ft.
 - The septic tanks provide approximately 1.33 days of detention at design average flow.
 - The septic tank is equipped with an alarm.
 - From the septic tank, flows will go to the new subsurface dispersal field by gravity.
 - Settled solids in the septic tank shall be removed by a contract hauler.

Construction will cover the following items:

- Installation of approximately 136 linear feet of 6-inch PVC with a precast manhole.
- Subsurface Soil Dispersal System – The soils at this site are rated for 0.4 gpd/sf.
 - The geohydrologic evaluation from April 30, 2025, stated the surficial materials in the proposed dispersal area are primarily brown silt loam with gravel.
 - The gravel content increases with depth, and a gravelly layer was encountered at approximately two feet below grade.
 - The silt loam materials have a moderate permeability and the residuum a moderate to high permeability.
 - According to geologic mapping and local well records, the uppermost bedrock at the site is Mississippian-age Burlington-Keokuk Limestone.
 - There are no known karst features within one mile of the site.
 - Soil morphology review was conducted during the construction permit application review and on site soils were determined to be acceptable for this system.
 - The soil investigation was completed by Rachel Deem, with Ozark Soils Consulting on October 20, 2023. One pit was dug onsite. However, as the facility had put in a county health department system in 2019 close to this location, that information was also reviewed. The pits showed that the area is suitable with gravels appearing at about 31 inches below grade.
 - Conventional – There will be 1 subsurface conventional systems installed. The system will have 10 lines of 100 feet each, with a minimum of 5 feet between each line, providing an area of approximately 5,000 sq ft, more than meeting the 3,750 sq ft required for loading at 0.4 gpd/ sq ft for a design flow of 1,500 gpd.

5. OPERATING PERMIT

After completion of construction project submit: statement of work completed, as-builts if the project was not constructed in accordance with previously submitted plans and specifications. As this is an existing facility previously regulated by the Newton County Health Department, the operating permit, MOG823253, will be issued concurrently with this construction permit. As there are no sampling or reporting requirements in the operating permit, the operating permit already covers the proposed construction (permitted feature #001). The initial operating permit fee has been paid.

V. NOTICE OF RIGHT TO APPEAL


If you were adversely affected by this decision, you may be entitled to an appeal before the Administrative Hearing Commission (AHC) pursuant to Section 621.250 RSMo. To appeal, you must file a petition with the AHC within 30 days after the date this decision was mailed or the date it was delivered, whichever date was earlier. If any such petition is sent by registered mail or certified mail, it will be deemed filed on the date it is mailed; if it is sent by any method other than registered mail or certified mail, it will be deemed filed on the date it is received by the AHC. Any appeal should be directed to:

Administrative Hearing Commission
U.S. Post Office Building, Third Floor
131 West High Street, P.O. Box 1557
Jefferson City, MO 65102-1557
Phone: 573-751-2422
Fax: 573-751-5018
Website: <https://ahc.mo.gov>


Leasue Meyers, EI
Engineering Section
leasue.meyers@dnr.mo.gov


Chia-Wei Young, P.E.
Engineering Section
chia-wei.young@dnr.mo.gov

Appendix A: General Site Layout for Dining Hall Expansion

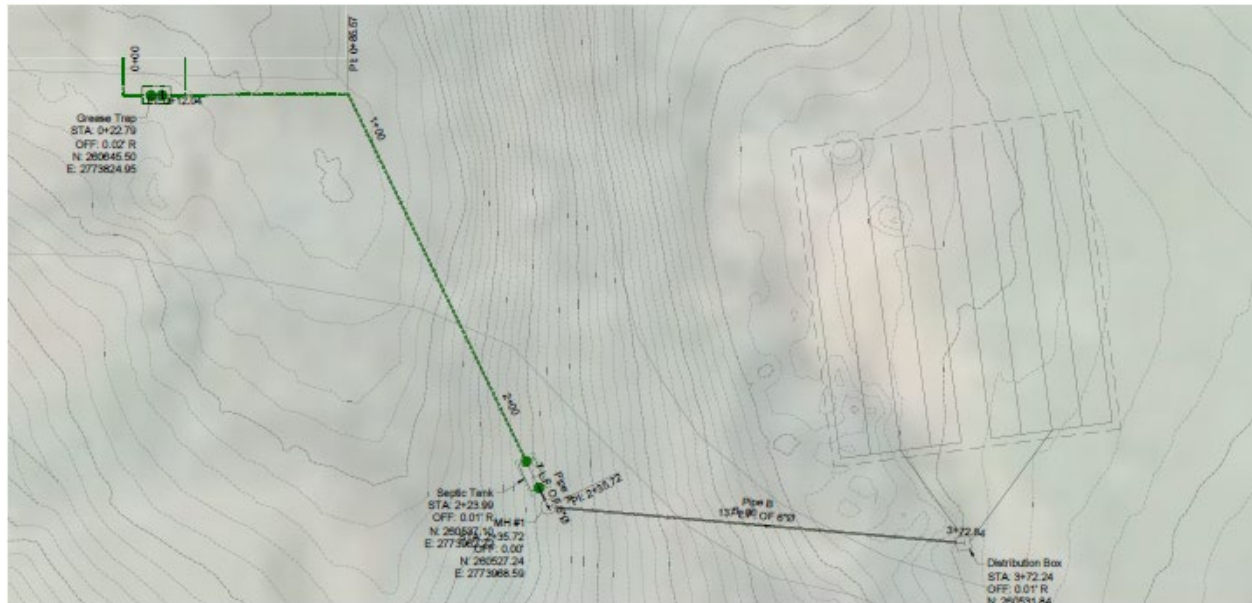

Appendix B: Overall Site Layout

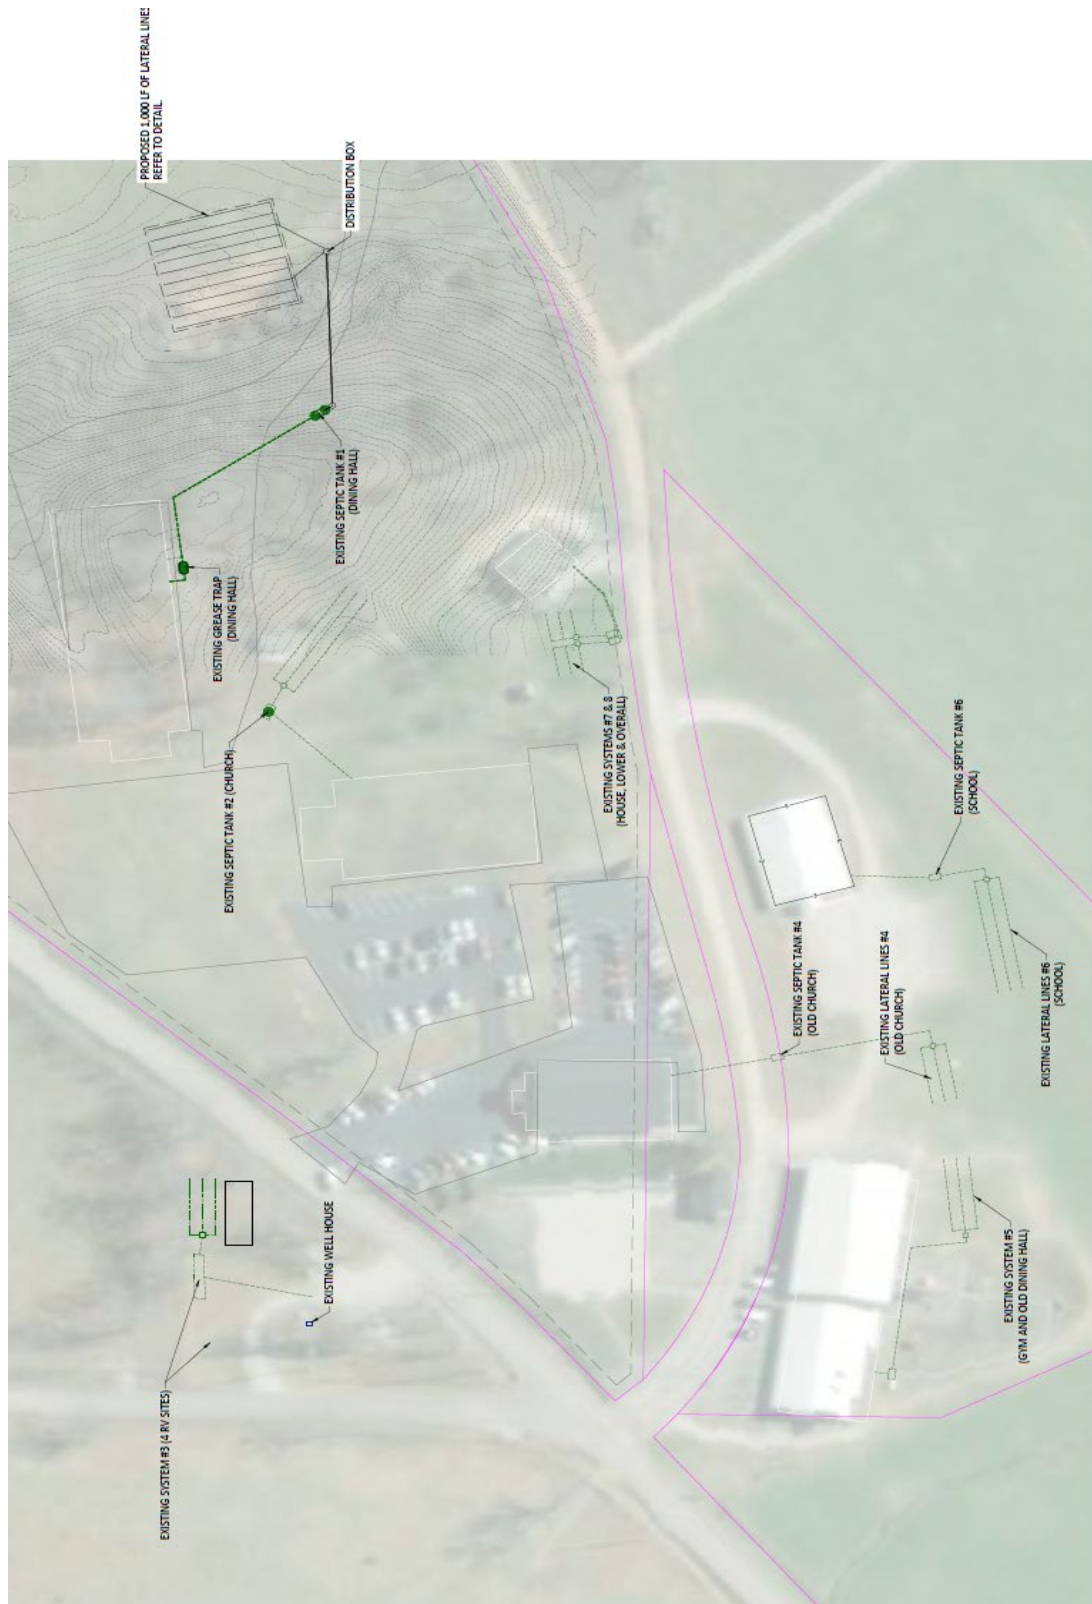



MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM

APPLICATION FOR CONSTRUCTION PERMIT
WASTEWATER TREATMENT FACILITY

RECEIVED
SEP-09 2024
DEQ/SWRO

FOR DEPARTMENT USE ONLY

| | |
|----------------------------|-------------------|
| APP NO. | CP NO. |
| FEE RECEIVED \$ 1000.00 | CHECK NO. 3185 |
| DATE RECEIVED 9-9-2024 | |

APPLICATION OVERVIEW

The Application for Construction Permit – Wastewater Treatment Facility form has been developed in a modular format and consists of Part A and B. **All applicants must complete Part A.** Part B should be completed for applicants who currently land-apply wastewater or propose land application for wastewater treatment. **Please read the accompanying instructions before completing this form. Submittal of an incomplete application may result in the application being returned.**

PART A – BASIC INFORMATION


1.0 APPLICATION INFORMATION (Note – If any of the questions in this section are answered NO, this application may be considered incomplete and returned.)

- 1.1 Is this a Federal/State funded project? ☐ YES ☒ N/A Funding Agency: _____ Project #: _____
- 1.2 Has the Missouri Department of Natural Resources approved the proposed project's antidegradation review?
☒ YES Date of Approval: _____ ☐ N/A
- 1.3 Has the department approved the proposed project's facility plan*?
☒ YES Date of Approval: _____ ☐ NO (If No, complete No. 1.4.)
- 1.4 [Complete only if answered No on No. 1.3.] Is a copy of the facility plan* for wastewater treatment facilities included with this application?
☐ YES ☐ NO ☐ Exempt because _____
- 1.5 Is a copy of the appropriate plans* and specifications* included with this application?
☐ YES Denote which form is submitted: ☐ Hard copy ☐ Electronic copy (See instructions.) ☒ NO
- 1.6 Is a summary of design* included with this application? ☐ YES ☒ NO
- 1.7 Has the appropriate operating permit application (A, B, or B2) been submitted to the department?
☒ YES Date of submittal: _____
☐ Enclosed is the appropriate operating permit application and fee submittal. Denote which form: ☒ A ☐ B ☐ B2
☐ N/A: However, In the event the department believes that my operating permit requires revision to permit limitation such as changing equivalent to secondary limits to secondary limits or adding total residual chlorine limits, please share a draft copy prior to public notice? ☐ YES ☐ NO
- 1.8 Is the facility currently under enforcement with the department or the Environmental Protection Agency? ☐ YES ☒ NO
- 1.9 Is the appropriate fee or JetPay confirmation included with this application? ☒ YES ☐ NO
See Section 7.0

* Must be affixed with a Missouri registered professional engineer's seal, signature and date.

2.0 PROJECT INFORMATION

| | |
|--|---|
| 2.1 NAME OF PROJECT Racine Apostolic Church Cafeteria | 2.2 ESTIMATED PROJECT CONSTRUCTION COST \$ |
| 2.3 PROJECT DESCRIPTION Cafeteria and Dining Hall | |
| 2.4 SLUDGE HANDLING, USE AND DISPOSAL DESCRIPTION | |
| 2.5 DESIGN INFORMATION A. Current population: _____; Design population: _____ B. Actual Flow: _____ gpd; Design Average Flow: _____ gpd; Actual Peak Daily Flow: _____ gpd; Design Maximum Daily Flow: _____ gpd; Design Wet Weather Event: _____ | |
| 2.6 ADDITIONAL INFORMATION A. Is a topographic map attached? <input type="checkbox"/> YES <input type="checkbox"/> NO B. Is a process flow diagram attached? <input type="checkbox"/> YES <input type="checkbox"/> NO | |

| | | | | |
|---|---------------------|---|-------------------|---|
| 3.0 WASTEWATER TREATMENT FACILITY | | | | |
| NAME Racine Apostolic Church | | TELEPHONE NUMBER WITH AREA CODE 417-342-3810 | | E-MAIL ADDRESS kenschroader@yahoo.com |
| ADDRESS (PHYSICAL) 12894 Diver Drive | CITY Neosho | STATE MO | ZIP CODE 64850 | COUNTY Newton |
| Wastewater Treatment Facility: Mo- (Outfall Of) | | | | |
| 3.1 Legal Description: SW 1/4, SW 1/4, 1/4, Sec. 16, T 25N, R 33W (Use additional pages if construction of more than one outfall is proposed.) | | | | |
| 3.2 UTM Coordinates Easting (X): Northing (Y): For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83) | | | | |
| 3.3 Name of receiving streams: _____ | | | | |
| 4.0 PROJECT OWNER | | | | |
| NAME Racine Apostolic Church | | TELEPHONE NUMBER WITH AREA CODE 417-342-3810 | | E-MAIL ADDRESS |
| ADDRESS P.O. Box 929 | CITY Racine | STATE MO | ZIP CODE 64858 | |
| 5.0 CONTINUING AUTHORITY: A continuing authority is a company, business, entity or person(s) that will be operating the facility and/or ensuring compliance with the permit requirements. | | | | |
| NAME Keith Sampson | | TELEPHONE NUMBER WITH AREA CODE 417-389-0382 | | E-MAIL ADDRESS sampsondoneright@gmail.com |
| ADDRESS P.O. Box 21 | CITY Racine | STATE MO | ZIP CODE 64858 | |
| 5.1 A letter from the continuing authority, if different than the owner, is included with this application. <input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> N/A | | | | |
| 5.2 COMPLETE THE FOLLOWING IF THE CONTINUING AUTHORITY IS A MISSOURI PUBLIC SERVICE COMMISSION REGULATED ENTITY. | | | | |
| A. Is a copy of the certificate of convenience and necessity included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO | | | | |
| 5.3 COMPLETE THE FOLLOWING IF THE CONTINUING AUTHORITY IS A PROPERTY OWNERS ASSOCIATION. | | | | |
| A. Is a copy of the as-filed restrictions and covenants included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO | | | | |
| B. Is a copy of the as-filed warranty deed, quitclaim deed or other legal instrument which transfers ownership of the land for the wastewater treatment facility to the association included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO | | | | |
| C. Is a copy of the as-filed legal instrument (typically the plat) that provides the association with valid easements for all sewers included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO | | | | |
| D. Is a copy of the Missouri Secretary of State's nonprofit corporation certificate included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO | | | | |
| 6.0 ENGINEER | | | | |
| ENGINEER NAME / COMPANY NAME Doug Carmichael P.E. | | TELEPHONE NUMBER WITH AREA CODE 417-830-2170 | | E-MAIL ADDRESS dougcar michael62@gmail.com |
| ADDRESS 2342 W. Buena Vista | CITY Springfield | STATE MO | ZIP CODE 65810 | |
| 7.0 APPLICATION FEE | | | | |
| <input type="checkbox"/> CHECK NUMBER <input type="checkbox"/> JETPAY CONFIRMATION NUMBER | | | | |
| 8.0 PROJECT OWNER: I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. | | | | |
| PROJECT OWNER SIGNATURE  | | | | |
| PRINTED NAME Keith Sampson | | | DATE 8/26/24 | |
| TITLE OR CORPORATE POSITION Property Management | | TELEPHONE NUMBER WITH AREA CODE 417-389-0382 | | E-MAIL ADDRESS sampsondoneright@gmail.com |
| Mail completed copy to: MISSOURI DEPARTMENT OF NATURAL RESOURCES WATER PROTECTION PROGRAM P.O. BOX 176 JEFFERSON CITY, MO 65102-0176 | | | | |
| END OF PART A. | | | | |
| REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHETHER PART B NEEDS TO BE COMPLETE. | | | | |