

**STATE OF MISSOURI**  
**DEPARTMENT OF NATURAL RESOURCES**  
**MISSOURI CLEAN WATER COMMISSION**



**CONSTRUCTION PERMIT**

The Missouri Department of Natural Resources hereby issues a permit to:

LAKE OF THE OZARKS WATERPARK, INC.  
Big Surf Waterpark  
954 State Road Y  
Linn Creek, MO 65052

for the construction of (described facilities):

See attached.

Permit Conditions:

See attached.

Construction of such proposed facilities shall be in accordance with the provisions of the Missouri Clean Water Law, Chapter 644, RSMo, and regulation promulgated thereunder, or this permit may be revoked by the Department of Natural Resources (department).

As the department does not examine structural features of design or the efficiency of mechanical equipment, the issuance of this permit does not include approval of these features.

A representative of the department may inspect the work covered by this permit during construction. Issuance of a permit to operate by the department will be contingent on the work substantially adhering to the approved plans and specifications.

This permit applies only to the construction of water pollution control components; it does not apply to other environmentally regulated areas.

March 12, 2025  
Effective Date

March 11, 2027  
Expiration Date

  
John Hoke, Director, Water Protection Program

## **CONSTRUCTION PERMIT**

### **I. CONSTRUCTION DESCRIPTION**

Construction of approximately 33 linear feet of 6-inch gravity sewers including 2 concrete manholes. The existing deteriorated extended aeration wastewater treatment plant will be replaced and moved approximate 20 feet from its current location (like-for-like replacement) and a new tertiary recirculating sand filter for ammonia treatment will be constructed. Design average flow will remain at 22,000 gallons per day (gpd). The current effluent limits will remain unchanged.

This project will also include general site work appropriate to the scope and purpose of the project and all necessary appurtenances to make a complete and usable wastewater treatment facility.

### **II. COST ANALYSIS FOR COMPLIANCE**

Pursuant to Section 644.145, RSMo, when issuing permits under this chapter that incorporate a new requirement for discharges from publicly owned combined or separate sanitary or storm sewer systems or publicly owned treatment works, or when enforcing provisions of this chapter or the Federal Water Pollution Control Act, 33 U.S.C. 1251 et seq., pertaining to any portion of a publicly owned combined or separate sanitary or storm sewer system or [publicly owned] treatment works, the Department of Natural Resources shall make a “finding of affordability” on the costs to be incurred and the impact of any rate changes on ratepayers upon which to base such permits and decisions, to the extent allowable under this chapter and the Federal Water Pollution Control Act. This process is completed through a cost analysis for compliance. Permits that do not include new requirements may be deemed affordable.

The department is not required to complete a cost analysis for compliance because the facility is not a combined or separate sanitary sewer system for a publicly owned treatment works.

### **III. CONSTRUCTION PERMIT CONDITIONS**

The permittee is authorized to construct subject to the following conditions:

1. This construction permit does not authorize discharge.
2. All construction shall be consistent with plans and specifications signed and sealed by Joseph Heberlie, P.E., with Missouri Engineering Company and as described in this permit.

3. The department must be contacted in writing prior to making any changes to the plans and specifications that would directly or indirectly have an impact on the capacity, flow, system layout, or reliability of the proposed wastewater treatment facilities or any design parameter that is addressed by 10 CSR 20-8, in accordance with 10 CSR 20-8.110(11).
4. State and federal law does not permit bypassing of raw wastewater, therefore steps must be taken to ensure that raw wastewater does not discharge during construction. If a sanitary sewer overflow or bypass occurs, report the appropriate information to the department's Central Field Operations Office per 10 CSR 20-7.015(9)(G).
5. The completed project shall be field tested to verify actual pumped volume of each dose. The timer controls shall be set to ensure a dosing rate not to exceed the allowable rate of 9.16 gallons per square foot per day
6. In addition to the requirements for a construction permit, 10 CSR 20-6.200 requires land disturbance activities of one acre or more to obtain a Missouri state operating permit to discharge stormwater. The permit requires best management practices sufficient to control runoff and sedimentation to protect waters of the state. Land disturbance permits will only be obtained by means of the department's ePermitting system available online at <https://dnr.mo.gov/data-e-services/missouri-gateway-environmental-management-mogem>. See <https://dnr.mo.gov/data-e-services/water/electronic-permitting-epermitting> for more information.
7. A United States Army Corps of Engineers (USACE) Clean Water Act Section 404 Department of the Army permit and a Section 401 Water Quality Certification issued by the department may be required for the activities described in this permit. This permit is not valid until these requirements are satisfied or notification is provided that no Section 404 permit is required by the USACE. You must contact your local USACE district since they determine what waters are jurisdictional and which permitting requirements may apply. You may call the department's Water Protection Program, Operating Permits Section at 573-522-4502 for more information. See <https://dnr.mo.gov/water/business-industry-other-entities/permits-certification-engineering-fees/section-401-water-quality> for more information.
8. In accordance with 10 CSR 20-6.010(12), a full closure plan shall be submitted to the department's Central Field Operations Office for review and approval of any permitted wastewater treatment system being replaced. The closure plan must meet the requirements outlined in Standard Conditions Part III of the Missouri State Operating Permit No. MO- 0107751.
9. All construction must adhere to applicable 10 CSR 20-8 (Chapter 8) requirements listed below.
  - Flood protection shall apply to new construction and to existing facilities undergoing major modification. The wastewater facility structures, electrical equipment, and mechanical equipment shall be protected from physical damage by not less than the 100-year flood elevation. 10 CSR 20-8.140(2)(B)

- Facilities shall be readily accessible by authorized personnel from a public right-of-way at all times. 10 CSR 20-8.140(2)(D)
- All wastewater treatment facilities shall be provided with an alternate source of electric power or pumping capability to allow continuity of operation during power failures. 10 CSR 20-8.140(7)(A)1.
- An audiovisual alarm or a more advanced alert system, with a self-contained power supply, capable of monitoring the condition of equipment whose failure could result in a violation of the operating permit, shall be provided for all wastewater treatment facilities. 10 CSR 20-8.140(7)(C)
- Adequate provisions shall be made to effectively protect facility personnel and visitors from hazards. The following shall be provided to fulfill the particular needs of each wastewater treatment facility:
  - Fencing. Enclose the facility site with a fence designed to discourage the entrance of unauthorized persons and animals; 10 CSR 20-8.140 (8) (A)
  - Gratings over appropriate areas of treatment units where access for maintenance is necessary; 10 CSR 20-8.140(8)(B)
  - First aid equipment; 10 CSR 20-8.140(8)(C)
  - Posted “No Smoking” signs in hazardous areas; 10 CSR 20-8.140(8)(D)
  - Appropriate personal protective equipment (PPE); 10 CSR 20-8.140(8)(E)
  - Portable blower and hose sufficient to ventilate accessed confined spaces; 10 CSR 20-8.140(8)(F)
  - 10 CSR 20-8.140(8)(G) Portable lighting equipment complying with NEC requirements. See subsection (7)(B) of this rule;
  - 10 CSR 20-8.140(8)(H) Gas detectors listed and labeled for use in NEC Class I, Division 1, Group D locations. See subsection (7)(B) of this rule;
  - Appropriately-placed warning signs for slippery areas, non-potable water fixtures (see subparagraph (7)(D)3.B. of this rule), low head clearance areas, open service manholes, hazardous chemical storage areas, flammable fuel storage areas, high noise areas, etc.; 10 CSR 20-8.140(8)(I)
- Recirculating media filters with a capacity of 22,500 gpd or less shall be located no closer than the minimum distance of 50 feet to a neighboring residence. A minimum of 2 recirculating media filter beds and a diversion box are required for all design flows. 10 CSR 20-8.180(3)(B)
- Dosing. Both timer and float switch controls are required; timers are the primary method of operation and the float switch control is a back-up. 10 CSR 20-8.180(3)(C)
- The media is any of a number of physical structures whose sole purpose is to provide a surface to support biological growth. Commonly used media includes rock, gravel, and sand of various sizes, textile media, and peat. Finely crushed limestone, dolomite, slag, any clay, limestone, or appreciable amounts of organic material is not acceptable. 10 CSR 20-8.180(3)(E)

- Filtration systems shall have:
  - Convenient access to all components and the media surface for inspection and maintenance without taking other units out of service; 10 CSR 20-8.210(3)(B)1.A.
  - Enclosed controls and heating and ventilation equipment to control humidity; 10 CSR 20-8.210(3)(B)1.B. and
  - The capacity to process the design average flow to the filters with the largest unit out of service utilizing a minimum of two units. 10 CSR 20-8.210(3)(B)1.C.

10. Upon completion of construction:

- A. LAKE OF THE OZARKS WATERPARK, INC. will become the continuing authority for operation and maintenance of these facilities;
- B. Submit an electronic copy of the as builts if the project was not constructed in accordance with previously submitted plans and specifications; and
- C. Submit the Statement of Work Completed form to the department in accordance with 10 CSR 20-6.010(5)(N) (<https://dnr.mo.gov/document-search/wastewater-construction-statement-work-completed-mo-780-2155>) and request the modification be issued. The operating permit modification fee is 450 dollars.

#### **IV. REVIEW SUMMARY**

##### **1. CONSTRUCTION PURPOSE**

The existent wastewater is in compliance with effluent limits. The proposed construction is addressing possible more stringent future Ammonia limits as the facility is in a numeric lake watershed. The facility currently discharges in the Lake of the Ozarks watershed, which is listed on the 303(d) impaired waterbodies list for nutrients and the department is in the process of developing a total maximum daily load. Besides total nutrient removal, the department is in the process of adopting EPA's 2013 ammonia criteria, which will reduce ammonia effluent limits.

##### **2. FACILITY DESCRIPTION**

The Big Surf Waterpark WWTF is located at 954 State Road Y, Linn Creek City, in Camden County, Missouri. The facility has a design average flow of 22,000 gpd and serves a hydraulic population equivalent of approximately 266 people. The current facility is a deteriorated precast concrete extended aeration packaged plant, consisting of aeration basins, clarification, chlorination and a dechlorination units, and sludge storage tank. The new proposed construction includes replacement of the existing extended aeration plant with a new, identical extended aeration plant consisting of 7 concrete tanks and the addition of 2 recirculating sand filters with approximate dimensions of 40 x 60 x 5 feet, for tertiary ammonia treatment, and a recirculation pump tank for each. Effluent will continue to the existing chlorination and dechlorination treatment units.

### 3. COMPLIANCE PARAMETERS

Effluent limits following the construction will remain the same for the facility as presented in the next table:

Parameter	Units	Monthly average limit
Biochemical Oxygen Demand <sub>5</sub>	mg/L	10
Total Suspended Solids	mg/L	15
Ammonia as N (Jan 1-March 31)	mg/L	3.0
Ammonia as N (April 1- June 30)	mg/L	2.0
Ammonia as N (July 1 – September 30)	mg/L	1.5
Ammonia as N (Oct 1 – December 31)	mg/l	2.9
pH	SU	6.5-9.0
Total Residual Chlorine	µg/L	< 130
<i>E. coli</i>	#/100mL	126

### 4. REVIEW of MAJOR TREATMENT DESIGN CRITERIA

**Existing major components that will remain in use include the following:**

- Disinfection – Disinfection is the process of removal, deactivation, or killing of pathogenic microorganisms.
  - Current Chlorination and dichlorination units will remain.
- Flow Measurement – Existent V notch unit for flow measurement after dechlorination tank will remain.
- Oxygen enhancement – Current Oxygen enhancement unit will be reused. Existing blowers, diffusers, valves and piping and any other part that is in good condition will be reused in the new extended aeration tanks and sludge storage tank.
- Existent outfall will remain the same.

**Construction will cover the following items:**

- Construction of approximately 33 linear feet of 6-inch gravity sewers including 2 concrete manholes.
- Extended aeration package plant capable of treating an average design flow of 22,000 gpd. The new extended aeration plant is a like-for-like replacement located about 20 feet to the east of the current location to accommodate construction of the new recirculating sand filters and recirculating tanks.

- The existing extended aeration plant will be replaced with one of identical design. There will be 7 concrete tanks with approximate dimension of 12' 10" x 6' 10" x 13' 2" (width, length, and height), five aeration tanks, one sludge holding tank and one settling tank.
- Aeration tanks 1 through 5 and sludge holding tank air headers, drop pipes, and air piping will have the piping system replaced if observed in bad condition with scheduled 40 galvanized pipe. Each diffuser drop pipe assembly will have a control valve and disconnection union to permit adjustment of airflow and removal of the assembly for service, without disturbing the plant operation. Each diffuser bar assembly will be equipped with non-clog diffusers which use a trapped bubble of air to isolate and protect the diffuser from contact with wastewater even during shut-off periods.
- Final settling tank: Will be constructed with hopper walls sloped a minimum of 60 degree to the horizontal with a bottom measuring one square foot in each hopper. Inlet and outlet baffle shall be reinstalled to prevent short-circuiting and keep floating solids from the effluent weir. Settle sludge will be piped to aeration or sludge holding by airlift pumps installed in each hopper. The airlift pumps shall be capable of exceeding the plant's total daily flow and each pump shall be controlled by an adjustable valve. An airlift surface skimmer with adjustable PVC intake fitting and adjustment/shut-off valve will be installed. Skimmer will be made from 40 galvanized pipe. Skimmer will return floating particles in final settling chamber back to aeration for further treatment. Effluent from the final settling tank will be divided between the two recirculating tank pumps via two gate valves.
- All seven concrete basin will be furnished with steel-bar grating consisting of 1.25 by 1.125 bar members. Gratings will be hinged and secured with master-keyed padlocks.
- Recirculation Tank for Sand Filter – Construction of two recirculation tanks to pump treated wastewater from the extended aeration plant to the recirculating media filter. The recirculation tanks are approximate 17 ft x 8 ft x 10 ft deep with a water level depth of 7.28 ft for a wastewater volume of approximately 7,554 gallons each. Effective flow equalization volume of 425.4 gallons between the low water level and the high water "on" level. Each recirculation tank will have 2 - 1 HP submersible pumps – each capable of 52.2 gpm at 48 ft TDH. The submersible pumps transfer wastewater to 5 separate zones of the recirculating media filter by means of a distributing valve model V6605 or similar which alternates the dose into 4 2-inch PVC laterals in each zone. The distributing valve sit on top the re-circulation tanks and can take the flow from the sand filter and distribute it as follows: 100 percent back into to the re-circulation tank; or up to 20 percent to the de-chlorinator and 80 percent back into the re-circulation tank.

- **Recirculating Media Filter Beds**– Each bed will be concrete with a 30mil PVC liner. There are two recirculating media filters sharing one side wall. Each media filter is split into five zones. Each filter bed is approximately 40 ft x 60 ft x 5 ft deep, each having a surface area of 2,400 ft<sup>2</sup> which gives a total hydraulic loading of 9.16 gpd/ft<sup>2</sup> at design average flow. The PVC laterals are spaced 2-ft apart with 30 1/8-inch shielded orifices per lateral. The laterals are located in the center of the top 9-inch layer of 3/8-inch pea gravel. The number of laterals per zone is 4, the number of zones per filter bed is 5. The filter media layer is 27-inches deep containing media with an effective size of 2 mm to 5 mm and a uniformity coefficient less than 2.5. The underdrain has an approximate 2-inch layer of 3/8-inch pea gravel on top of an approximate 4-inch layer of 1/2-inch to 3/4-inch rock. Each filter bed contains 4 underdrains comprised of 4-inch slotted PVC piping with approximate 10-ft spacing.

## **5. OPERATING PERMIT**

These construction activities do not change the effluent limits or conditions of the current operating permit. Submit an operating permit modification application and the \$450.00 fee at least 180 days prior to construction completion. The modified permit that reflects the current updated facility description will be issued upon receipt of the Statement of Work Completed form.

Operating permit MO-0107751 will be expiring on September 30, 2028. A renewal application must be filed before April 3, 2028, regardless of the status of these construction activities. If you have questions on completing the renewal application, please contact the NPDES permitting section at 573-522-4502 or [cleanwaterpermits@dnr.mo.gov](mailto:cleanwaterpermits@dnr.mo.gov).

This facility is not being converted to a general operating permit at this time, as the construction does not trigger a modification of the operating permit under 10 CSR 20-6.010 and as such it will be evaluated at operating permit renewal to determine if it qualifies for a general permit.



## **V. NOTICE OF RIGHT TO APPEAL**

If you were adversely affected by this decision, you may be entitled to an appeal before the Administrative Hearing Commission (AHC) pursuant to Section 621.250 RSMo. To appeal, you must file a petition with the AHC within 30 days after the date this decision was mailed or the date it was delivered, whichever date was earlier. If any such petition is sent by registered mail or certified mail, it will be deemed filed on the date it is mailed; if it is sent by any method other than registered mail or certified mail, it will be deemed filed on the date it is received by the AHC. Any appeal should be directed to:


Administrative Hearing Commission  
U.S. Post Office Building, Third Floor  
131 West High Street, P.O. Box 1557  
Jefferson City, MO 65102-1557  
Phone: 573-751-2422  
Fax: 573-751-5018  
Website: <https://ahc.mo.gov>

Francisco Cortalezzi, EI  
Water Protection Program - Engineering Section  
[francisco.cortalezzi@dnr.mo.gov](mailto:francisco.cortalezzi@dnr.mo.gov)


Chia-Wei Young, P.E.  
Water Protection Program - Engineering Section  
[chia-wei.young@dnr.mo.gov](mailto:chia-wei.young@dnr.mo.gov)

## APPENDICES

- Process Flow Diagram

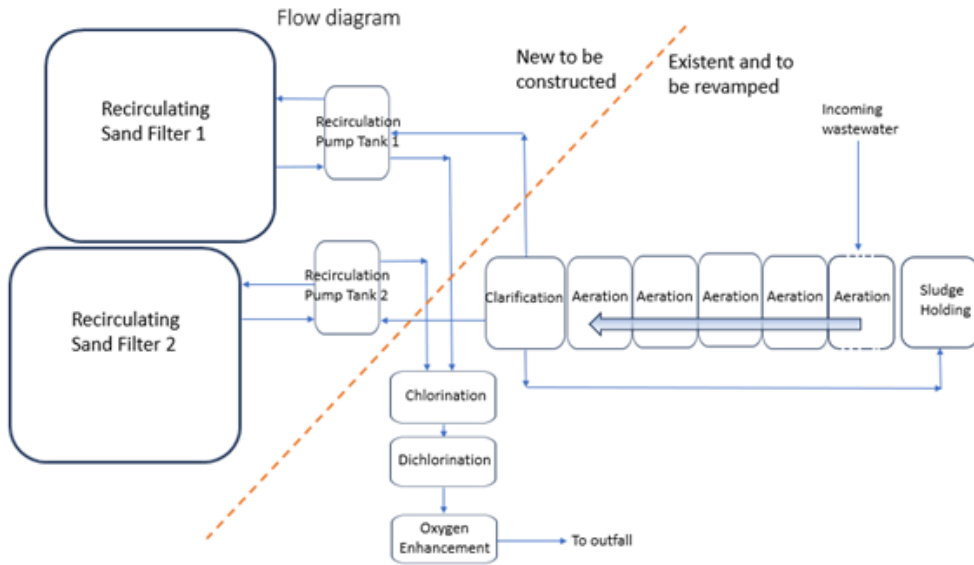

• **Plans**

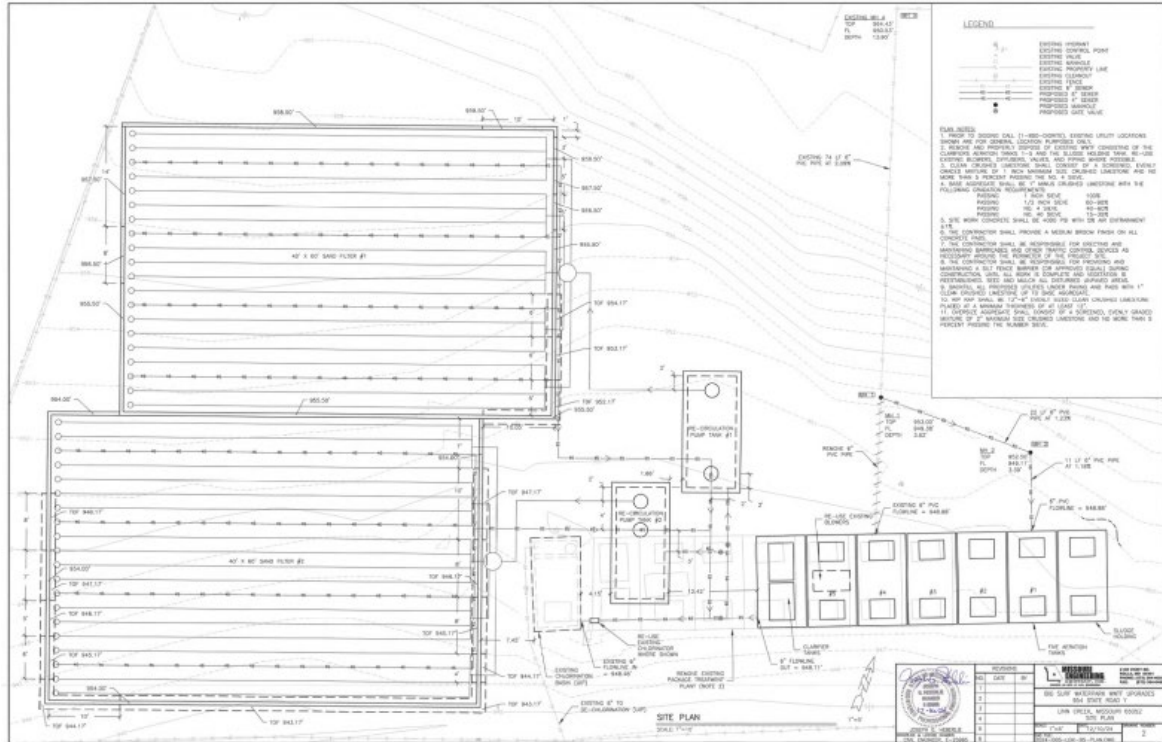



MISSOURI DEPARTMENT OF NATURAL RESOURCES  
 WATER PROTECTION PROGRAM  
**APPLICATION FOR CONSTRUCTION PERMIT –  
 WASTEWATER TREATMENT FACILITY**

FOR DEPARTMENT USE ONLY	
APP NO.	CP NO.
FEE RECEIVED	CHECK NO.
DATE RECEIVED	

**APPLICATION OVERVIEW**

The Application for Construction Permit – Wastewater Treatment Facility form has been developed in a modular format and consists of Part A and B. All applicants must complete Part A. Part B should be completed for applicants who currently land-apply wastewater or propose land application for wastewater treatment. Please read the accompanying instructions before completing this form. Submittal of an incomplete application may result in the application being returned.

**PART A – BASIC INFORMATION**

**1.0 APPLICATION INFORMATION** (Note – If any of the questions in this section are answered NO, this application may be considered incomplete and returned.)

- 1.1 Is this a Federal/State funded project?  YES  N/A Funding Agency: \_\_\_\_\_ Project #: \_\_\_\_\_
- 1.2 Has the Missouri Department of Natural Resources approved the proposed project's antidegradation review?  
 YES Date of Approval: \_\_\_\_\_  N/A
- 1.3 Has the department approved the proposed project's facility plan\*?  
 YES Date of Approval: 10-9-24  NO (If No, complete No. 1.4.)
- 1.4 [Complete only if answered No on No. 1.3.] Is a copy of the facility plan\* for wastewater treatment facilities included with this application?  
 YES  NO  Exempt because \_\_\_\_\_
- 1.5 Is a copy of the appropriate plans\* and specifications\* included with this application?  
 YES Denote which form is submitted:  Hard copy  Electronic copy (See instructions.)  NO
- 1.6 Is a summary of design\* included with this application?  YES  NO
- 1.7 Has the appropriate operating permit application (A, B, or B2) been submitted to the department?  
 YES Date of submittal: \_\_\_\_\_  
 Enclosed is the appropriate operating permit application and fee submittal. Denote which form:  A  B  B2  
 N/A: However, in the event the department believes that my operating permit requires revision to permit limitation such as changing equivalent to secondary limits or adding total residual chlorine limits, please share a draft copy prior to public notice?  YES  NO
- 1.8 Is the facility currently under enforcement with the department or the Environmental Protection Agency?  YES  NO
- 1.9 Is the appropriate fee or JetPay confirmation included with this application?  YES  NO  
 See Section 7.0

\* Must be affixed with a Missouri registered professional engineer's seal, signature and date.

**2.0 PROJECT INFORMATION**

2.1 NAME OF PROJECT Big Surf Waterpark WWTF	2.2 ESTIMATED PROJECT CONSTRUCTION COST \$ 295,000.00
--	--

2.3 PROJECT DESCRIPTION  
 The project consists of replacing the aeration and clarifier concrete basins and adding recirculating sand filtration to reduce the ammonia in the effluent to below new limits.

SLUDGE HANDLING, USE AND DISPOSAL DESCRIPTION


Pumped and hauled as needed.

2.5 DESIGN INFORMATION

- A. Current population: \_\_\_\_\_; Design population: 266
- B. Actual Flow: 19 K gpd; Design Average Flow: 22 K gpd;  
 Actual Peak Daily Flow: \_\_\_\_\_ gpd; Design Maximum Daily Flow: \_\_\_\_\_ gpd; Design Wet Weather Event: N/A

2.6 ADDITIONAL INFORMATION

- A. Is a topographic map attached?  YES  NO
- B. Is a process flow diagram attached?  YES  NO

3.0 WASTEWATER TREATMENT FACILITY				
NAME Blg Surf Waterpark WWTF		TELEPHONE NUMBER WITH AREA CODE 573-692-2300		E-MAIL ADDRESS dkelm@blgsurfwaterpark.com
ADDRESS (PHYSICAL) 954 State Road Y		CITY Linn Creek	STATE MO	ZIP CODE 65052
COUNTY Camden				
Wastewater Treatment Facility: Mo- 017751 (Outfall 1 Of 1 )				
3.1 Legal Description: <u>SE 1/4, SW 1/4, SW 1/4, Sec. 33, T 39N, R 16W</u> (Use additional pages if construction of more than one outfall is proposed.)				
3.2 UTM Coordinates Easting (X): <u>526743</u> Northing (Y): <u>4213542</u> For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83)				
3.3 Name of receiving streams: <u>Presumed Use Streams (C) (5059) (losing)</u>				
4.0 PROJECT OWNER				
NAME Lake of The Ozarks Waterpark, Inc.		TELEPHONE NUMBER WITH AREA CODE 573-692-2300		E-MAIL ADDRESS dkelm@blgsurfwaterpark.com
ADDRESS 954 State Road Y		CITY Linn Creek	STATE MO	ZIP CODE 65052
5.0 CONTINUING AUTHORITY: A continuing authority is a company, business, entity or person(s) that will be operating the facility and/or ensuring compliance with the permit requirements.				
NAME Lake of The Ozarks Waterpark, Inc.		TELEPHONE NUMBER WITH AREA CODE 573-692-2300		E-MAIL ADDRESS dkeim@blgsurfwaterpark.com
ADDRESS 954 State Road Y		CITY Linn Creek	STATE MO	ZIP CODE 65052
5.1 A letter from the continuing authority, if different than the owner, is included with this application. <input type="checkbox"/> YES <input type="checkbox"/> NO <input checked="" type="checkbox"/> N/A				
5.2 COMPLETE THE FOLLOWING IF THE CONTINUING AUTHORITY IS A MISSOURI PUBLIC SERVICE COMMISSION REGULATED ENTITY.				
A. Is a copy of the certificate of convenience and necessity included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO				
5.3 COMPLETE THE FOLLOWING IF THE CONTINUING AUTHORITY IS A PROPERTY OWNERS ASSOCIATION.				
A. Is a copy of the as-filed restrictions and covenants included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO				
B. Is a copy of the as-filed warranty deed, quitclaim deed or other legal instrument which transfers ownership of the land for the wastewater treatment facility to the association included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO				
C. Is a copy of the as-filed legal instrument (typically the plat) that provides the association with valid easements for all sewers included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO				
D. Is a copy of the Missouri Secretary of State's nonprofit corporation certificate included with this application? <input type="checkbox"/> YES <input type="checkbox"/> NO				
6.0 ENGINEER				
ENGINEER NAME / COMPANY NAME Joseph G Heberle, Missouri Engineering Company		TELEPHONE NUMBER WITH AREA CODE 573-364-4003		E-MAIL ADDRESS jheberle@moengco.com
ADDRESS P.O. Box 13		CITY Rolla	STATE MO	ZIP CODE 65402
7.0 APPLICATION FEE				
<input checked="" type="checkbox"/> CHECK NUMBER <u>1037</u> <input type="checkbox"/> JETPAY CONFIRMATION NUMBER				
8.0 PROJECT OWNER: I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.				
PROJECT OWNER SIGNATURE 				
PRINTED NAME Darln Keim			DATE <u>12-9-24</u>	
TITLE OR CORPORATE POSITION <u>President</u>		TELEPHONE NUMBER WITH AREA CODE 573-692-2300		E-MAIL ADDRESS dkeim@blgsurfwaterpark.com
Mail completed copy to: MISSOURI DEPARTMENT OF NATURAL RESOURCES WATER PROTECTION PROGRAM P.O. BOX 176 JEFFERSON CITY, MO 65102-0176				
END OF PART A. REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHETHER PART B NEEDS TO BE COMPLETE.				